



OH1400111 BLANCHESTER VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1453378	Facility Name: BLANCHESTER WTP	Facility Class: CLASS 3
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

Chemicals**Monitoring Requirements**

INORGANICS 1 Sample(s) Required between 1/1/2015 and 5/31/2015

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2015 and 1/31/2015

1 Sample(s) Required between 2/1/2015 and 2/28/2015

1 Sample(s) Required between 3/1/2015 and 3/31/2015

1 Sample(s) Required between 4/1/2015 and 4/30/2015

1 Sample(s) Required between 5/1/2015 and 5/31/2015

1 Sample(s) Required between 6/1/2015 and 6/30/2015

1 Sample(s) Required between 7/1/2015 and 7/31/2015

1 Sample(s) Required between 8/1/2015 and 8/31/2015

1 Sample(s) Required between 9/1/2015 and 9/30/2015

1 Sample(s) Required between 10/1/2015 and 10/31/2015

1 Sample(s) Required between 11/1/2015 and 11/30/2015

1 Sample(s) Required between 12/1/2015 and 12/31/2015

RADIOLOGICALS Not Required

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1

1 Sample(s) Required between 1/1/2015 and 3/31/2015

1 Sample(s) Required between 4/1/2015 and 4/15/2015

1 Sample(s) Required between 4/16/2015 and 4/30/2015

1 Sample(s) Required between 5/1/2015 and 5/15/2015

1 Sample(s) Required between 5/16/2015 and 5/31/2015

1 Sample(s) Required between 6/1/2015 and 6/15/2015

1 Sample(s) Required between 6/16/2015 and 6/30/2015

1 Sample(s) Required between 7/1/2015 and 9/30/2015

1 Sample(s) Required between 10/1/2015 and 12/31/2015

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 1/1/2015 and 5/31/2015

TOTAL ORGANIC CARBON (TOC)

1 Paired Sample Set Required between 1/1/2015 and 1/31/2015

1 Paired Sample Set Required between 2/1/2015 and 2/28/2015

1 Paired Sample Set Required between 3/1/2015 and 3/31/2015

1 Paired Sample Set Required between 4/1/2015 and 4/30/2015

1 Paired Sample Set Required between 5/1/2015 and 5/31/2015

1 Paired Sample Set Required between 6/1/2015 and 6/30/2015

1 Paired Sample Set Required between 7/1/2015 and 7/31/2015

1 Paired Sample Set Required between 8/1/2015 and 8/31/2015

1 Paired Sample Set Required between 9/1/2015 and 9/30/2015

1 Paired Sample Set Required between 10/1/2015 and 10/31/2015



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

OH1400111 BLANCHESTER VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1453378	Facility Name: BLANCHESTER WTP	
Location	SMP ID: EP001	Facility Source: Surface Water	Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

Chemicals

Monitoring Requirements

TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 11/1/2015 and 11/30/2015
	1 Paired Sample Set Required between 12/1/2015 and 12/31/2015

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.

**OH1400111 BLANCHESTER VILLAGE PWS**

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: BLANCHESTER, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals**Monitoring Requirements**

LEAD - 1030 AND COPPER - 1022	20 Sample(s) Required between 6/1/2015 and 9/30/2015
-------------------------------	--

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	5 Sample(s) Required between 1/1/2015 and 1/31/2015
	5 Sample(s) Required between 2/1/2015 and 2/28/2015
	5 Sample(s) Required between 3/1/2015 and 3/31/2015
	5 Sample(s) Required between 4/1/2015 and 4/30/2015
	5 Sample(s) Required between 5/1/2015 and 5/31/2015
	5 Sample(s) Required between 6/1/2015 and 6/30/2015
	5 Sample(s) Required between 7/1/2015 and 7/31/2015
	5 Sample(s) Required between 8/1/2015 and 8/31/2015
	5 Sample(s) Required between 9/1/2015 and 9/30/2015
	5 Sample(s) Required between 10/1/2015 and 10/31/2015
	5 Sample(s) Required between 11/1/2015 and 11/30/2015
	5 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000	5 Sample(s) Required between 1/1/2015 and 1/31/2015
	5 Sample(s) Required between 2/1/2015 and 2/28/2015
	5 Sample(s) Required between 3/1/2015 and 3/31/2015
	5 Sample(s) Required between 4/1/2015 and 4/30/2015
	5 Sample(s) Required between 5/1/2015 and 5/31/2015
	5 Sample(s) Required between 6/1/2015 and 6/30/2015
	5 Sample(s) Required between 7/1/2015 and 7/31/2015
	5 Sample(s) Required between 8/1/2015 and 8/31/2015
	5 Sample(s) Required between 9/1/2015 and 9/30/2015
	5 Sample(s) Required between 10/1/2015 and 10/31/2015
	5 Sample(s) Required between 11/1/2015 and 11/30/2015
	5 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: BLANCHESTER, VILLAGE OF DISTRIBUTION 122 FAWN LANE	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals**Monitoring Requirements**

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 3/1/2015 and 3/7/2015 at SMP: DS201
	1 Sample(s) Required between 6/1/2015 and 6/7/2015 at SMP: DS201
	1 Sample(s) Required between 9/1/2015 and 9/7/2015 at SMP: DS201



OH1400111 BLANCHESTER VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: BLANCHESTER, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
	SMP ID: DS201	122 FAWN LANE	

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 12/1/2015 and 12/7/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1	Facility Name: BLANCHESTER, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
	SMP ID: DS202	117 NORTHVIEW	

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 3/1/2015 and 3/7/2015 at SMP: DS202
	1 Sample(s) Required between 6/1/2015 and 6/7/2015 at SMP: DS202
	1 Sample(s) Required between 9/1/2015 and 9/7/2015 at SMP: DS202
	1 Sample(s) Required between 12/1/2015 and 12/7/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH1400203 CLARKSVILLE VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: CLARKSVILLE, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

1 Sample(s) Required between	1/1/2015	and	1/31/2015
1 Sample(s) Required between	2/1/2015	and	2/28/2015
1 Sample(s) Required between	3/1/2015	and	3/31/2015
1 Sample(s) Required between	4/1/2015	and	4/30/2015
1 Sample(s) Required between	5/1/2015	and	5/31/2015
1 Sample(s) Required between	6/1/2015	and	6/30/2015
1 Sample(s) Required between	7/1/2015	and	7/31/2015
1 Sample(s) Required between	8/1/2015	and	8/31/2015
1 Sample(s) Required between	9/1/2015	and	9/30/2015
1 Sample(s) Required between	10/1/2015	and	10/31/2015
1 Sample(s) Required between	11/1/2015	and	11/30/2015
1 Sample(s) Required between	12/1/2015	and	12/31/2015

TOTAL CHLORINE - 1000

1 Sample(s) Required between	1/1/2015	and	1/31/2015
1 Sample(s) Required between	2/1/2015	and	2/28/2015
1 Sample(s) Required between	3/1/2015	and	3/31/2015
1 Sample(s) Required between	4/1/2015	and	4/30/2015
1 Sample(s) Required between	5/1/2015	and	5/31/2015
1 Sample(s) Required between	6/1/2015	and	6/30/2015
1 Sample(s) Required between	7/1/2015	and	7/31/2015
1 Sample(s) Required between	8/1/2015	and	8/31/2015
1 Sample(s) Required between	9/1/2015	and	9/30/2015
1 Sample(s) Required between	10/1/2015	and	10/31/2015
1 Sample(s) Required between	11/1/2015	and	11/30/2015
1 Sample(s) Required between	12/1/2015	and	12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: CLARKSVILLE, VILLAGE OF DISTRIBUTION CWWTP SPRINGHILL RD.	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2015

2015 DISTRIBUTION SCHEDULE

OH1400203 CLARKSVILLE VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: CLARKSVILLE, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
	SMP ID: DS202	ADDRESS NOT KNOWN	

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

OH1400512 MARTINSVILLE VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1453380	Facility Name: MARTINSVILLE	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 3/31/2015
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1400512 MARTINSVILLE VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: MARTINSVILLE, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2015 and 9/30/2015
-------------------------------	---

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 1/31/2015
	1 Sample(s) Required between 2/1/2015 and 2/28/2015
	1 Sample(s) Required between 3/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 4/30/2015
	1 Sample(s) Required between 5/1/2015 and 5/31/2015
	1 Sample(s) Required between 6/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 7/31/2015
	1 Sample(s) Required between 8/1/2015 and 8/31/2015
	1 Sample(s) Required between 9/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 10/31/2015
	1 Sample(s) Required between 11/1/2015 and 11/30/2015
	1 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2015 and 1/31/2015
	1 Sample(s) Required between 2/1/2015 and 2/28/2015
	1 Sample(s) Required between 3/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 4/30/2015
	1 Sample(s) Required between 5/1/2015 and 5/31/2015
	1 Sample(s) Required between 6/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 7/31/2015
	1 Sample(s) Required between 8/1/2015 and 8/31/2015
	1 Sample(s) Required between 9/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 10/31/2015
	1 Sample(s) Required between 11/1/2015 and 11/30/2015
	1 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: MARTINSVILLE, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

OH1400815 NEW VIENNA VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1453381	Facility Name: NEW VIENNA WTP	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1400815 NEW VIENNA VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: NEW VIENNA, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between	1/1/2015	and	1/31/2015
	2 Sample(s) Required between	2/1/2015	and	2/28/2015
	2 Sample(s) Required between	3/1/2015	and	3/31/2015
	2 Sample(s) Required between	4/1/2015	and	4/30/2015
	2 Sample(s) Required between	5/1/2015	and	5/31/2015
	2 Sample(s) Required between	6/1/2015	and	6/30/2015
	2 Sample(s) Required between	7/1/2015	and	7/31/2015
	2 Sample(s) Required between	8/1/2015	and	8/31/2015
	2 Sample(s) Required between	9/1/2015	and	9/30/2015
	2 Sample(s) Required between	10/1/2015	and	10/31/2015
	2 Sample(s) Required between	11/1/2015	and	11/30/2015
	2 Sample(s) Required between	12/1/2015	and	12/31/2015

TOTAL CHLORINE - 1000	2 Sample(s) Required between	1/1/2015	and	1/31/2015
	2 Sample(s) Required between	2/1/2015	and	2/28/2015
	2 Sample(s) Required between	3/1/2015	and	3/31/2015
	2 Sample(s) Required between	4/1/2015	and	4/30/2015
	2 Sample(s) Required between	5/1/2015	and	5/31/2015
	2 Sample(s) Required between	6/1/2015	and	6/30/2015
	2 Sample(s) Required between	7/1/2015	and	7/31/2015
	2 Sample(s) Required between	8/1/2015	and	8/31/2015
	2 Sample(s) Required between	9/1/2015	and	9/30/2015
	2 Sample(s) Required between	10/1/2015	and	10/31/2015
	2 Sample(s) Required between	11/1/2015	and	11/30/2015
	2 Sample(s) Required between	12/1/2015	and	12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: NEW VIENNA, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2015

2015 DISTRIBUTION SCHEDULE

OH1400815 NEW VIENNA VILLAGE

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: NEW VIENNA, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
	SMP ID: DS202	ADDRESS NOT KNOWN	

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

OH1400912 SABINA VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1453382	Facility Name: SABINA VILLAGE	
Location	SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

Chemicals	Monitoring Requirements
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required



OH1400912 SABINA VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: SABINA, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	3 Sample(s) Required between	1/1/2015	and	1/31/2015
	3 Sample(s) Required between	2/1/2015	and	2/28/2015
	3 Sample(s) Required between	3/1/2015	and	3/31/2015
	3 Sample(s) Required between	4/1/2015	and	4/30/2015
	3 Sample(s) Required between	5/1/2015	and	5/31/2015
	3 Sample(s) Required between	6/1/2015	and	6/30/2015
	3 Sample(s) Required between	7/1/2015	and	7/31/2015
	3 Sample(s) Required between	8/1/2015	and	8/31/2015
	3 Sample(s) Required between	9/1/2015	and	9/30/2015
	3 Sample(s) Required between	10/1/2015	and	10/31/2015
	3 Sample(s) Required between	11/1/2015	and	11/30/2015
	3 Sample(s) Required between	12/1/2015	and	12/31/2015

TOTAL CHLORINE - 1000	3 Sample(s) Required between	1/1/2015	and	1/31/2015
	3 Sample(s) Required between	2/1/2015	and	2/28/2015
	3 Sample(s) Required between	3/1/2015	and	3/31/2015
	3 Sample(s) Required between	4/1/2015	and	4/30/2015
	3 Sample(s) Required between	5/1/2015	and	5/31/2015
	3 Sample(s) Required between	6/1/2015	and	6/30/2015
	3 Sample(s) Required between	7/1/2015	and	7/31/2015
	3 Sample(s) Required between	8/1/2015	and	8/31/2015
	3 Sample(s) Required between	9/1/2015	and	9/30/2015
	3 Sample(s) Required between	10/1/2015	and	10/31/2015
	3 Sample(s) Required between	11/1/2015	and	11/30/2015
	3 Sample(s) Required between	12/1/2015	and	12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: SABINA, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2015

2015 DISTRIBUTION SCHEDULE

OH1400912 SABINA VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: SABINA, VILLAGE OF DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH1401211 WILMINGTON CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 1453383	Facility Name: WILMINGTON WATER DEPARTMENT
	SMP ID: EP001	Facility Source: Surface Water
		Facility Class: CLASS 3

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

Chemicals**Monitoring Requirements**

INORGANICS 1 Sample(s) Required between 1/1/2015 and 5/31/2015

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040

1 Sample(s) Required between 1/1/2015 and 1/31/2015

1 Sample(s) Required between 2/1/2015 and 2/28/2015

1 Sample(s) Required between 3/1/2015 and 3/31/2015

1 Sample(s) Required between 4/1/2015 and 4/30/2015

1 Sample(s) Required between 5/1/2015 and 5/31/2015

1 Sample(s) Required between 6/1/2015 and 6/30/2015

1 Sample(s) Required between 7/1/2015 and 7/31/2015

1 Sample(s) Required between 8/1/2015 and 8/31/2015

1 Sample(s) Required between 9/1/2015 and 9/30/2015

1 Sample(s) Required between 10/1/2015 and 10/31/2015

1 Sample(s) Required between 11/1/2015 and 11/30/2015

1 Sample(s) Required between 12/1/2015 and 12/31/2015

RADIOLOGICALS Not Required

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1

1 Sample(s) Required between 4/1/2015 and 4/30/2015

1 Sample(s) Required between 5/1/2015 and 5/31/2015

1 Sample(s) Required between 6/1/2015 and 6/30/2015

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 1/1/2015 and 5/31/2015

TOTAL ORGANIC CARBON (TOC)

1 Paired Sample Set Required between 1/1/2015 and 1/31/2015

1 Paired Sample Set Required between 2/1/2015 and 2/28/2015

1 Paired Sample Set Required between 3/1/2015 and 3/31/2015

1 Paired Sample Set Required between 4/1/2015 and 4/30/2015

1 Paired Sample Set Required between 5/1/2015 and 5/31/2015

1 Paired Sample Set Required between 6/1/2015 and 6/30/2015

1 Paired Sample Set Required between 7/1/2015 and 7/31/2015

1 Paired Sample Set Required between 8/1/2015 and 8/31/2015

1 Paired Sample Set Required between 9/1/2015 and 9/30/2015

1 Paired Sample Set Required between 10/1/2015 and 10/31/2015

1 Paired Sample Set Required between 11/1/2015 and 11/30/2015

1 Paired Sample Set Required between 12/1/2015 and 12/31/2015

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.

**OH1401211 WILMINGTON CITY PWS**

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: WILMINGTON, CITY OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	10 Sample(s) Required between	1/1/2015	and	1/31/2015
	10 Sample(s) Required between	2/1/2015	and	2/28/2015
	10 Sample(s) Required between	3/1/2015	and	3/31/2015
	10 Sample(s) Required between	4/1/2015	and	4/30/2015
	10 Sample(s) Required between	5/1/2015	and	5/31/2015
	10 Sample(s) Required between	6/1/2015	and	6/30/2015
	10 Sample(s) Required between	7/1/2015	and	7/31/2015
	10 Sample(s) Required between	8/1/2015	and	8/31/2015
	10 Sample(s) Required between	9/1/2015	and	9/30/2015
	10 Sample(s) Required between	10/1/2015	and	10/31/2015
	10 Sample(s) Required between	11/1/2015	and	11/30/2015
	10 Sample(s) Required between	12/1/2015	and	12/31/2015

TOTAL CHLORINE - 1000	10 Sample(s) Required between	1/1/2015	and	1/31/2015
	10 Sample(s) Required between	2/1/2015	and	2/28/2015
	10 Sample(s) Required between	3/1/2015	and	3/31/2015
	10 Sample(s) Required between	4/1/2015	and	4/30/2015
	10 Sample(s) Required between	5/1/2015	and	5/31/2015
	10 Sample(s) Required between	6/1/2015	and	6/30/2015
	10 Sample(s) Required between	7/1/2015	and	7/31/2015
	10 Sample(s) Required between	8/1/2015	and	8/31/2015
	10 Sample(s) Required between	9/1/2015	and	9/30/2015
	10 Sample(s) Required between	10/1/2015	and	10/31/2015
	10 Sample(s) Required between	11/1/2015	and	11/30/2015
	10 Sample(s) Required between	12/1/2015	and	12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: WILMINGTON, CITY OF DISTRIBUTION 300 OAK DR.	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between	1/8/2015	and	1/14/2015	at SMP: DS201
	1 Sample(s) Required between	4/8/2015	and	4/14/2015	at SMP: DS201
	1 Sample(s) Required between	7/8/2015	and	7/14/2015	at SMP: DS201
	1 Sample(s) Required between	10/8/2015	and	10/14/2015	at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

**OH1401211 WILMINGTON CITY PWS**

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: WILMINGTON, CITY OF DISTRIBUTION 3992 ST 730	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/8/2015 and 1/14/2015 at SMP: DS202
	1 Sample(s) Required between 4/8/2015 and 4/14/2015 at SMP: DS202
	1 Sample(s) Required between 7/8/2015 and 7/14/2015 at SMP: DS202
	1 Sample(s) Required between 10/8/2015 and 10/14/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS203	Facility Name: WILMINGTON, CITY OF DISTRIBUTION 863 S. SOUTH ST.	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/8/2015 and 1/14/2015 at SMP: DS203
	1 Sample(s) Required between 4/8/2015 and 4/14/2015 at SMP: DS203
	1 Sample(s) Required between 7/8/2015 and 7/14/2015 at SMP: DS203
	1 Sample(s) Required between 10/8/2015 and 10/14/2015 at SMP: DS203

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS204	Facility Name: WILMINGTON, CITY OF DISTRIBUTION 4425 SR 730	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/8/2015 and 1/14/2015 at SMP: DS204
	1 Sample(s) Required between 4/8/2015 and 4/14/2015 at SMP: DS204
	1 Sample(s) Required between 7/8/2015 and 7/14/2015 at SMP: DS204
	1 Sample(s) Required between 10/8/2015 and 10/14/2015 at SMP: DS204

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

OH1432112 EAST CLINTON HIGH SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling	Facility ID: 1453388	Facility Name: EAST CLINTON HIGH SCHOOL
Location	SMP ID: EP001	Facility Source: Ground Water
		Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015
INORGANICS	Not Required
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	Not Required

**OH1432112 EAST CLINTON HIGH SCHOOL**

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: EAST CLINTON HIGH SCHOOL DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: EAST CLINTON HIGH SCHOOL DISTRIBUTION
	SMP ID: DS201	ADDRESS NOT KNOWN

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 3/8/2015 and 3/14/2015 at SMP: DS201 1 Sample(s) Required between 6/8/2015 and 6/14/2015 at SMP: DS201 1 Sample(s) Required between 9/8/2015 and 9/14/2015 at SMP: DS201 1 Sample(s) Required between 12/8/2015 and 12/14/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1	Facility Name: EAST CLINTON HIGH SCHOOL DISTRIBUTION
	SMP ID: DS202	ADDRESS NOT KNOWN

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 3/8/2015 and 3/14/2015 at SMP: DS202 1 Sample(s) Required between 6/8/2015 and 6/14/2015 at SMP: DS202 1 Sample(s) Required between 9/8/2015 and 9/14/2015 at SMP: DS202 1 Sample(s) Required between 12/8/2015 and 12/14/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH1433512 SNOW HILL COUNTRY CLUB

System Type: Transient Noncommunity

Operating Period: 3/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: SNOW HILL COUNTRY CLUB DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1453390	Facility Name: SNOW HILL COUNTRY CLUB
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

Where to Collect Samples For a Small Public Water System

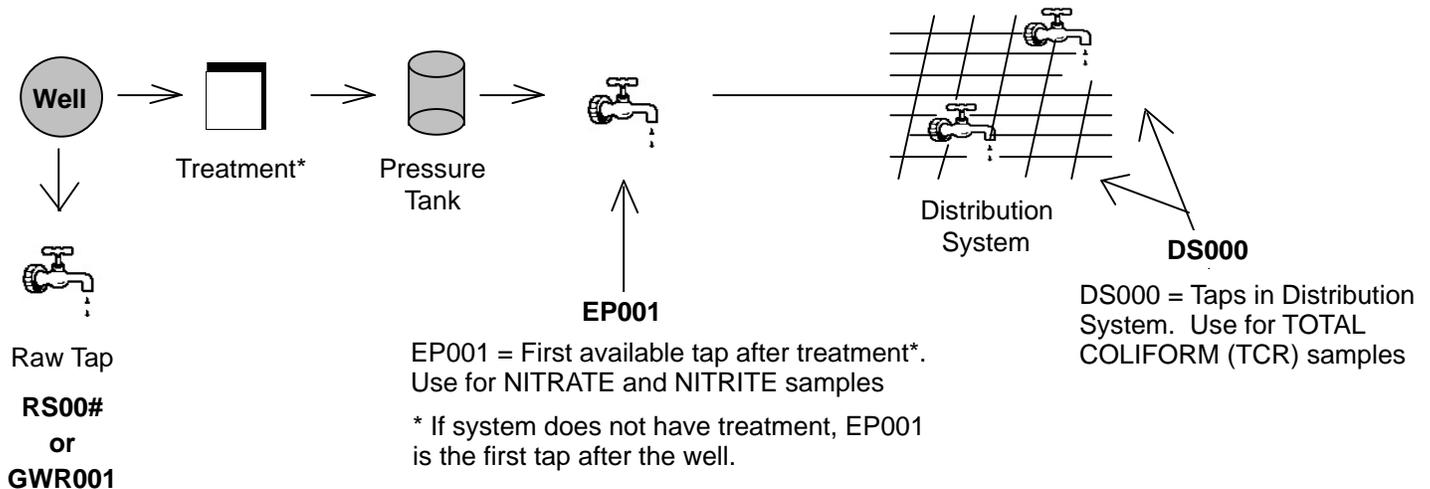

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1434012 BEECHWOOD ACRES

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **BEECHWOOD ACRES DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **1453391** Facility Name: **BEECHWOOD ACRES**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

Where to Collect Samples For a Small Public Water System

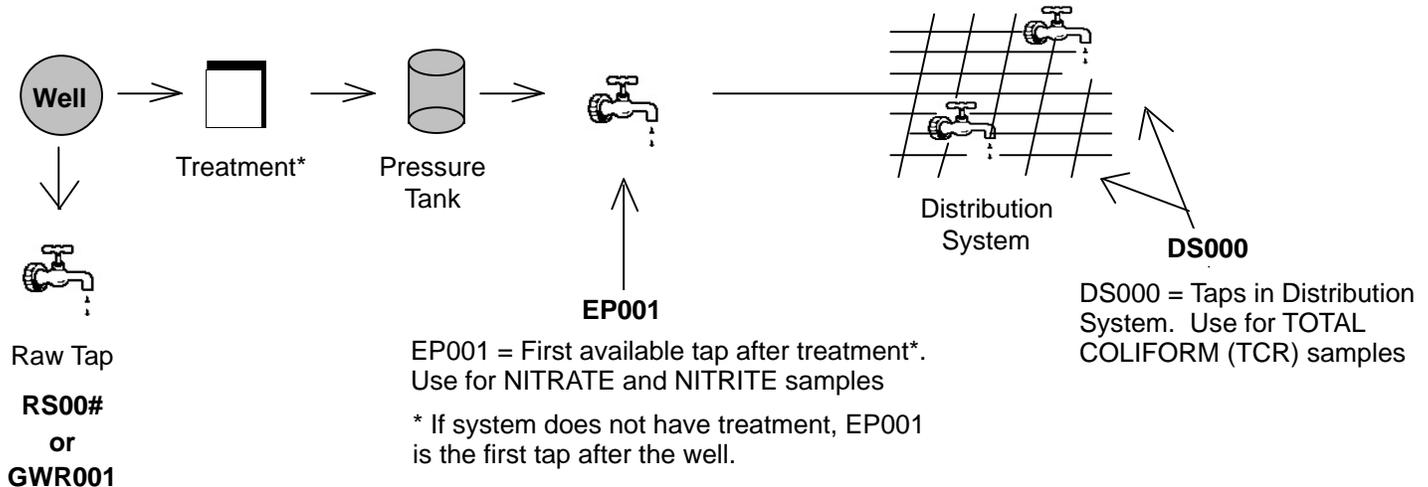

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1434612 SHADY OAKS CAMPGROUNDS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: SHADY OAKS CAMPGROUNDS DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1453392	Facility Name: SHADY OAKS CAMPGROUNDS
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

Where to Collect Samples For a Small Public Water System

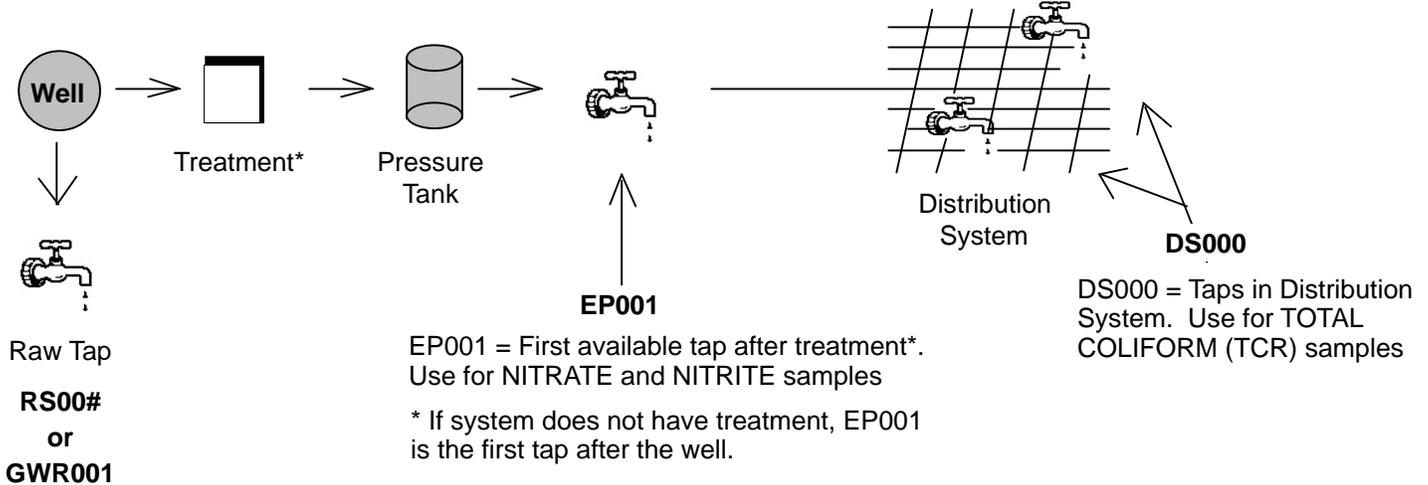

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:
<http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH1434812 COMMUNITY CHRISTIAN CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: COMMUNITY CHRISTIAN CHUR DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 1453393	Facility Name: COMMUNITY CHRISTIAN CHURCH
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 5/31/2015

Where to Collect Samples For a Small Public Water System

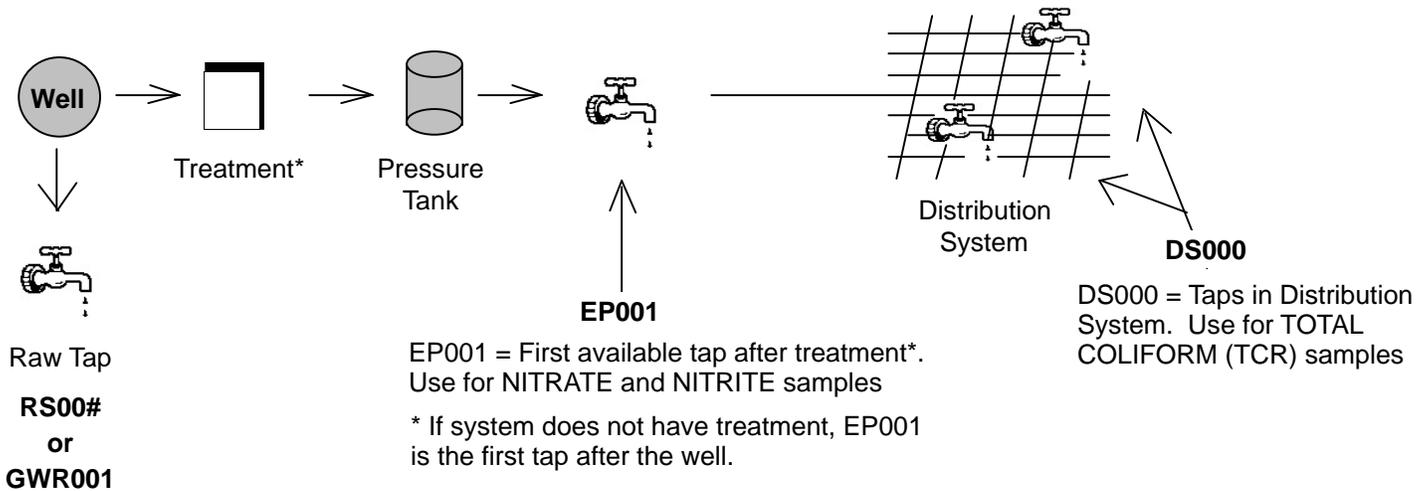

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!