



OH5000411 CAMPBELL CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5056004	Facility Name: CAMPBELL CITY	Facility Class: CLASS 3
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2015 and 10/31/2015
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 1/31/2015 1 Sample(s) Required between 2/1/2015 and 2/28/2015 1 Sample(s) Required between 3/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 4/30/2015 1 Sample(s) Required between 5/1/2015 and 5/31/2015 1 Sample(s) Required between 6/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 7/31/2015 1 Sample(s) Required between 8/1/2015 and 8/31/2015 1 Sample(s) Required between 9/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 10/31/2015 1 Sample(s) Required between 11/1/2015 and 11/30/2015 1 Sample(s) Required between 12/1/2015 and 12/31/2015
RADIOLOGICALS	1 Sample(s) Required between 6/1/2015 and 10/31/2015
<i>Sample for all the analytes listed below:</i>	
GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2015 and 6/30/2015
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 7/1/2015 and 9/30/2015
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2015 and 1/31/2015 1 Paired Sample Set Required between 2/1/2015 and 2/28/2015 1 Paired Sample Set Required between 3/1/2015 and 3/31/2015 1 Paired Sample Set Required between 4/1/2015 and 4/30/2015 1 Paired Sample Set Required between 5/1/2015 and 5/31/2015 1 Paired Sample Set Required between 6/1/2015 and 6/30/2015 1 Paired Sample Set Required between 7/1/2015 and 7/31/2015 1 Paired Sample Set Required between 8/1/2015 and 8/31/2015 1 Paired Sample Set Required between 9/1/2015 and 9/30/2015 1 Paired Sample Set Required between 10/1/2015 and 10/31/2015 1 Paired Sample Set Required between 11/1/2015 and 11/30/2015 1 Paired Sample Set Required between 12/1/2015 and 12/31/2015

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.

OH5000411 CAMPBELL CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: CAMPBELL, CITY OF DISTRIBUTION	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

TOTAL COLIFORM (TCR) - 3100	9 Sample(s) Required between 1/1/2015 and 1/31/2015
	9 Sample(s) Required between 2/1/2015 and 2/28/2015
	9 Sample(s) Required between 3/1/2015 and 3/31/2015
	9 Sample(s) Required between 4/1/2015 and 4/30/2015
	9 Sample(s) Required between 5/1/2015 and 5/31/2015
	9 Sample(s) Required between 6/1/2015 and 6/30/2015
	9 Sample(s) Required between 7/1/2015 and 7/31/2015
	9 Sample(s) Required between 8/1/2015 and 8/31/2015
	9 Sample(s) Required between 9/1/2015 and 9/30/2015
	9 Sample(s) Required between 10/1/2015 and 10/31/2015
	9 Sample(s) Required between 11/1/2015 and 11/30/2015
	9 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000	9 Sample(s) Required between 1/1/2015 and 1/31/2015
	9 Sample(s) Required between 2/1/2015 and 2/28/2015
	9 Sample(s) Required between 3/1/2015 and 3/31/2015
	9 Sample(s) Required between 4/1/2015 and 4/30/2015
	9 Sample(s) Required between 5/1/2015 and 5/31/2015
	9 Sample(s) Required between 6/1/2015 and 6/30/2015
	9 Sample(s) Required between 7/1/2015 and 7/31/2015
	9 Sample(s) Required between 8/1/2015 and 8/31/2015
	9 Sample(s) Required between 9/1/2015 and 9/30/2015
	9 Sample(s) Required between 10/1/2015 and 10/31/2015
	9 Sample(s) Required between 11/1/2015 and 11/30/2015
	9 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: CAMPBELL, CITY OF DISTRIBUTION 773 MCCARTNEY RD.	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
------------------	--------------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/1/2015 and 1/7/2015 at SMP: DS201
	1 Sample(s) Required between 4/1/2015 and 4/7/2015 at SMP: DS201
	1 Sample(s) Required between 7/1/2015 and 7/7/2015 at SMP: DS201
	1 Sample(s) Required between 10/1/2015 and 10/7/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH5000411 CAMPBELL CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: CAMPBELL, CITY OF DISTRIBUTION 220 TWELFTH ST.	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements		
DISINFECTION BYPRODUCTS	1 Sample(s) Required between	1/1/2015 and	1/7/2015 at SMP: DS202
	1 Sample(s) Required between	4/1/2015 and	4/7/2015 at SMP: DS202
	1 Sample(s) Required between	7/1/2015 and	7/7/2015 at SMP: DS202
	1 Sample(s) Required between	10/1/2015 and	10/7/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH5000503 CANFIELD CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: CANFIELD, CITY OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

9 Sample(s) Required between 1/1/2015 and 1/31/2015

9 Sample(s) Required between 2/1/2015 and 2/28/2015

9 Sample(s) Required between 3/1/2015 and 3/31/2015

9 Sample(s) Required between 4/1/2015 and 4/30/2015

9 Sample(s) Required between 5/1/2015 and 5/31/2015

9 Sample(s) Required between 6/1/2015 and 6/30/2015

9 Sample(s) Required between 7/1/2015 and 7/31/2015

9 Sample(s) Required between 8/1/2015 and 8/31/2015

9 Sample(s) Required between 9/1/2015 and 9/30/2015

9 Sample(s) Required between 10/1/2015 and 10/31/2015

9 Sample(s) Required between 11/1/2015 and 11/30/2015

9 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000

9 Sample(s) Required between 1/1/2015 and 1/31/2015

9 Sample(s) Required between 2/1/2015 and 2/28/2015

9 Sample(s) Required between 3/1/2015 and 3/31/2015

9 Sample(s) Required between 4/1/2015 and 4/30/2015

9 Sample(s) Required between 5/1/2015 and 5/31/2015

9 Sample(s) Required between 6/1/2015 and 6/30/2015

9 Sample(s) Required between 7/1/2015 and 7/31/2015

9 Sample(s) Required between 8/1/2015 and 8/31/2015

9 Sample(s) Required between 9/1/2015 and 9/30/2015

9 Sample(s) Required between 10/1/2015 and 10/31/2015

9 Sample(s) Required between 11/1/2015 and 11/30/2015

9 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: CANFIELD, CITY OF DISTRIBUTION 133 LAKE WOBEGON	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 2/8/2015 and 2/14/2015 at SMP: DS201

1 Sample(s) Required between 5/8/2015 and 5/14/2015 at SMP: DS201

1 Sample(s) Required between 8/8/2015 and 8/14/2015 at SMP: DS201

1 Sample(s) Required between 11/8/2015 and 11/14/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH5000503 CANFIELD CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: CANFIELD, CITY OF DISTRIBUTION 81 SAVANNAH CT.	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/8/2015 and 2/14/2015 at SMP: DS202
	1 Sample(s) Required between 5/8/2015 and 5/14/2015 at SMP: DS202
	1 Sample(s) Required between 8/8/2015 and 8/14/2015 at SMP: DS202
	1 Sample(s) Required between 11/8/2015 and 11/14/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH5000612 COLONIAL VILLA ESTATES MHP

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5056006	Facility Name: COLONIAL VILLA ESTATES MHP STU 1
	SMP ID: EP001	Facility Source: Ground Water
		Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2015 and 10/31/2015

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 6/1/2015 and 10/31/2015

RADIOLOGICALS 1 Sample(s) Required between 6/1/2015 and 10/31/2015

Sample for all the analytes listed below:

GROSS ALPHA - 4002 RADIUM-228 - 4030

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 Not Required

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2015 and 10/31/2015



OH5000612 COLONIAL VILLA ESTATES MHP

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5060556	Facility Name: COLONIAL VILLA ESTATES MHP STU 2
	SMP ID: EP002	Facility Source: Ground Water
		Facility Class: CLASS 1

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2015 and 10/31/2015
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020	
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015
RADIOLOGICALS	1 Sample(s) Required between 6/1/2015 and 10/31/2015
<i>Sample for all the analytes listed below:</i>	
GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 7/1/2015 and 9/30/2015

OH5000612 COLONIAL VILLA ESTATES MHP

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: COLONIAL VILLA ESTATES DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 1/31/2015
	1 Sample(s) Required between 2/1/2015 and 2/28/2015
	1 Sample(s) Required between 3/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 4/30/2015
	1 Sample(s) Required between 5/1/2015 and 5/31/2015
	1 Sample(s) Required between 6/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 7/31/2015
	1 Sample(s) Required between 8/1/2015 and 8/31/2015
	1 Sample(s) Required between 9/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 10/31/2015
	1 Sample(s) Required between 11/1/2015 and 11/30/2015
	1 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2015 and 1/31/2015
	1 Sample(s) Required between 2/1/2015 and 2/28/2015
	1 Sample(s) Required between 3/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 4/30/2015
	1 Sample(s) Required between 5/1/2015 and 5/31/2015
	1 Sample(s) Required between 6/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 7/31/2015
	1 Sample(s) Required between 8/1/2015 and 8/31/2015
	1 Sample(s) Required between 9/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 10/31/2015
	1 Sample(s) Required between 11/1/2015 and 11/30/2015
	1 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: COLONIAL VILLA ESTATES DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 09/11/2015

2015 ENTRY POINT SCHEDULE

OH5000912 M AND C MOBILE HOME PARK

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5056008	Facility Name: M & C MHP VILLAGE	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2015 and 10/31/2015

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 6/1/2015 and 10/31/2015

RADIOLOGICALS 1 Sample(s) Required between 7/1/2015 and 9/30/2015

1 Sample(s) Required between 10/1/2015 and 12/31/2015

Sample for all the analytes listed below:

GROSS ALPHA - 4002 RADIUM-228 - 4030

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 Not Required

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2015 and 10/31/2015



OH5000912 M AND C MOBILE HOME PARK

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: M & C MOBILE HOME PARK DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 6/1/2015 and 9/30/2015
-------------------------------	---

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 1/31/2015
	1 Sample(s) Required between 2/1/2015 and 2/28/2015
	1 Sample(s) Required between 3/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 4/30/2015
	1 Sample(s) Required between 5/1/2015 and 5/31/2015
	1 Sample(s) Required between 6/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 7/31/2015
	1 Sample(s) Required between 8/1/2015 and 8/31/2015
	1 Sample(s) Required between 9/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 10/31/2015
	1 Sample(s) Required between 11/1/2015 and 11/30/2015
	1 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2015 and 1/31/2015
	1 Sample(s) Required between 2/1/2015 and 2/28/2015
	1 Sample(s) Required between 3/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 4/30/2015
	1 Sample(s) Required between 5/1/2015 and 5/31/2015
	1 Sample(s) Required between 6/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 7/31/2015
	1 Sample(s) Required between 8/1/2015 and 8/31/2015
	1 Sample(s) Required between 9/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 10/31/2015
	1 Sample(s) Required between 11/1/2015 and 11/30/2015
	1 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: M & C MOBILE HOME PARK DISTRIBUTION
	SMP ID: DS201	ADDRESS NOT KNOWN

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH5001212 DEER MEADOW ESTATES

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5056011	Facility Name: DEER MEADOWS MHP DBA EVERGREEN COMMUNITI	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2015 and 10/31/2015
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020	
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015
RADIOLOGICALS	1 Sample(s) Required between 6/1/2015 and 10/31/2015
<i>Sample for all the analytes listed below:</i>	
GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2015 and 10/31/2015



OH5001212 DEER MEADOW ESTATES

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: DEER MEADOW ESTATES DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2015	and	1/31/2015
	1 Sample(s) Required between	2/1/2015	and	2/28/2015
	1 Sample(s) Required between	3/1/2015	and	3/31/2015
	1 Sample(s) Required between	4/1/2015	and	4/30/2015
	1 Sample(s) Required between	5/1/2015	and	5/31/2015
	1 Sample(s) Required between	6/1/2015	and	6/30/2015
	1 Sample(s) Required between	7/1/2015	and	7/31/2015
	1 Sample(s) Required between	8/1/2015	and	8/31/2015
	1 Sample(s) Required between	9/1/2015	and	9/30/2015
	1 Sample(s) Required between	10/1/2015	and	10/31/2015
	1 Sample(s) Required between	11/1/2015	and	11/30/2015
	1 Sample(s) Required between	12/1/2015	and	12/31/2015

TOTAL CHLORINE - 1000	1 Sample(s) Required between	1/1/2015	and	1/31/2015
	1 Sample(s) Required between	2/1/2015	and	2/28/2015
	1 Sample(s) Required between	3/1/2015	and	3/31/2015
	1 Sample(s) Required between	4/1/2015	and	4/30/2015
	1 Sample(s) Required between	5/1/2015	and	5/31/2015
	1 Sample(s) Required between	6/1/2015	and	6/30/2015
	1 Sample(s) Required between	7/1/2015	and	7/31/2015
	1 Sample(s) Required between	8/1/2015	and	8/31/2015
	1 Sample(s) Required between	9/1/2015	and	9/30/2015
	1 Sample(s) Required between	10/1/2015	and	10/31/2015
	1 Sample(s) Required between	11/1/2015	and	11/30/2015
	1 Sample(s) Required between	12/1/2015	and	12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: DEER MEADOW ESTATES DISTRIBUTION
	SMP ID: DS201	ADDRESS NOT KNOWN

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between	7/1/2015	and	9/30/2015 at SMP: DS201
-------------------------	------------------------------	----------	-----	-------------------------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH5001611 AQUA OHIO - STRUTHERS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5056013	Facility Name: AQUA OHIO-STRUTHERS WTP	Facility Class: CLASS 4
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015

Chemicals	Monitoring Requirements
-----------	-------------------------

INORGANICS	1 Sample(s) Required between 6/1/2015 and 10/31/2015
------------	--

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 1/31/2015
	1 Sample(s) Required between 2/1/2015 and 2/28/2015
	1 Sample(s) Required between 3/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 4/30/2015
	1 Sample(s) Required between 5/1/2015 and 5/31/2015
	1 Sample(s) Required between 6/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 7/31/2015
	1 Sample(s) Required between 8/1/2015 and 8/31/2015
	1 Sample(s) Required between 9/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 10/31/2015
	1 Sample(s) Required between 11/1/2015 and 11/30/2015
	1 Sample(s) Required between 12/1/2015 and 12/31/2015

RADIOLOGICALS	1 Sample(s) Required between 6/1/2015 and 10/31/2015
---------------	--

Sample for all the analytes listed below:

GROSS ALPHA - 4002 RADIUM-228 - 4030

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2015 and 6/30/2015
---	---

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2015 and 10/31/2015
----------------------------------	--

TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2015 and 1/31/2015
	1 Paired Sample Set Required between 2/1/2015 and 2/28/2015
	1 Paired Sample Set Required between 3/1/2015 and 3/31/2015
	1 Paired Sample Set Required between 4/1/2015 and 4/30/2015
	1 Paired Sample Set Required between 5/1/2015 and 5/31/2015
	1 Paired Sample Set Required between 6/1/2015 and 6/30/2015
	1 Paired Sample Set Required between 7/1/2015 and 7/31/2015
	1 Paired Sample Set Required between 8/1/2015 and 8/31/2015
	1 Paired Sample Set Required between 9/1/2015 and 9/30/2015
	1 Paired Sample Set Required between 10/1/2015 and 10/31/2015
	1 Paired Sample Set Required between 11/1/2015 and 11/30/2015
	1 Paired Sample Set Required between 12/1/2015 and 12/31/2015

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



OH5001611 AQUA OHIO - STRUTHERS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

Table with 4 columns: Sampling Location, Facility ID, Facility Name, Facility Class. Values: DS1, AQUA OHIO-STRUTHERS DISTRIBUTION, CLASS 2, DS000.

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100 50 Sample(s) Required between 1/1/2015 and 1/31/2015 ... 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000 50 Sample(s) Required between 1/1/2015 and 1/31/2015 ... 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Table with 4 columns: Sampling Location, Facility ID, Facility Name, Facility Class. Values: DS1, AQUA OHIO-STRUTHERS DISTRIBUTION, CLASS 2, DS201, 6 ELM STREET.

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 1/8/2015 and 1/14/2015 at SMP: DS201 ... 10/8/2015 and 10/14/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950

OH5001611 AQUA OHIO - STRUTHERS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: AQUA OHIO-STRUTHERS DISTRIBUTION 13770 WOODWORTH ROAD	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/8/2015 and 1/14/2015 at SMP: DS202
	1 Sample(s) Required between 4/8/2015 and 4/14/2015 at SMP: DS202
	1 Sample(s) Required between 7/8/2015 and 7/14/2015 at SMP: DS202
	1 Sample(s) Required between 10/8/2015 and 10/14/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS203	Facility Name: AQUA OHIO-STRUTHERS DISTRIBUTION 8916 STRUTHERS ROAD	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/8/2015 and 1/14/2015 at SMP: DS203
	1 Sample(s) Required between 4/8/2015 and 4/14/2015 at SMP: DS203
	1 Sample(s) Required between 7/8/2015 and 7/14/2015 at SMP: DS203
	1 Sample(s) Required between 10/8/2015 and 10/14/2015 at SMP: DS203

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS204	Facility Name: AQUA OHIO-STRUTHERS DISTRIBUTION 235 STATE STREET	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 1/8/2015 and 1/14/2015 at SMP: DS204
	1 Sample(s) Required between 4/8/2015 and 4/14/2015 at SMP: DS204
	1 Sample(s) Required between 7/8/2015 and 7/14/2015 at SMP: DS204
	1 Sample(s) Required between 10/8/2015 and 10/14/2015 at SMP: DS204

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH5001812 ISLAND CREEK HOMEOWNERS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5056014	Facility Name: ISLAND CREEK HOMEOWNERS ASSOC
	SMP ID: EP001	Facility Source: Ground Water
		Facility Class: CLASS A

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2015 and 10/31/2015

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 6/1/2015 and 10/31/2015

RADIOLOGICALS 1 Sample(s) Required between 6/1/2015 and 10/31/2015

Sample for all the analytes listed below:

GROSS ALPHA - 4002 RADIUM-228 - 4030

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 Not Required

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2015 and 10/31/2015



OH5001812 ISLAND CREEK HOMEOWNERS

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

Table with 2 columns: Sampling Location and Facility Name/ID. Facility ID: DS1, Facility Name: ISLAND CREEK HOMEOWNERS DISTRIBUTIO, SMP ID: DS000

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2015 and 9/30/2015

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: http://epa.ohio.gov/ddagw/reporting.aspx

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100 1 Sample(s) Required between 1/1/2015 and 1/31/2015
1 Sample(s) Required between 2/1/2015 and 2/28/2015
1 Sample(s) Required between 3/1/2015 and 3/31/2015
1 Sample(s) Required between 4/1/2015 and 4/30/2015
1 Sample(s) Required between 5/1/2015 and 5/31/2015
1 Sample(s) Required between 6/1/2015 and 6/30/2015
1 Sample(s) Required between 7/1/2015 and 7/31/2015
1 Sample(s) Required between 8/1/2015 and 8/31/2015
1 Sample(s) Required between 9/1/2015 and 9/30/2015
1 Sample(s) Required between 10/1/2015 and 10/31/2015
1 Sample(s) Required between 11/1/2015 and 11/30/2015
1 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000 1 Sample(s) Required between 1/1/2015 and 1/31/2015
1 Sample(s) Required between 2/1/2015 and 2/28/2015
1 Sample(s) Required between 3/1/2015 and 3/31/2015
1 Sample(s) Required between 4/1/2015 and 4/30/2015
1 Sample(s) Required between 5/1/2015 and 5/31/2015
1 Sample(s) Required between 6/1/2015 and 6/30/2015
1 Sample(s) Required between 7/1/2015 and 7/31/2015
1 Sample(s) Required between 8/1/2015 and 8/31/2015
1 Sample(s) Required between 9/1/2015 and 9/30/2015
1 Sample(s) Required between 10/1/2015 and 10/31/2015
1 Sample(s) Required between 11/1/2015 and 11/30/2015
1 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Table with 2 columns: Sampling Location and Facility Name/ID. Facility ID: DS1, Facility Name: ISLAND CREEK HOMEOWNERS DISTRIBUTIO, SMP ID: DS201, ADDRESS NOT KNOWN

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



OH5001911 SEBRING VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5056015	Facility Name: SEBRING WTP	Facility Class: CLASS 3
	SMP ID: EP001	Facility Source: Surface Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2015 and 10/31/2015
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 1/31/2015 1 Sample(s) Required between 2/1/2015 and 2/28/2015 1 Sample(s) Required between 3/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 4/30/2015 1 Sample(s) Required between 5/1/2015 and 5/31/2015 1 Sample(s) Required between 6/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 7/31/2015 1 Sample(s) Required between 8/1/2015 and 8/31/2015 1 Sample(s) Required between 9/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 10/31/2015 1 Sample(s) Required between 11/1/2015 and 11/30/2015 1 Sample(s) Required between 12/1/2015 and 12/31/2015
RADIOLOGICALS	1 Sample(s) Required between 6/1/2015 and 10/31/2015
<i>Sample for all the analytes listed below:</i>	
GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 4/1/2015 and 4/30/2015 1 Sample(s) Required between 5/1/2015 and 5/31/2015 1 Sample(s) Required between 6/1/2015 and 6/30/2015
<i>Sample for all the analytes listed below:</i>	
ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2015 and 10/31/2015
TOTAL ORGANIC CARBON (TOC)	1 Paired Sample Set Required between 1/1/2015 and 1/31/2015 1 Paired Sample Set Required between 2/1/2015 and 2/28/2015 1 Paired Sample Set Required between 3/1/2015 and 3/31/2015 1 Paired Sample Set Required between 4/1/2015 and 4/30/2015 1 Paired Sample Set Required between 5/1/2015 and 5/31/2015 1 Paired Sample Set Required between 6/1/2015 and 6/30/2015 1 Paired Sample Set Required between 7/1/2015 and 7/31/2015 1 Paired Sample Set Required between 8/1/2015 and 8/31/2015 1 Paired Sample Set Required between 9/1/2015 and 9/30/2015 1 Paired Sample Set Required between 10/1/2015 and 10/31/2015 1 Paired Sample Set Required between 11/1/2015 and 11/30/2015 1 Paired Sample Set Required between 12/1/2015 and 12/31/2015

A paired sample set refers to one source water and one treated water sample. A source water alkalinity is also required at the same time the TOC sample is taken.



OH5001911 SEBRING VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: SEBRING, VILLAGE OF DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	20 Sample(s) Required between 6/1/2015 and 9/30/2015
-------------------------------	--

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	9 Sample(s) Required between 1/1/2015 and 1/31/2015
	9 Sample(s) Required between 2/1/2015 and 2/28/2015
	9 Sample(s) Required between 3/1/2015 and 3/31/2015
	9 Sample(s) Required between 4/1/2015 and 4/30/2015
	9 Sample(s) Required between 5/1/2015 and 5/31/2015
	9 Sample(s) Required between 6/1/2015 and 6/30/2015
	9 Sample(s) Required between 7/1/2015 and 7/31/2015
	9 Sample(s) Required between 8/1/2015 and 8/31/2015
	9 Sample(s) Required between 9/1/2015 and 9/30/2015
	9 Sample(s) Required between 10/1/2015 and 10/31/2015
	9 Sample(s) Required between 11/1/2015 and 11/30/2015
	9 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000	9 Sample(s) Required between 1/1/2015 and 1/31/2015
	9 Sample(s) Required between 2/1/2015 and 2/28/2015
	9 Sample(s) Required between 3/1/2015 and 3/31/2015
	9 Sample(s) Required between 4/1/2015 and 4/30/2015
	9 Sample(s) Required between 5/1/2015 and 5/31/2015
	9 Sample(s) Required between 6/1/2015 and 6/30/2015
	9 Sample(s) Required between 7/1/2015 and 7/31/2015
	9 Sample(s) Required between 8/1/2015 and 8/31/2015
	9 Sample(s) Required between 9/1/2015 and 9/30/2015
	9 Sample(s) Required between 10/1/2015 and 10/31/2015
	9 Sample(s) Required between 11/1/2015 and 11/30/2015
	9 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: SEBRING, VILLAGE OF DISTRIBUTION 14277 MAIN STREET	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/8/2015 and 2/14/2015 at SMP: DS201
	1 Sample(s) Required between 5/8/2015 and 5/14/2015 at SMP: DS201
	1 Sample(s) Required between 8/8/2015 and 8/14/2015 at SMP: DS201



OH5001911 SEBRING VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: SEBRING, VILLAGE OF DISTRIBUTION 14277 MAIN STREET	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 11/8/2015 and 11/14/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: SEBRING, VILLAGE OF DISTRIBUTION 450 COURTNEY ROAD	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/8/2015 and 2/14/2015 at SMP: DS202
	1 Sample(s) Required between 5/8/2015 and 5/14/2015 at SMP: DS202
	1 Sample(s) Required between 8/8/2015 and 8/14/2015 at SMP: DS202
	1 Sample(s) Required between 11/8/2015 and 11/14/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH5002112 GLEN AT STATE LINE MHP 2 PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5056016	Facility Name: STATE LINE MHP-SYSTEM NO 2	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2015 and 10/31/2015
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020	
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015
RADIOLOGICALS	1 Sample(s) Required between 6/1/2015 and 10/31/2015
<i>Sample for all the analytes listed below:</i>	
GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2015 and 10/31/2015



OH5002112 GLEN AT STATE LINE MHP 2 PWS

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: STATE LINE MHP 2 DISTRIBUTION
Location SMP ID: DS000

Table with 2 columns: Chemicals, Monitoring Requirements. Row 1: LEAD - 1030 AND COPPER - 1022, 5 Sample(s) Required between 1/1/2015 and 6/30/2015, 5 Sample(s) Required between 7/1/2015 and 12/31/2015

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: http://epa.ohio.gov/ddagw/reporting.aspx

Table with 2 columns: Chemicals, Monitoring Requirements. Row 1: TOTAL COLIFORM (TCR) - 3100, 1 Sample(s) Required between 1/1/2015 and 1/31/2015, 1 Sample(s) Required between 2/1/2015 and 2/28/2015, 1 Sample(s) Required between 3/1/2015 and 3/31/2015, 1 Sample(s) Required between 4/1/2015 and 4/30/2015, 1 Sample(s) Required between 5/1/2015 and 5/31/2015, 1 Sample(s) Required between 6/1/2015 and 6/30/2015, 1 Sample(s) Required between 7/1/2015 and 7/31/2015, 1 Sample(s) Required between 8/1/2015 and 8/31/2015, 1 Sample(s) Required between 9/1/2015 and 9/30/2015, 1 Sample(s) Required between 10/1/2015 and 10/31/2015, 1 Sample(s) Required between 11/1/2015 and 11/30/2015, 1 Sample(s) Required between 12/1/2015 and 12/31/2015

Table with 2 columns: Chemicals, Monitoring Requirements. Row 1: TOTAL CHLORINE - 1000, 1 Sample(s) Required between 1/1/2015 and 1/31/2015, 1 Sample(s) Required between 2/1/2015 and 2/28/2015, 1 Sample(s) Required between 3/1/2015 and 3/31/2015, 1 Sample(s) Required between 4/1/2015 and 4/30/2015, 1 Sample(s) Required between 5/1/2015 and 5/31/2015, 1 Sample(s) Required between 6/1/2015 and 6/30/2015, 1 Sample(s) Required between 7/1/2015 and 7/31/2015, 1 Sample(s) Required between 8/1/2015 and 8/31/2015, 1 Sample(s) Required between 9/1/2015 and 9/30/2015, 1 Sample(s) Required between 10/1/2015 and 10/31/2015, 1 Sample(s) Required between 11/1/2015 and 11/30/2015, 1 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Facility ID: DS1 Facility Name: STATE LINE MHP 2 DISTRIBUTION
Location SMP ID: DS201 ADDRESS NOT KNOWN

Table with 2 columns: Chemicals, Monitoring Requirements. Row 1: DISINFECTION BYPRODUCTS, 1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201

Sample for all the analytes listed below:
1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



OH5002303 YOUNGSTOWN CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: YOUNGSTOWN, CITY OF DISTRIBUTION	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100

120 Sample(s) Required between	1/1/2015	and	1/31/2015
120 Sample(s) Required between	2/1/2015	and	2/28/2015
120 Sample(s) Required between	3/1/2015	and	3/31/2015
120 Sample(s) Required between	4/1/2015	and	4/30/2015
120 Sample(s) Required between	5/1/2015	and	5/31/2015
120 Sample(s) Required between	6/1/2015	and	6/30/2015
120 Sample(s) Required between	7/1/2015	and	7/31/2015
120 Sample(s) Required between	8/1/2015	and	8/31/2015
120 Sample(s) Required between	9/1/2015	and	9/30/2015
120 Sample(s) Required between	10/1/2015	and	10/31/2015
120 Sample(s) Required between	11/1/2015	and	11/30/2015
120 Sample(s) Required between	12/1/2015	and	12/31/2015

TOTAL CHLORINE - 1000

120 Sample(s) Required between	1/1/2015	and	1/31/2015
120 Sample(s) Required between	2/1/2015	and	2/28/2015
120 Sample(s) Required between	3/1/2015	and	3/31/2015
120 Sample(s) Required between	4/1/2015	and	4/30/2015
120 Sample(s) Required between	5/1/2015	and	5/31/2015
120 Sample(s) Required between	6/1/2015	and	6/30/2015
120 Sample(s) Required between	7/1/2015	and	7/31/2015
120 Sample(s) Required between	8/1/2015	and	8/31/2015
120 Sample(s) Required between	9/1/2015	and	9/30/2015
120 Sample(s) Required between	10/1/2015	and	10/31/2015
120 Sample(s) Required between	11/1/2015	and	11/30/2015
120 Sample(s) Required between	12/1/2015	and	12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: YOUNGSTOWN, CITY OF DISTRIBUTION 2976 MCCARTNEY RD.	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between	2/1/2015	and	2/7/2015	at SMP: DS201
1 Sample(s) Required between	5/1/2015	and	5/7/2015	at SMP: DS201
1 Sample(s) Required between	8/1/2015	and	8/7/2015	at SMP: DS201
1 Sample(s) Required between	11/1/2015	and	11/7/2015	at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH5002303 YOUNGSTOWN CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: YOUNGSTOWN, CITY OF DISTRIBUTION 761 INDUSTRIAL RD.	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/1/2015 and 2/7/2015 at SMP: DS202
	1 Sample(s) Required between 5/1/2015 and 5/7/2015 at SMP: DS202
	1 Sample(s) Required between 8/1/2015 and 8/7/2015 at SMP: DS202
	1 Sample(s) Required between 11/1/2015 and 11/7/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS203	Facility Name: YOUNGSTOWN, CITY OF DISTRIBUTION 1624 E. MIDLOTHIAN BLVD.	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/1/2015 and 2/7/2015 at SMP: DS203
	1 Sample(s) Required between 5/1/2015 and 5/7/2015 at SMP: DS203
	1 Sample(s) Required between 8/1/2015 and 8/7/2015 at SMP: DS203
	1 Sample(s) Required between 11/1/2015 and 11/7/2015 at SMP: DS203

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS204	Facility Name: YOUNGSTOWN, CITY OF DISTRIBUTION 6252 MAHONING AVE.	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/1/2015 and 2/7/2015 at SMP: DS204
	1 Sample(s) Required between 5/1/2015 and 5/7/2015 at SMP: DS204
	1 Sample(s) Required between 8/1/2015 and 8/7/2015 at SMP: DS204
	1 Sample(s) Required between 11/1/2015 and 11/7/2015 at SMP: DS204

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS205	Facility Name: YOUNGSTOWN, CITY OF DISTRIBUTION 571 BELLE VISTA AVE.	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/1/2015 and 2/7/2015 at SMP: DS205
	1 Sample(s) Required between 5/1/2015 and 5/7/2015 at SMP: DS205
	1 Sample(s) Required between 8/1/2015 and 8/7/2015 at SMP: DS205

OH5002303 YOUNGSTOWN CITY PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS205	Facility Name: YOUNGSTOWN, CITY OF DISTRIBUTION 571 BELLE VISTA AVE.	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 11/1/2015 and 11/7/2015 at SMP: DS205

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS206	Facility Name: YOUNGSTOWN, CITY OF DISTRIBUTION 125 W. INDIANOLA AVE.	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/1/2015 and 2/7/2015 at SMP: DS206
	1 Sample(s) Required between 5/1/2015 and 5/7/2015 at SMP: DS206
	1 Sample(s) Required between 8/1/2015 and 8/7/2015 at SMP: DS206
	1 Sample(s) Required between 11/1/2015 and 11/7/2015 at SMP: DS206

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS207	Facility Name: YOUNGSTOWN, CITY OF DISTRIBUTION 2739 MCCOLLUM RD.	Facility Class: CLASS 2
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/1/2015 and 2/7/2015 at SMP: DS207
	1 Sample(s) Required between 5/1/2015 and 5/7/2015 at SMP: DS207
	1 Sample(s) Required between 8/1/2015 and 8/7/2015 at SMP: DS207
	1 Sample(s) Required between 11/1/2015 and 11/7/2015 at SMP: DS207

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Location	Facility ID: DS1 SMP ID: DS208	Facility Name: YOUNGSTOWN, CITY OF DISTRIBUTION 2251 MCGUFFY RD.	Facility Class: CLASS 2
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 2/1/2015 and 2/7/2015 at SMP: DS208
	1 Sample(s) Required between 5/1/2015 and 5/7/2015 at SMP: DS208
	1 Sample(s) Required between 8/1/2015 and 8/7/2015 at SMP: DS208
	1 Sample(s) Required between 11/1/2015 and 11/7/2015 at SMP: DS208

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH5002812 GLEN AT STATE LINE MHP 1 PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5056019	Facility Name: STATE LINE MHP-SYSTEM NO 1	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2015 and 10/31/2015
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015
RADIOLOGICALS	1 Sample(s) Required between 6/1/2015 and 10/31/2015
<i>Sample for all the analytes listed below:</i>	
GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 10/1/2015 and 12/31/2015



OH5002812 GLEN AT STATE LINE MHP 1 PWS

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: STATE LINE MHP 1 DISTRIBUTION
Location SMP ID: DS000

Table with 2 columns: Chemicals, Monitoring Requirements. Row 1: LEAD - 1030 AND COPPER - 1022, 5 Sample(s) Required between 1/1/2015 and 6/30/2015, 5 Sample(s) Required between 7/1/2015 and 12/31/2015

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: http://epa.ohio.gov/ddagw/reporting.aspx

Table with 2 columns: Chemicals, Monitoring Requirements. Row 1: TOTAL COLIFORM (TCR) - 3100, 1 Sample(s) Required between 1/1/2015 and 1/31/2015, 1 Sample(s) Required between 2/1/2015 and 2/28/2015, 1 Sample(s) Required between 3/1/2015 and 3/31/2015, 1 Sample(s) Required between 4/1/2015 and 4/30/2015, 1 Sample(s) Required between 5/1/2015 and 5/31/2015, 1 Sample(s) Required between 6/1/2015 and 6/30/2015, 1 Sample(s) Required between 7/1/2015 and 7/31/2015, 1 Sample(s) Required between 8/1/2015 and 8/31/2015, 1 Sample(s) Required between 9/1/2015 and 9/30/2015, 1 Sample(s) Required between 10/1/2015 and 10/31/2015, 1 Sample(s) Required between 11/1/2015 and 11/30/2015, 1 Sample(s) Required between 12/1/2015 and 12/31/2015

Table with 2 columns: Chemicals, Monitoring Requirements. Row 1: TOTAL CHLORINE - 1000, 1 Sample(s) Required between 1/1/2015 and 1/31/2015, 1 Sample(s) Required between 2/1/2015 and 2/28/2015, 1 Sample(s) Required between 3/1/2015 and 3/31/2015, 1 Sample(s) Required between 4/1/2015 and 4/30/2015, 1 Sample(s) Required between 5/1/2015 and 5/31/2015, 1 Sample(s) Required between 6/1/2015 and 6/30/2015, 1 Sample(s) Required between 7/1/2015 and 7/31/2015, 1 Sample(s) Required between 8/1/2015 and 8/31/2015, 1 Sample(s) Required between 9/1/2015 and 9/30/2015, 1 Sample(s) Required between 10/1/2015 and 10/31/2015, 1 Sample(s) Required between 11/1/2015 and 11/30/2015, 1 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Facility ID: DS1 Facility Name: STATE LINE MHP 1 DISTRIBUTION
Location SMP ID: DS201 ADDRESS NOT KNOWN

Table with 2 columns: Chemicals, Monitoring Requirements. Row 1: DISINFECTION BYPRODUCTS, 1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201

Sample for all the analytes listed below:
1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



OH5003012 ST. MARYS ALZHEIMERS CENTER

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5056020	Facility Name: ST MARYS ALZHEIMERS CTR	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015
INORGANICS	1 Sample(s) Required between 6/1/2015 and 10/31/2015
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1015 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015
RADIOLOGICALS	1 Sample(s) Required between 6/1/2015 and 10/31/2015
<i>Sample for all the analytes listed below:</i>	
GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 10/1/2015 and 12/31/2015



OH5003012 ST. MARYS ALZHEIMERS CENTER

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

Table with 2 columns: Sampling Location, Facility ID: DS1, Facility Name: ST. MARYS ALZHEIMERS CENTER DISTRIBUTION, SMP ID: DS000

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

Table with 2 columns: Chemical (TOTAL COLIFORM (TCR) - 3100), Monitoring Requirements (1 Sample(s) Required between 1/1/2015 and 1/31/2015, etc.)

Table with 2 columns: Chemical (TOTAL CHLORINE - 1000), Monitoring Requirements (1 Sample(s) Required between 1/1/2015 and 1/31/2015, etc.)

Samples should be collected at the same time and place as the Total Coliform samples.

Table with 2 columns: Sampling Location, Facility ID: DS1, Facility Name: ST. MARYS ALZHEIMERS CENTER DISTRIBUTION, SMP ID: DS201, ADDRESS NOT KNOWN

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950

OH5031212 KING'S MOTEL - EAST

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **KING'S MOTEL - EAST DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056025** Facility Name: **KING'S MOTEL - EAST STU 1**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

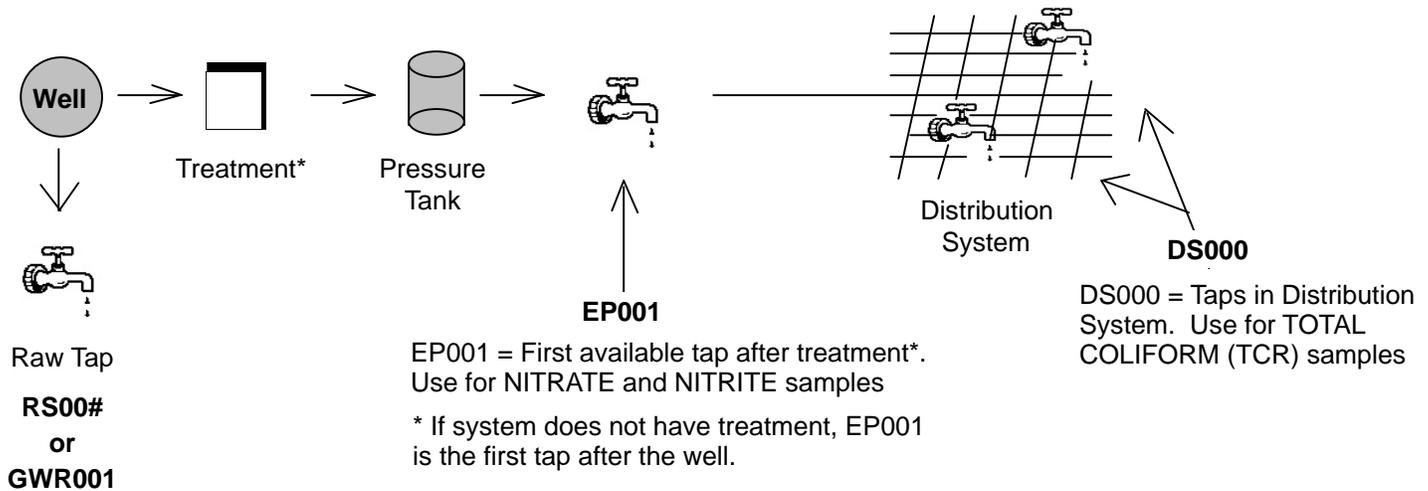

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5031812 TIC TOC FOODMART/ EDMOND'S DINER

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **TIC TOC FOOD MART-ROCCO'S DINER DISTRI**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056026** Facility Name: **ROCCO'S DINER / TIC TOC FOOD MART**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

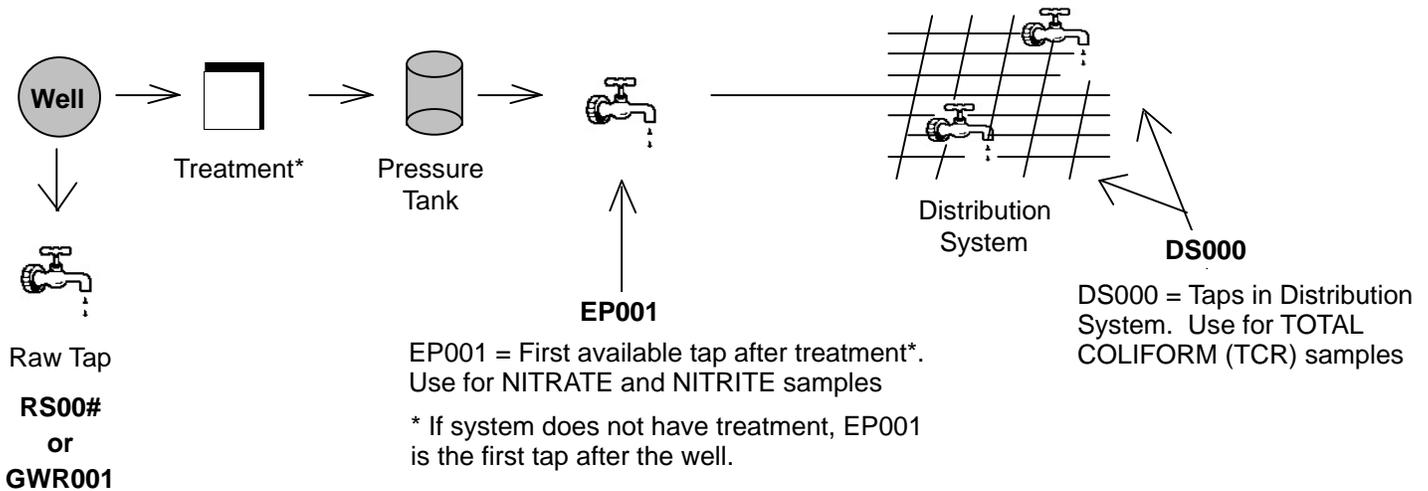

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5033012 BENS RESTAURANT AND BAR INC PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: BENS RESTAURANT & BAR INC DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5056029	Facility Name: BENS LAKESIDE LOUNGE
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

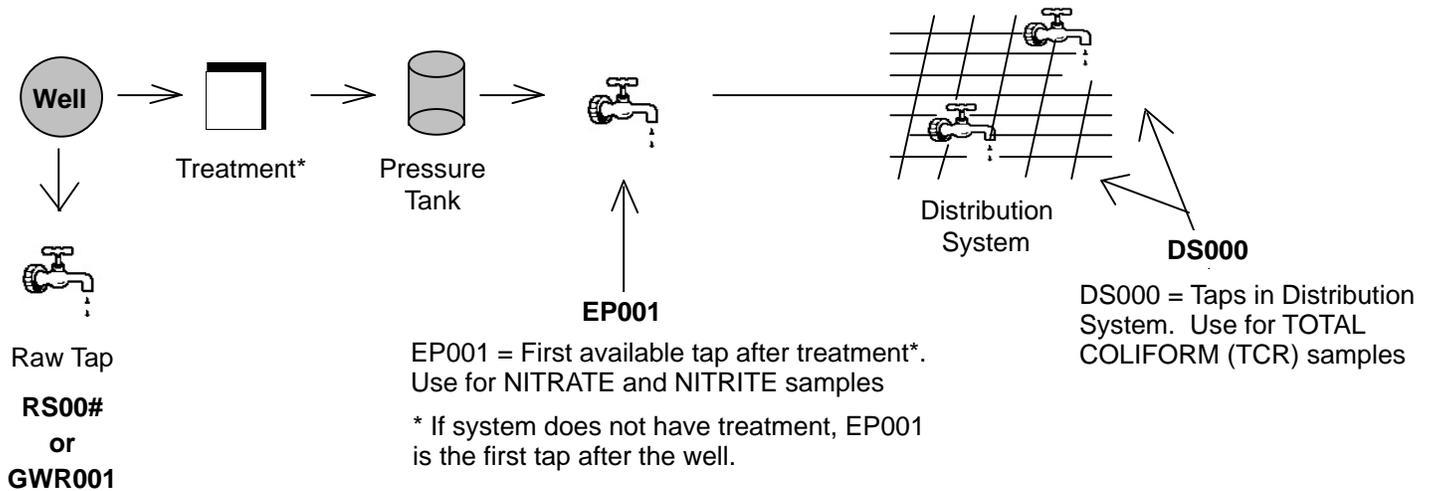

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5033112 CAMP STAMBAUGH BSA MAIN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056030** Facility Name: **CAMP STAMBAUGH BOY SCOUTS STU 1**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

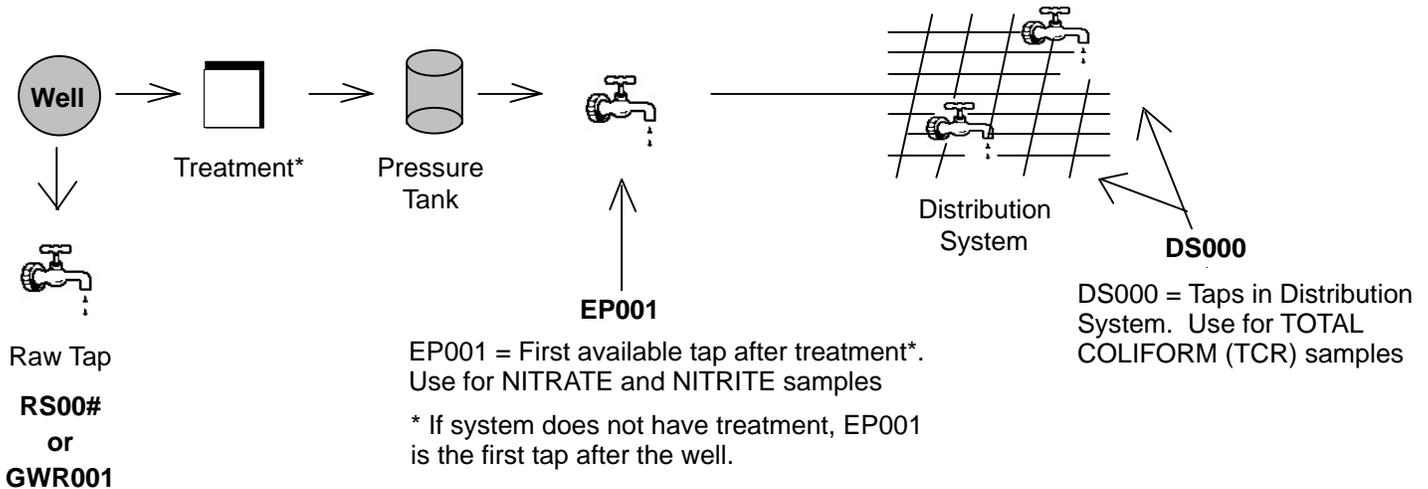

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>

Save a dime. Sample on time!

OH5033112 CAMP STAMBAUGH BSA MAIN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5060558** Facility Name: **CAMP STAMBAUGH BSA MAIN STU 2**
Location SMP ID: **EP002** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

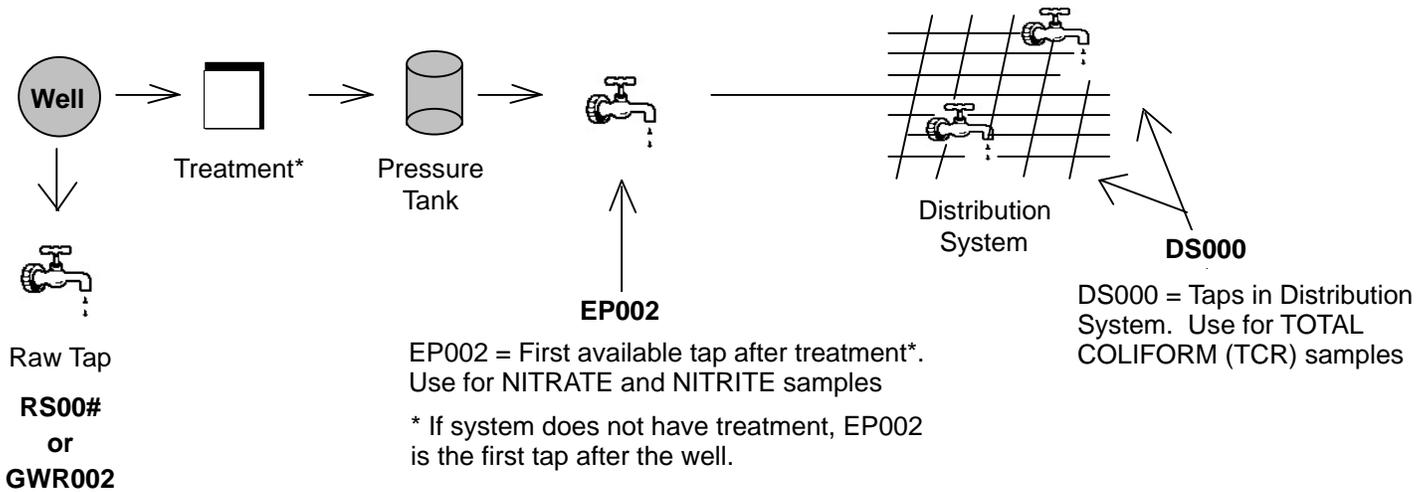

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5034112 SHILLING MILL TAVERN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **SHILLING MILL TAVERN DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056036** Facility Name: **SHILLING MILL TAVERN**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

Where to Collect Samples For a Small Public Water System

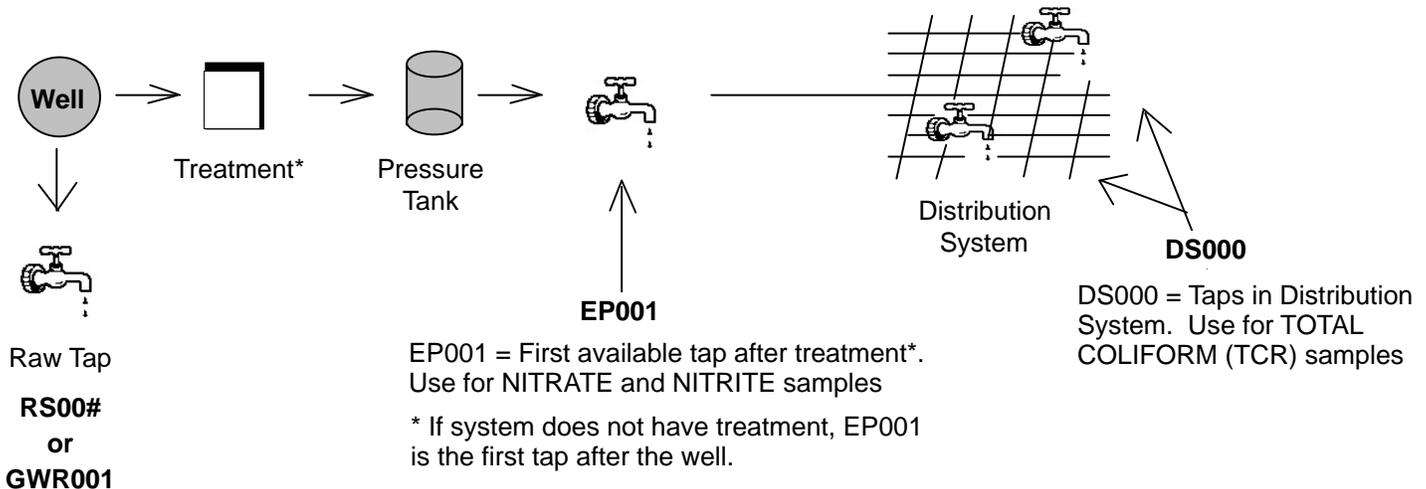

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:
<http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>

Save a dime. Sample on time!

OH5034712 CHAPARRAL FAMILY CAMPGROUND PWS

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **CHAPARRAL FAMILY CAMPGROUND DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056039** Facility Name: **CHAPARRAL FAMILY CAMPGROUND**
Location SMP ID: **EP001** Facility Source: **Ground Water** Facility Class: **CLASS A**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

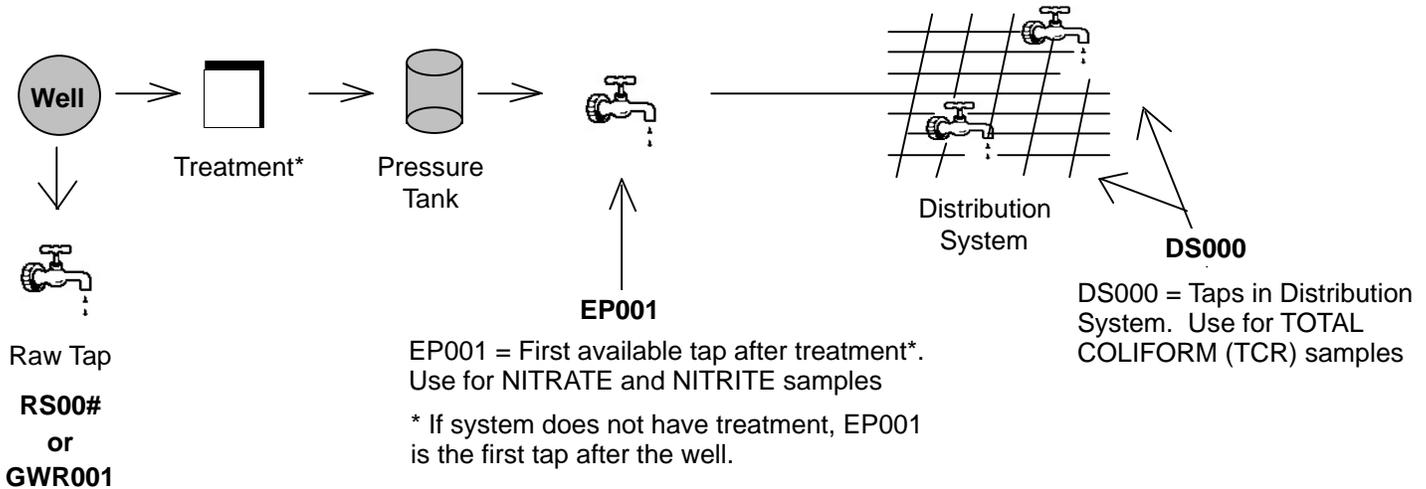

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5034912 LAKE MILTON RV RESORT

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **LAKE MILTON RV RESORT DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056040** Facility Name: **LAKE MILTON RV RESORT**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

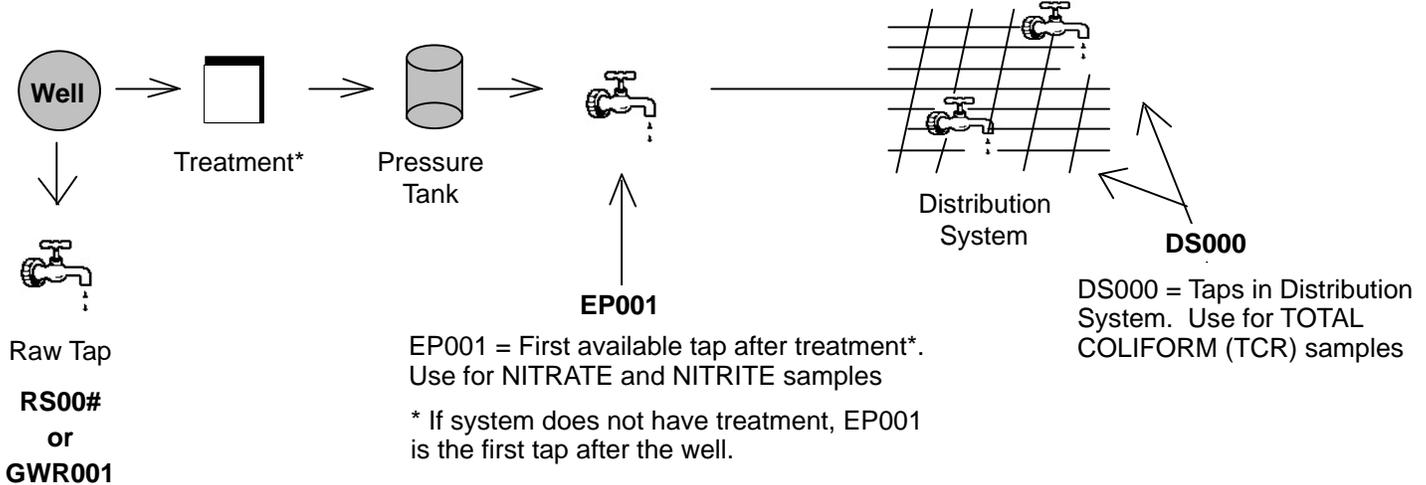

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:
<http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5035812 LAKESIDE CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **LAKESIDE CAMPGROUND DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056042** Facility Name: **LAKESIDE CAMPGROUND**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

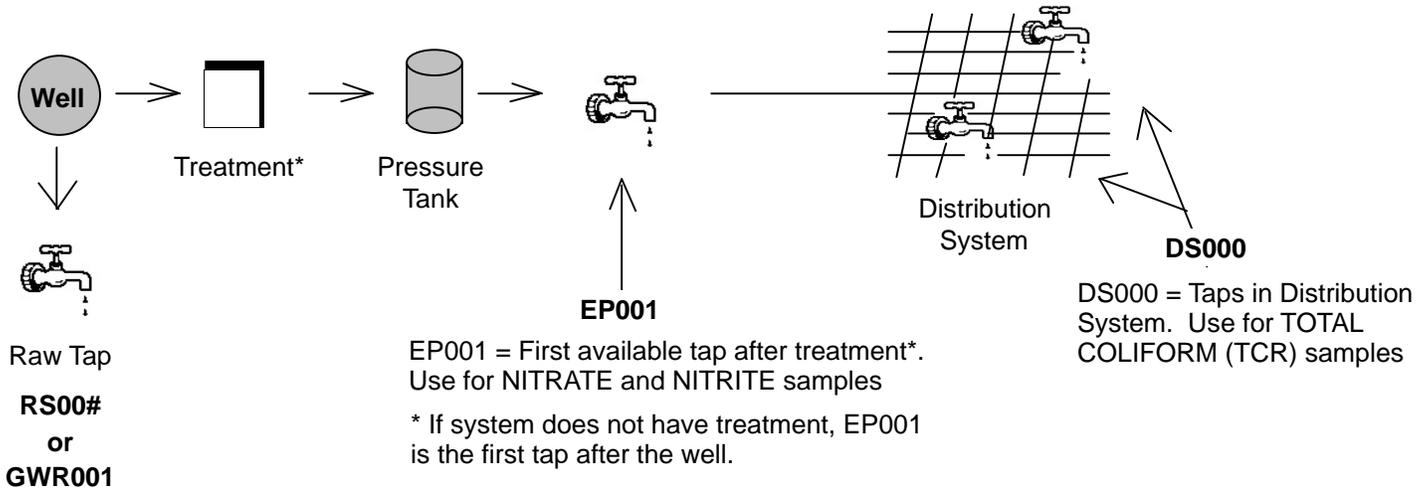

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5036212 DIAMOND BACK GOLF COURSE

System Type: Transient Noncommunity

Operating Period: 3/1 to 11/30

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **DIAMOND BACK GOLF COURSE DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056044** Facility Name: **DIAMOND BACK GOLF COURSE TP**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

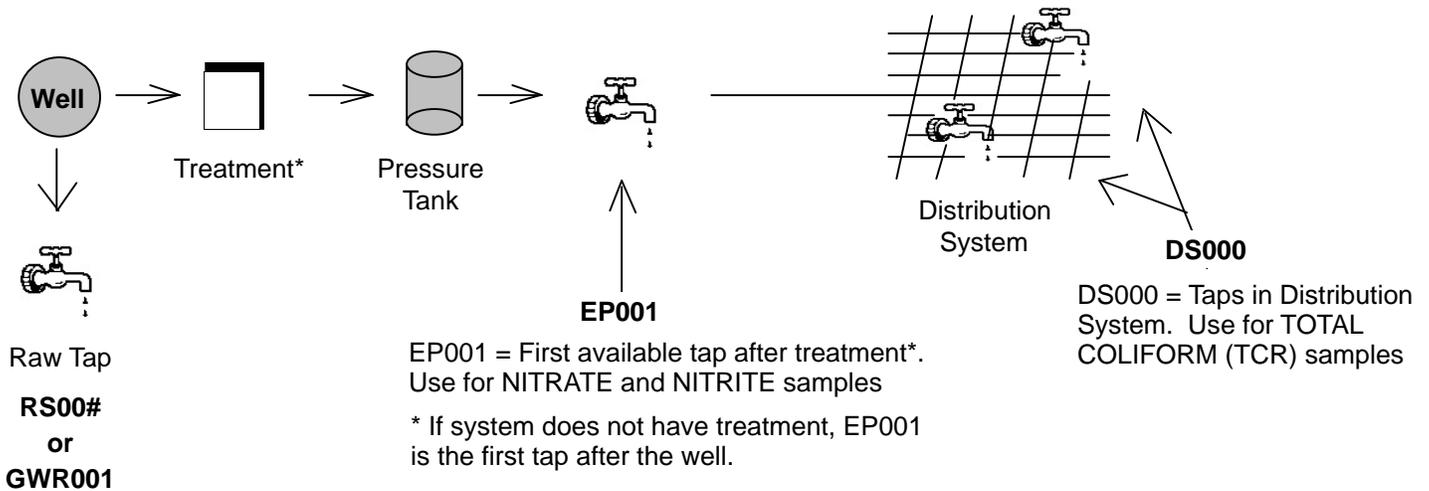

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH5036612 NEO CHURCH OF GOD CAMP & MHP

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5056046	Facility Name: NEO CHURCH OF GOD CAMPGROUND
	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 1/1/2015 and 5/31/2015
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015
RADIOLOGICALS	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015
<u>Sample for all the analytes listed below:</u> GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	1 Sample(s) Required between 1/1/2015 and 5/31/2015
<u>Sample for all the analytes listed below:</u> ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037	
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015



OH5036612 NEO CHURCH OF GOD CAMP & MHP

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: NEO CHURCH OF GOD CAMP DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	5 Sample(s) Required between 1/1/2015 and 6/30/2015 5 Sample(s) Required between 7/1/2015 and 12/31/2015

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 1/31/2015
	1 Sample(s) Required between 2/1/2015 and 2/28/2015
	1 Sample(s) Required between 3/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 4/30/2015
	1 Sample(s) Required between 5/1/2015 and 5/31/2015
	1 Sample(s) Required between 6/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 7/31/2015
	1 Sample(s) Required between 8/1/2015 and 8/31/2015
	1 Sample(s) Required between 9/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 10/31/2015
	1 Sample(s) Required between 11/1/2015 and 11/30/2015
	1 Sample(s) Required between 12/1/2015 and 12/31/2015

Sampling Location	Facility ID: DS1	Facility Name: NEO CHURCH OF GOD CAMP DISTRIBUTION
	SMP ID: DS201	ADDRESS NOT KNOWN

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH5038012 REAL LIFE CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **REAL LIFE CHURCH DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056051** Facility Name: **REAL LIFE CHURCH**
Location SMP ID: **EP001** Facility Source: **Ground Water** Facility Class: **CLASS A**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

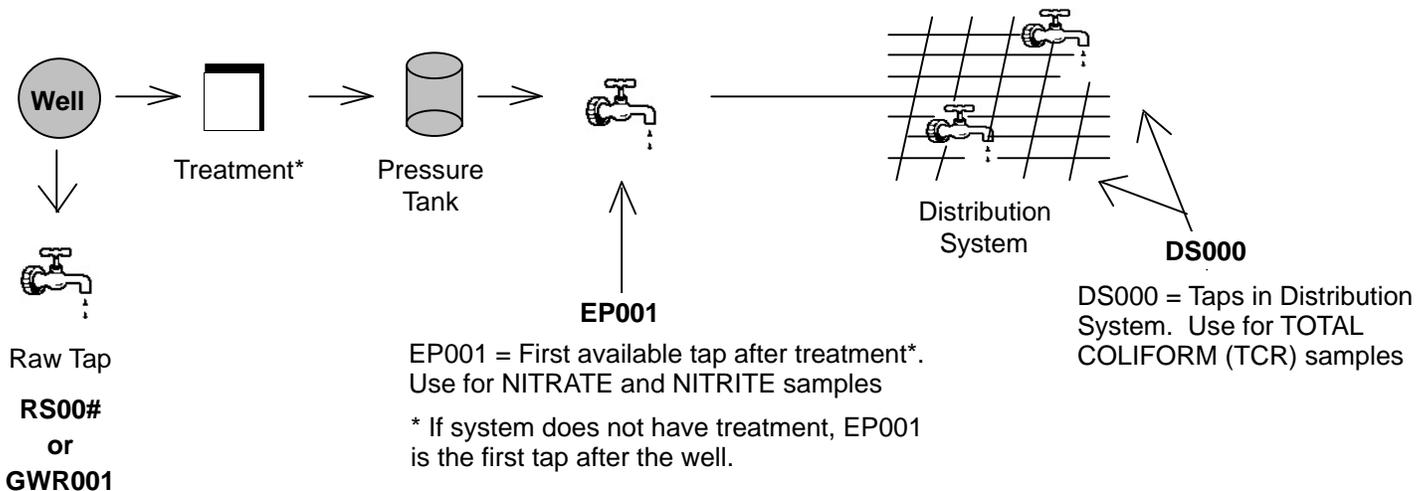

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

OH5038712 GREENFORD BOBCAT SPACE CENTER

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5056054	Facility Name: GREENFORD BOBCAT SPACE CENTER	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2015 and 10/31/2015

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 6/1/2015 and 10/31/2015

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 Not Required

VOLATILE ORGANIC CHEMICALS (VOC) Not Required



Effective Date: 01/01/2015

2015 DISTRIBUTION SCHEDULE

OH5038712 GREENFORD BOBCAT SPACE CENTER

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: GREENFORD BOBCAT SPACE CENT DISTRIB
	SMP ID: DS000	

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

OH5040012 WESTERN RESERVE SCHOOLS (K-12 CAMPUS)

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5056061	Facility Name: WESTERN RESERVE SCHOOLS (K-12 CAMPUS)	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2015 and 10/31/2015

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 6/1/2015 and 10/31/2015

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 Not Required

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2015 and 10/31/2015

OH5040012 WESTERN RESERVE SCHOOLS (K-12 CAMPUS)

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: WESTERN RESERVE SCHOOL K-12 DISTRIBU
	SMP ID: DS000	

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2015 and 9/30/2015
<i>Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: http://epa.ohio.gov/ddagw/reporting.aspx</i>	

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

Sampling Location	Facility ID: DS1	Facility Name: WESTERN RESERVE SCHOOL K-12 DISTRIBU
	SMP ID: DS201	ADDRESS NOT KNOWN

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201
<i>Sample for all the analytes listed below:</i>	
1) TOTAL HALOACETIC ACIDS (HAA5) – 2456	
2) TTHM - 2950	

Sampling Location	Facility ID: DS1	Facility Name: WESTERN RESERVE SCHOOL K-12 DISTRIBU
	SMP ID: DS202	ADDRESS NOT KNOWN

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS202
<i>Sample for all the analytes listed below:</i>	
1) TOTAL HALOACETIC ACIDS (HAA5) – 2456	
2) TTHM - 2950	

OH5040112 BACKYARD BAR AND GRILLE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056062** Facility Name: **BACKYARD BAR AND GRILLE**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

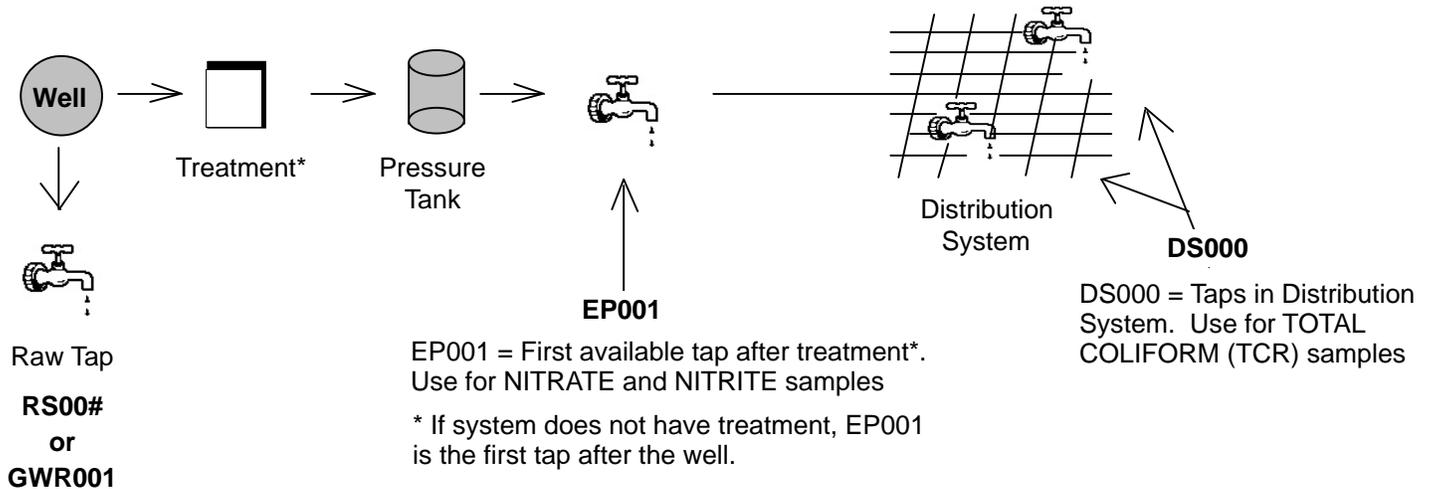

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>

Save a dime. Sample on time!

OH5040612 USACE-BERLIN LAKE/ MILL CREEK REC. AREA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: USACE-BERLIN LAKE DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5056064	Facility Name: USACE BERLIN LAKE - STU #3 (@ WELL #3)
Location SMP ID: EP003	Facility Source: Ground Water Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

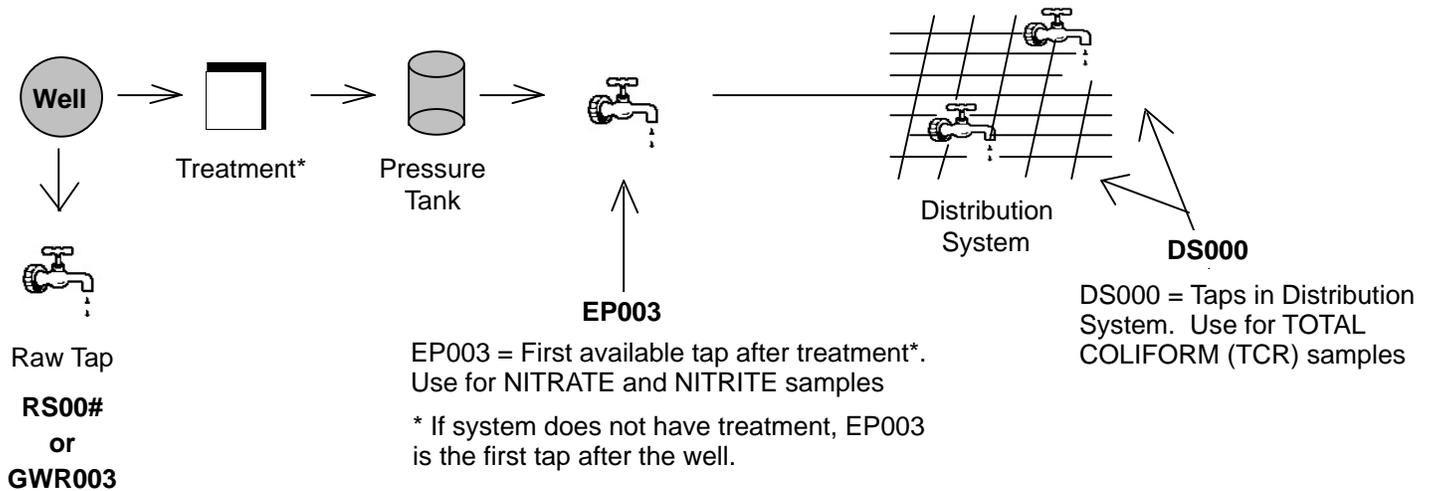

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5040612 USACE-BERLIN LAKE/ MILL CREEK REC. AREA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: USACE-BERLIN LAKE DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5062272	Facility Name: USACE BERLIN LAKE - STU #1 (@ WELL #1)
Location SMP ID: EP001	Facility Source: Ground Water
	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

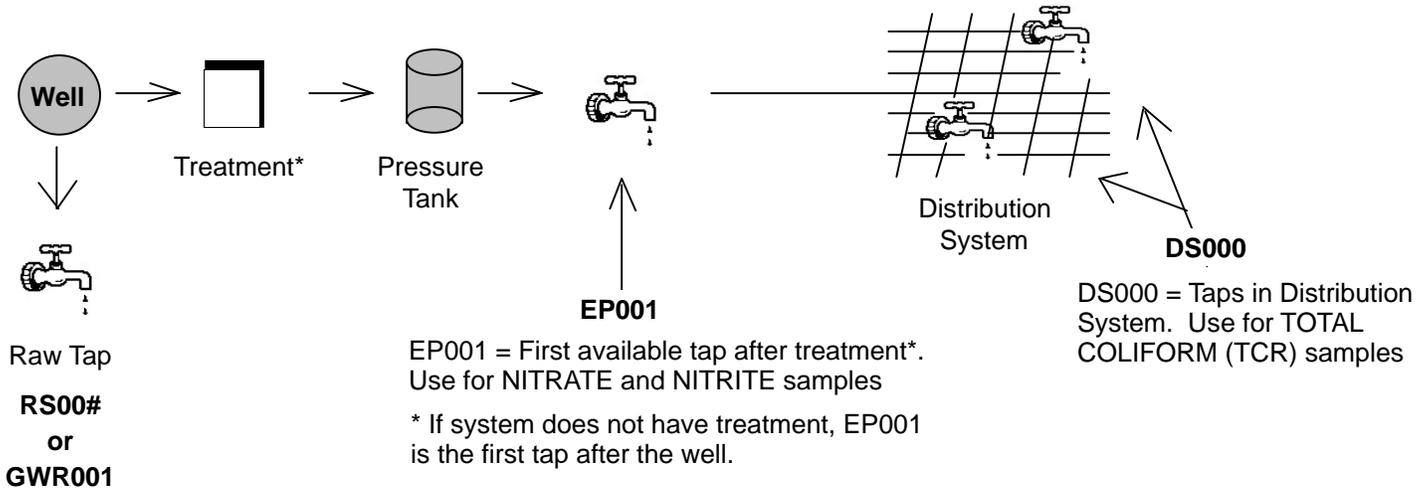

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5040612 USACE-BERLIN LAKE/ MILL CREEK REC. AREA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **USACE-BERLIN LAKE DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5062273** Facility Name: **USACE BERLIN LAKE - STU #2 (@ WELL #2)**
Location SMP ID: **EP002** Facility Source: **Ground Water** Facility Class: **CLASS A**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

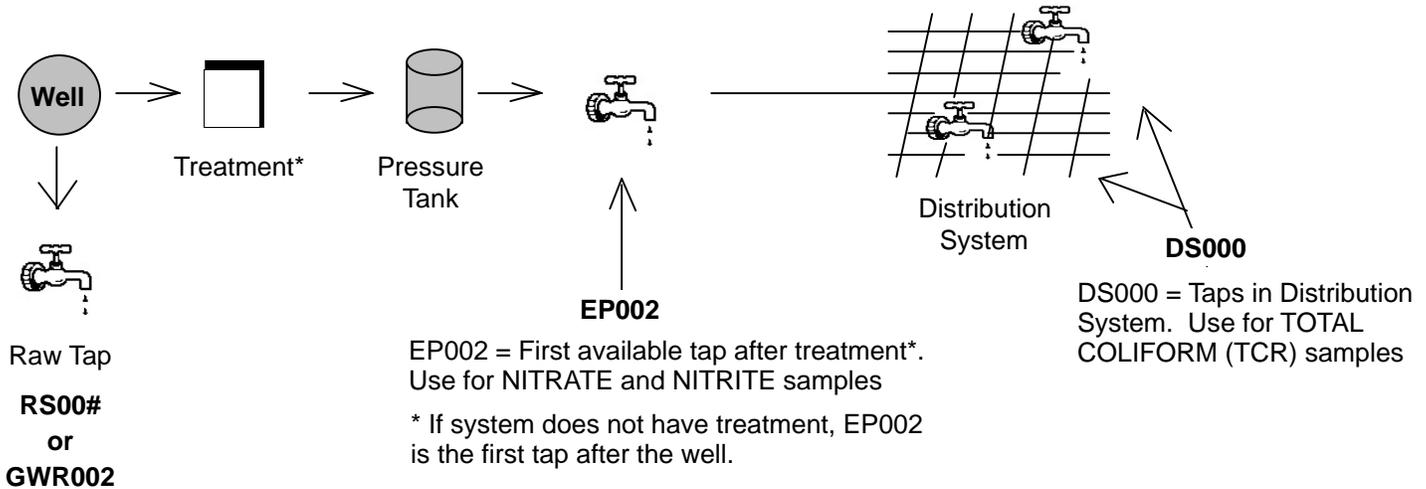

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5040912 BEDFORD TRAILS GOLF COURSE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: BEDFORD TRAILS GOLF COUR DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5056065	Facility Name: BEDFORD TRAILS GOLF COURSE
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

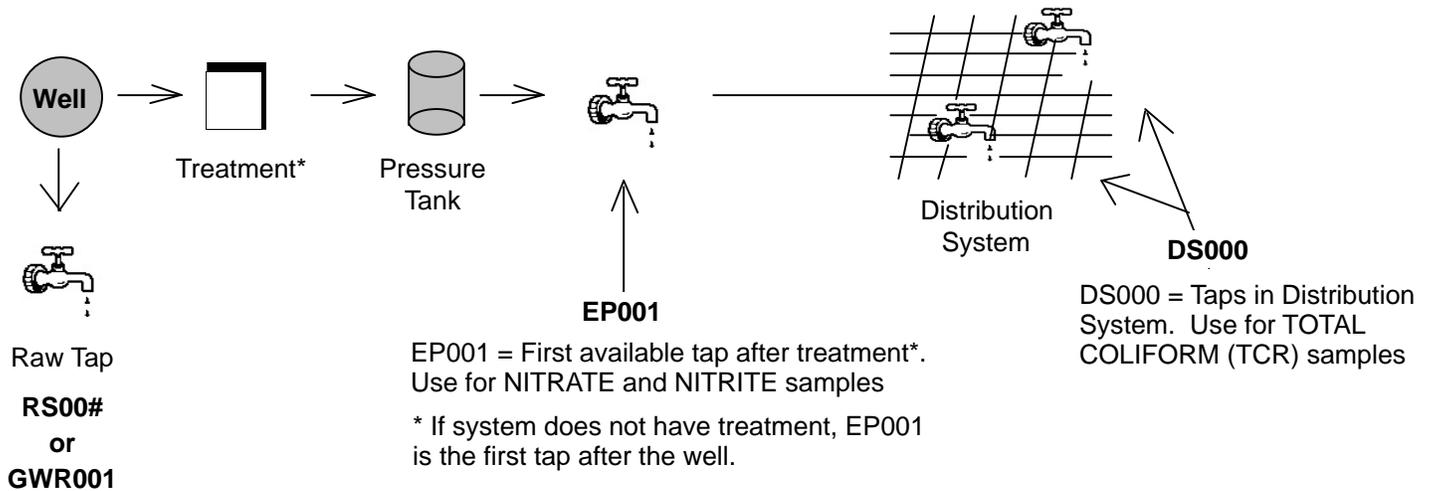

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5042712 WHITEHOUSE FRUIT FARM

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **WHITEHOUSE FRUIT FARM DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056073** Facility Name: **WHITEHOUSE FRUIT FARM AMLC**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

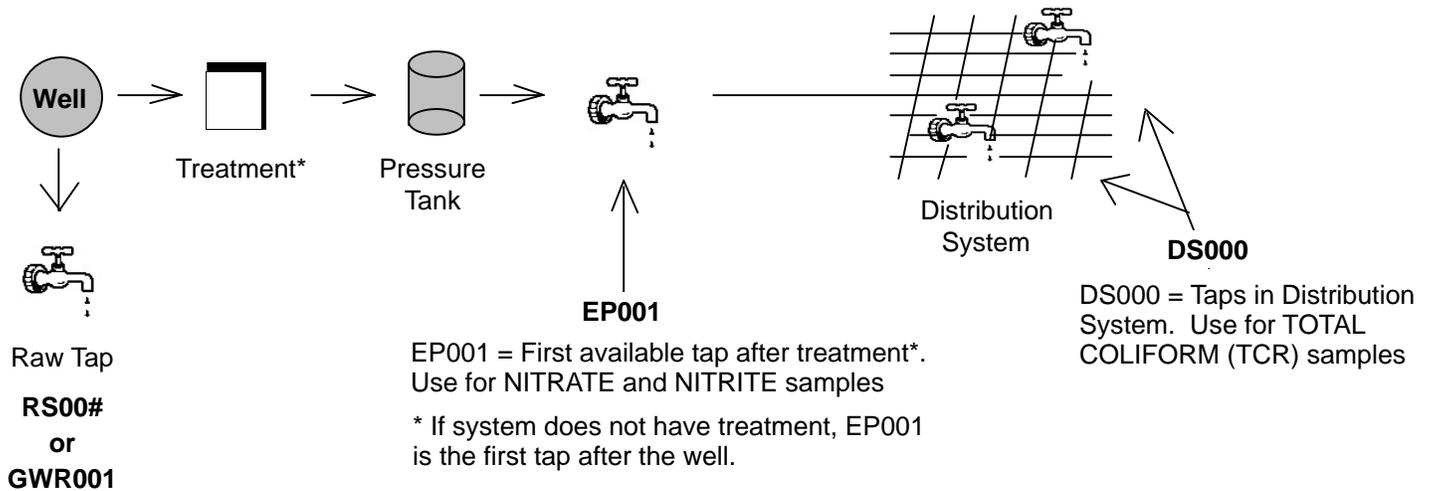

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5043012 GREENFORD EVAN LUTHERAN CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **GREENFORD EVAN LUTHERAN DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056075** Facility Name: **GREENFORD EVAN LUTHERAN CHURCH**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

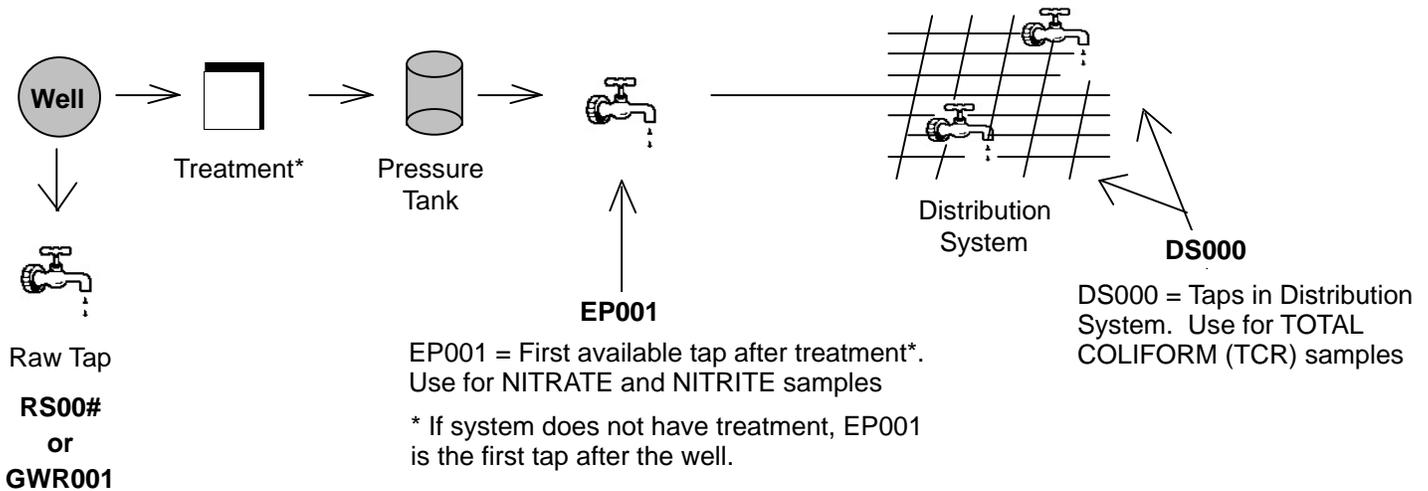

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5043312 GREEN ACRES-NORTH WELL PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **GREEN ACRES NORTH WELL DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056078** Facility Name: **GREEN ACRES CAMPGROUND**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

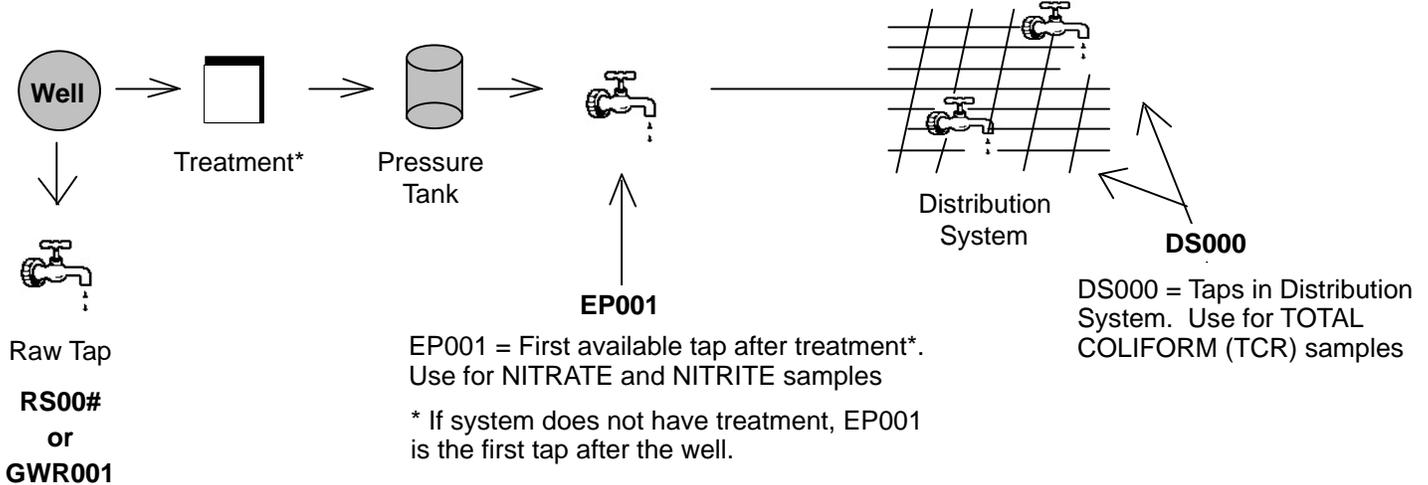

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5043322 GREEN ACRES-SOUTH WELL PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **GREEN ACRES-SOUTH WELL DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056079** Facility Name: **GREEN ACRES SOUTH WELL**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

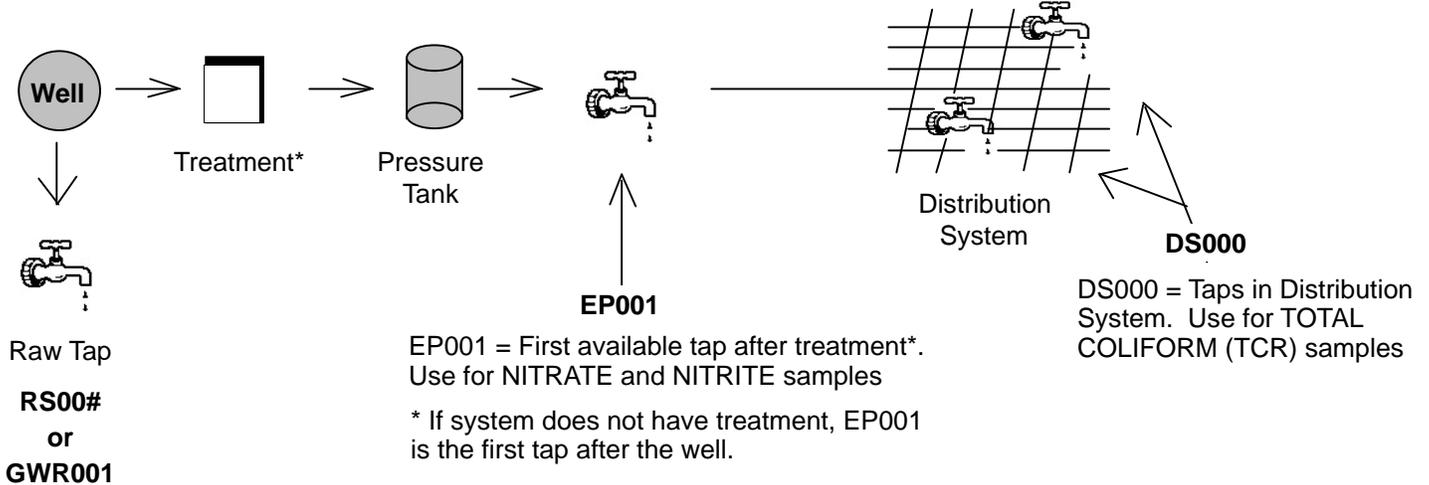

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:
<http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5043412 WESTERN RESERVE PARK - BATHHOUSE PWS

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **WESTERN RESERVE PARK- BATHHOUSE DISTRIB.**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056080** Facility Name: **WESTERN RESERVE PARK - BATHHOUSE**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

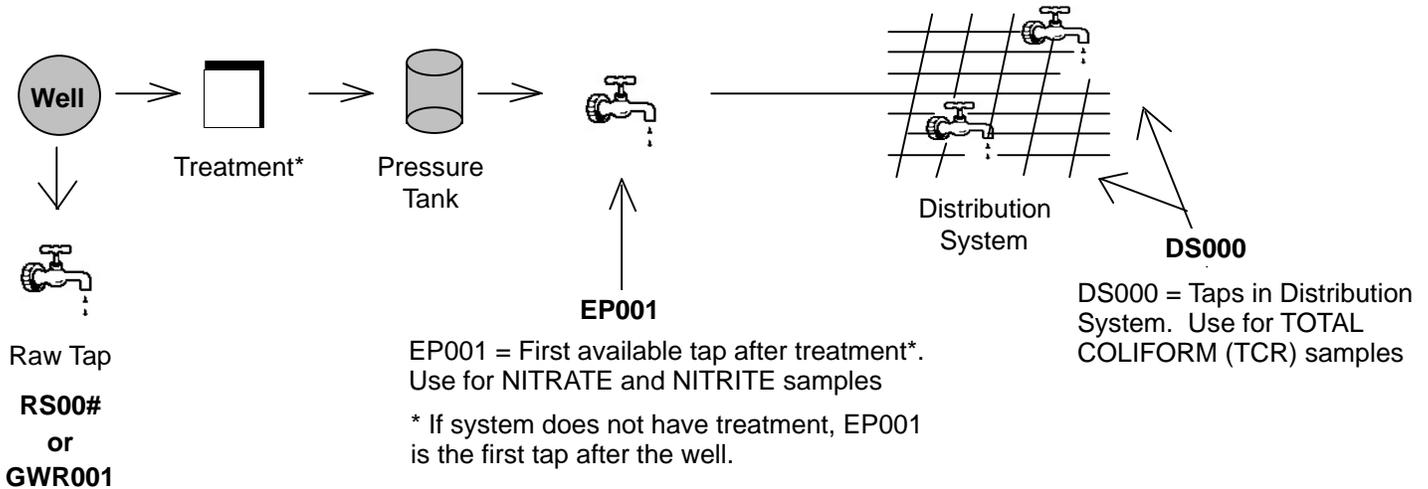

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5043422 WESTERN RESERVE PARK - CAMPGROUND PWS

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **WESTERN RESERVE PARK - CAMP DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056081** Facility Name: **WESTERN RESERVE PARK - CAMPGROUND**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

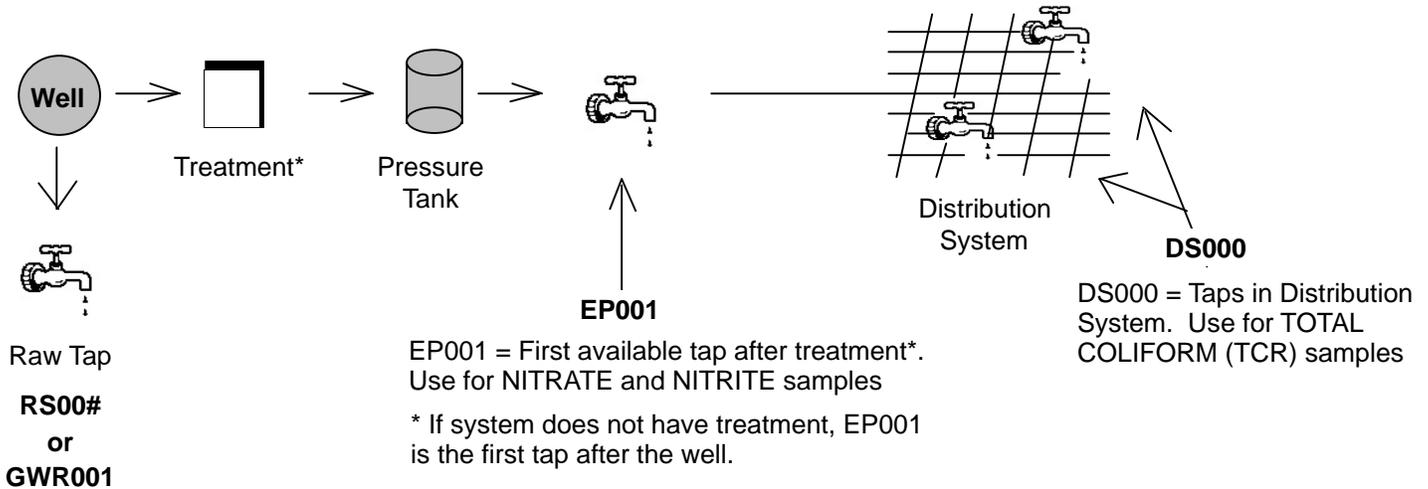

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5043912 ON TARGET OUTFITTERS PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056085** Facility Name: **ON TARGET OUTFITTERS**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

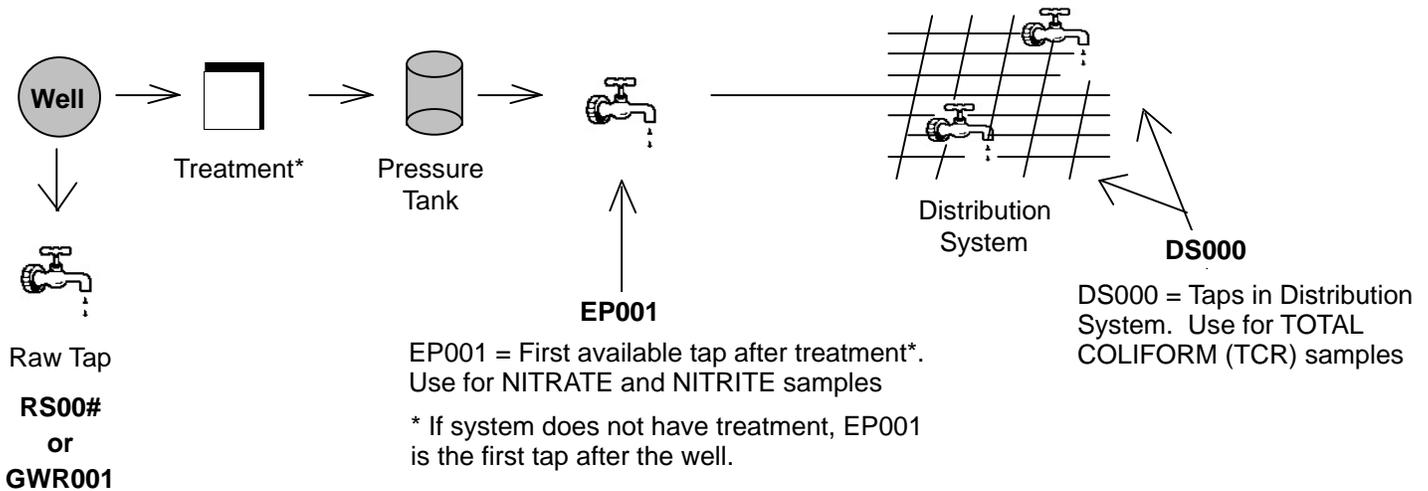

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5045012 LAKESIDE GOLF COURSE

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: LAKESIDE GOLF COURSE DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5056093	Facility Name: LAKESIDE GOLF COURSE
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

Where to Collect Samples For a Small Public Water System

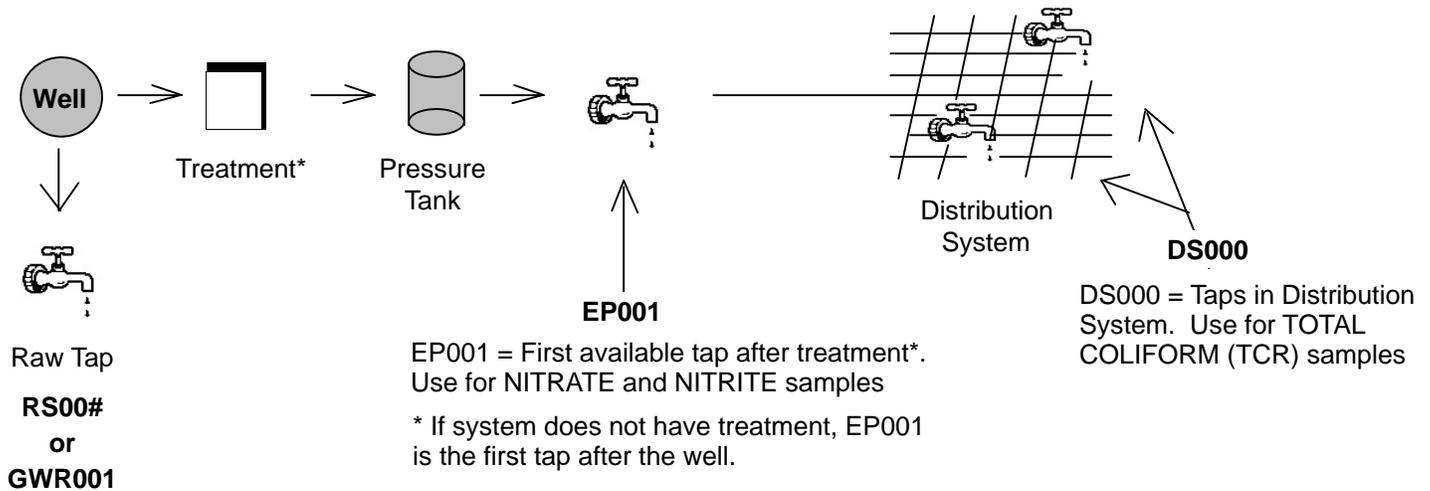

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5045512 PINE MEADOWS GOLF COURSE

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **PINE MEADOWS GOLF COURSE DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056098** Facility Name: **PINE MEADOWS GOLF COURSE**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

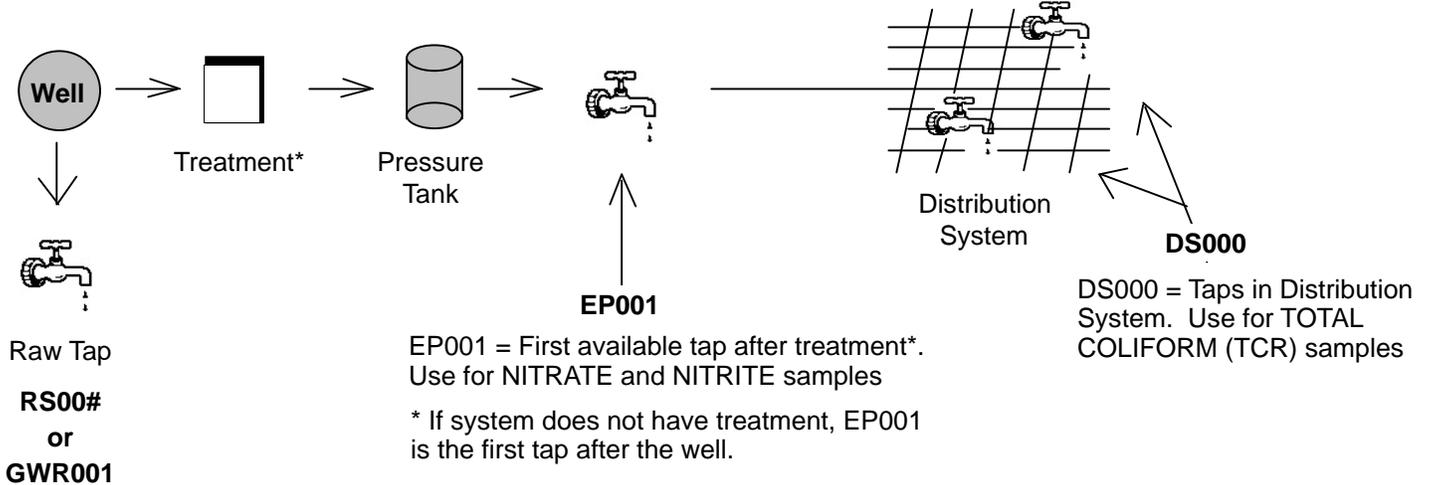

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:
<http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5045612 LAKE MILTON SUNOCO

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **LAKE MILTON SUNOCO DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056099** Facility Name: **LAKE MILTON SUNOCO**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 4/1/2015 and 6/30/2015

Where to Collect Samples For a Small Public Water System

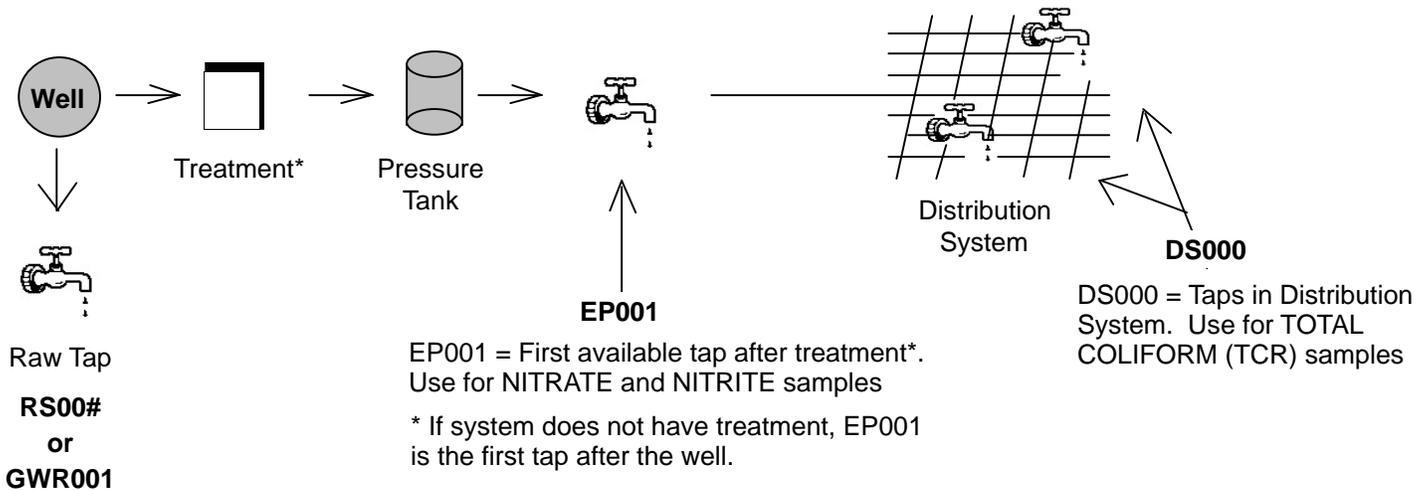

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5045812 BOARDMAN PARK-EDGEWOOD PWS

System Type: Transient Noncommunity

Operating Period: 4/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **BOARDMAN PARK-EDGEWOOD DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056101** Facility Name: **BOARDMAN PARK EDGEWOOD PAVILIO**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

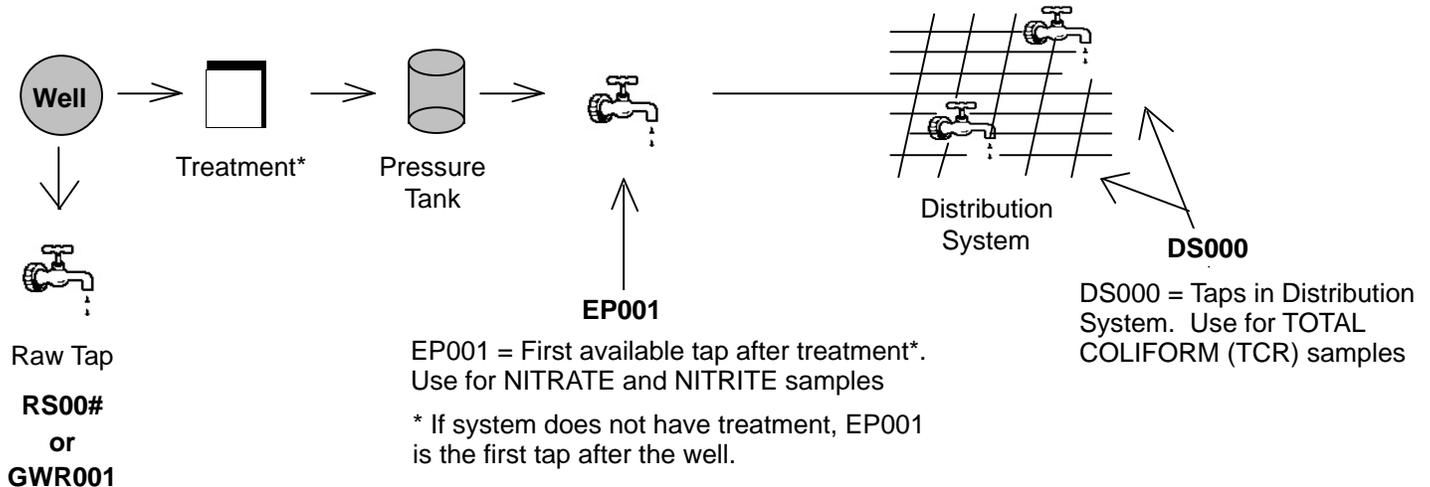

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5045912 BOARDMAN PARK-MAIN WELL PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: BOARDMAN PARK-MAIN WELL DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5056102	Facility Name: BOARDMAN PARK MAIN WELL	
Location SMP ID: EP001	Facility Source: Ground Water	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

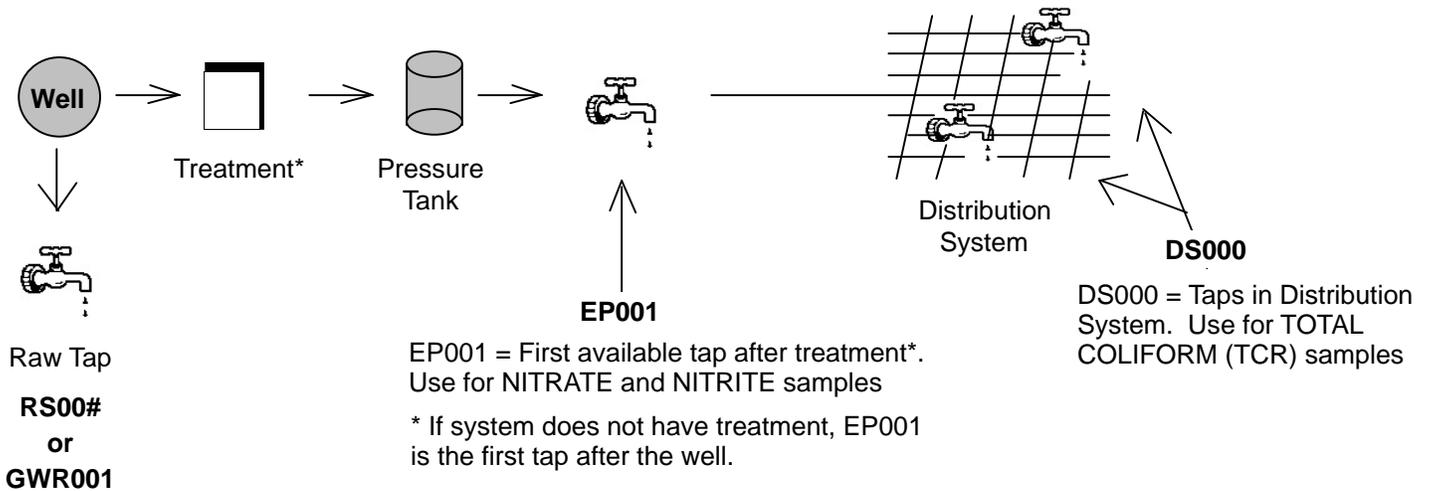

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5046212 FLYING B GOLF COURSE

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: FLYING B GOLF COURSE DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5056105	Facility Name: FLYING B GOLF COURSE
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

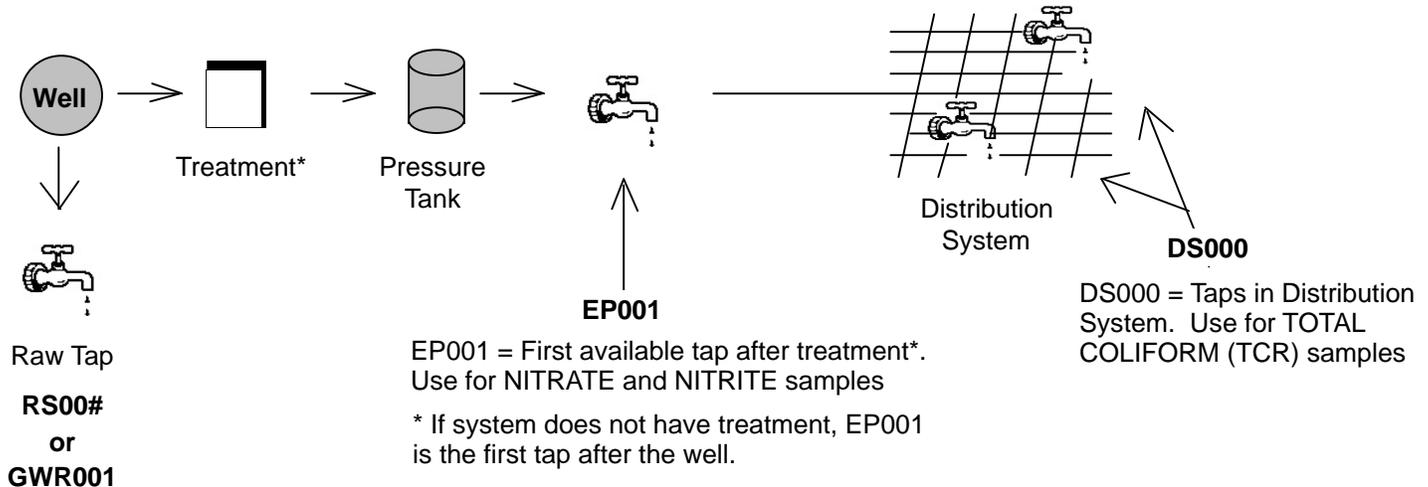

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5046612 LAKE MILTON BAPTIST TEMPLE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **LAKE MILTON BAPTIST TMPL DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056109** Facility Name: **LAKE MILTON BAPTIST TEMPLE**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

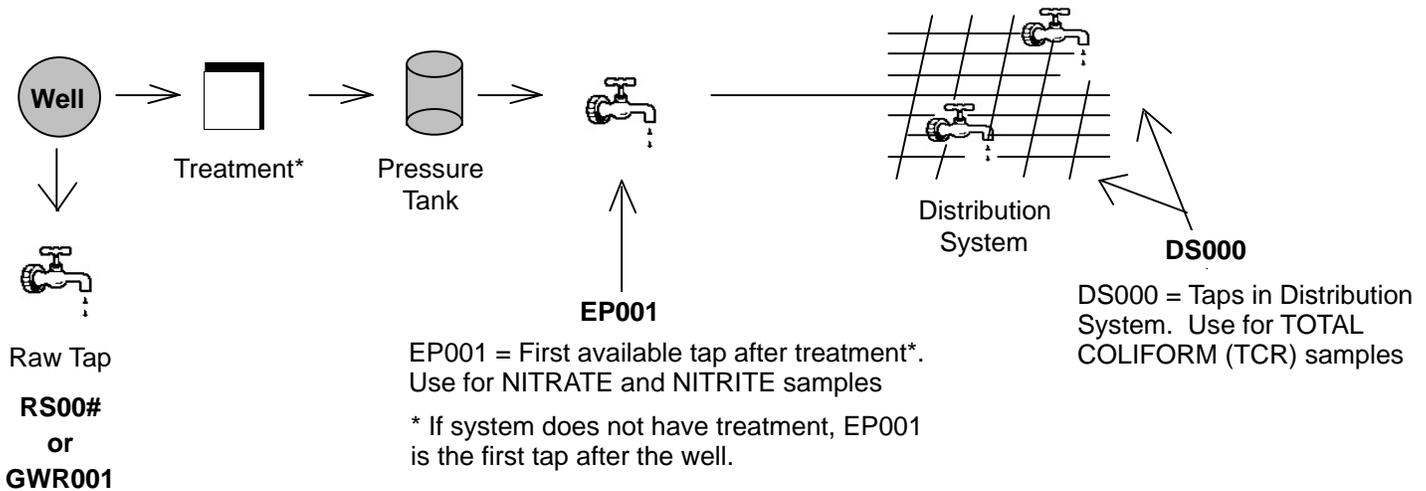

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5046912 NORTH BENTON UNITED PRESBYTERIAN CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **N BENTON UN PRESBYTERIAN DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056112** Facility Name: **N BENTON UN PRESBYTERIAN CHURC**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

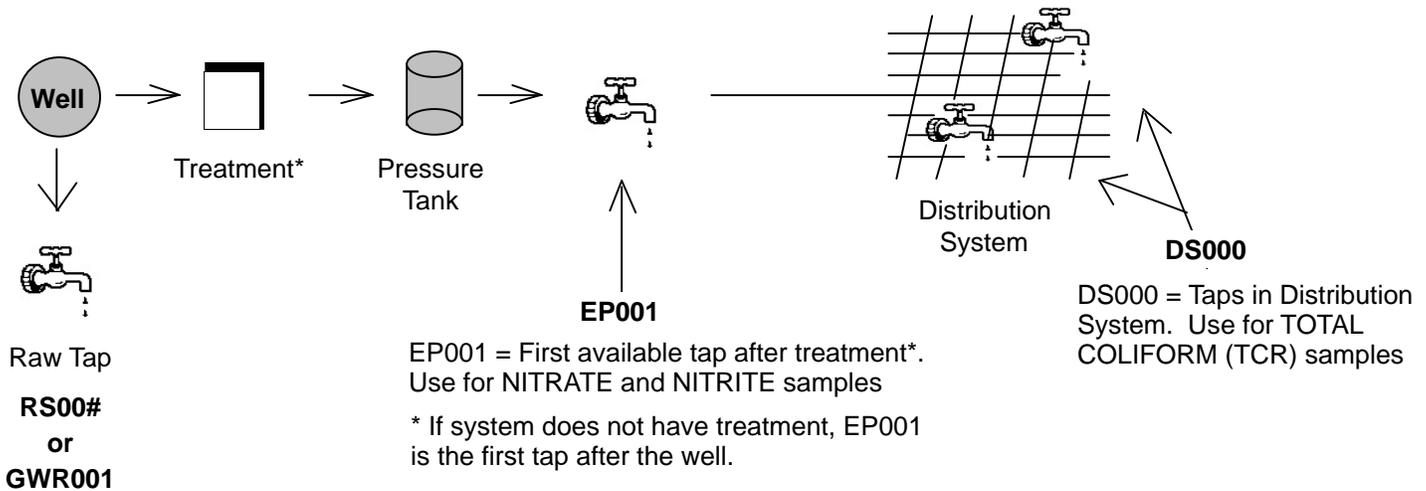

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5047012 BUNKER HILL METHODIST CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: BUNKER HILL METHODIST CH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5056113	Facility Name: BUNKER HILL METHODIST CHURCH
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

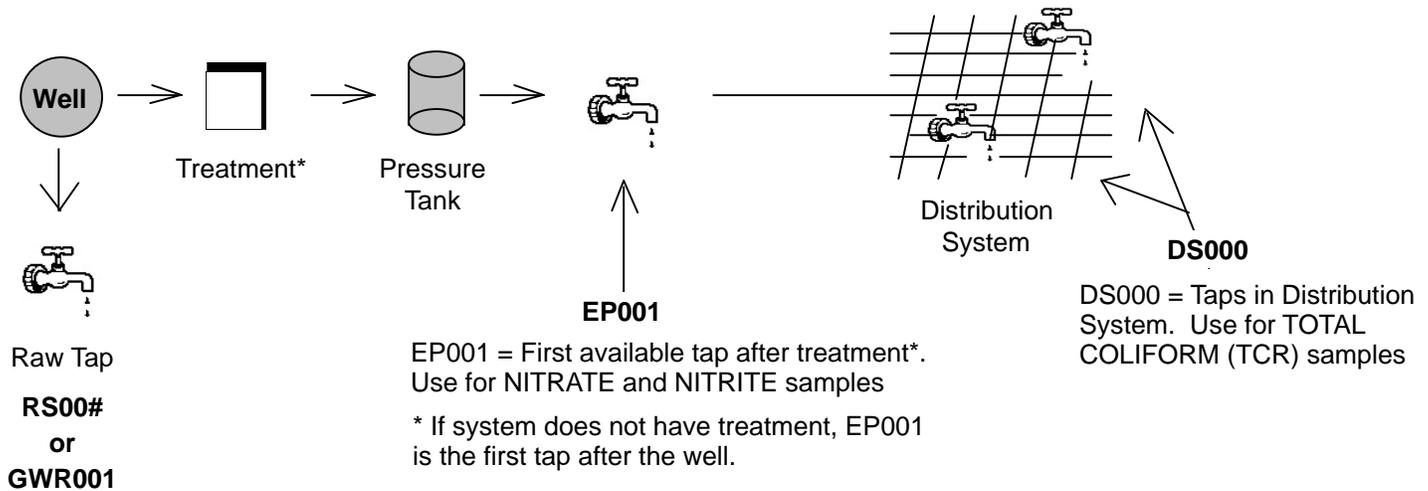

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5047112 GREENFORD CHRISTIAN CHURCH (BLDGS A & B)

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: GREENFORD CHRISTIAN CH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5056114	Facility Name: GREENFORD CHRISTIAN CHURCH (BLDGS A & B)
Location SMP ID: EP001	Facility Source: Ground Water Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

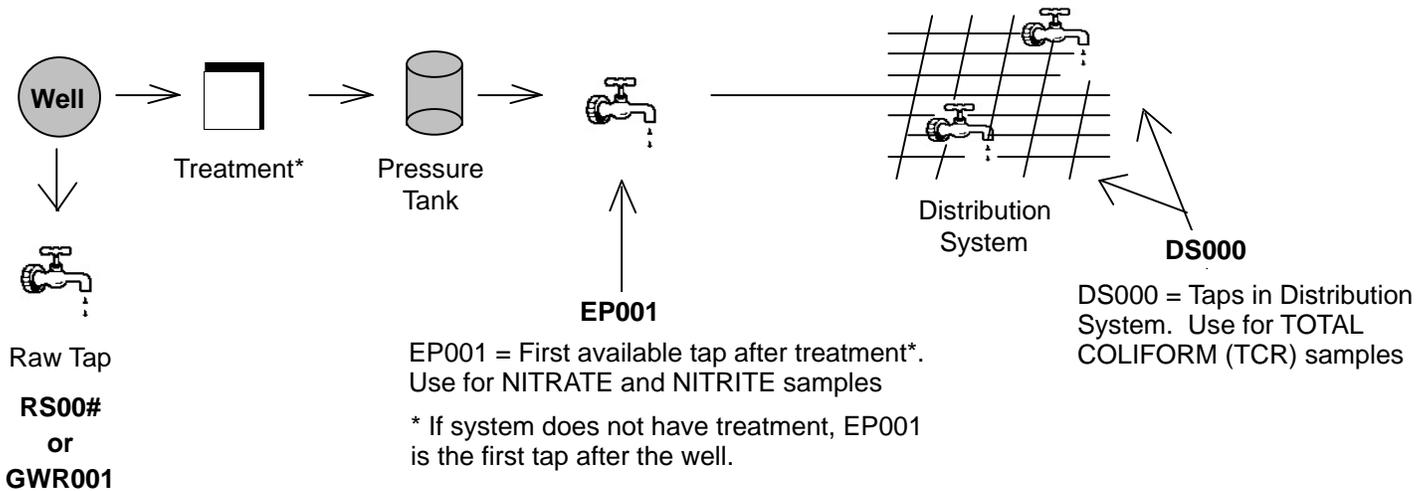

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5047712 PARADISE UNITED CHURCH OF CHRIST

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: PARADISE UN CH OF CHRIST DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5056120	Facility Name: PARADISE UN CHURCH OF CHRIST
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

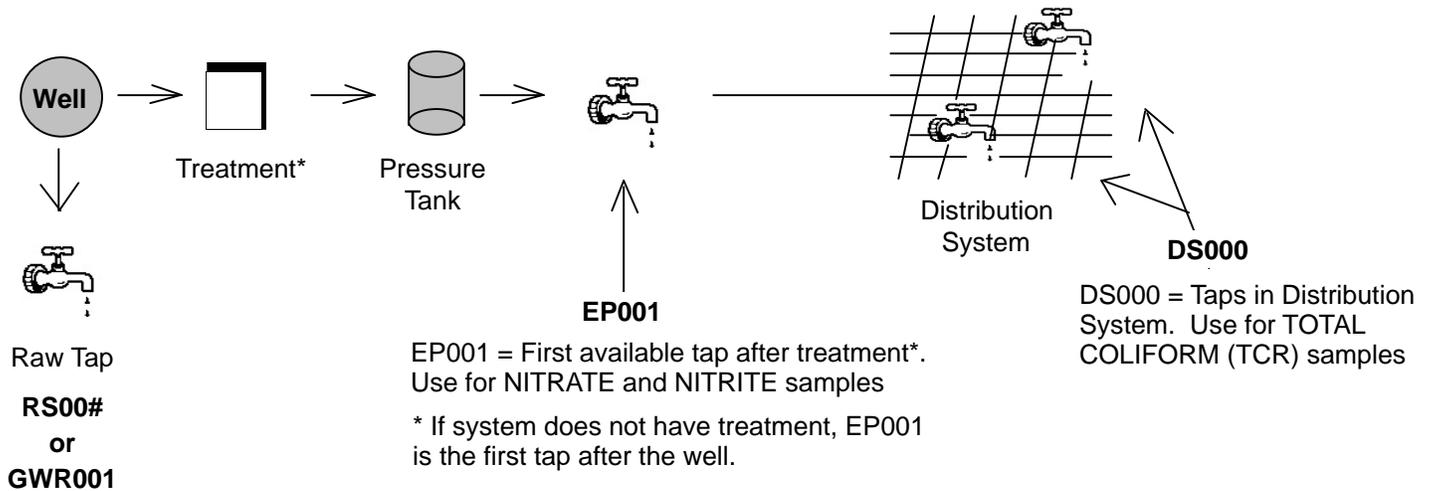

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5047812 LOCUST GROVE BAPTIST CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: LOCUST GROVE BAPTIST CH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5056121	Facility Name: LOCUST GROVE BAPTIST CHURCH
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

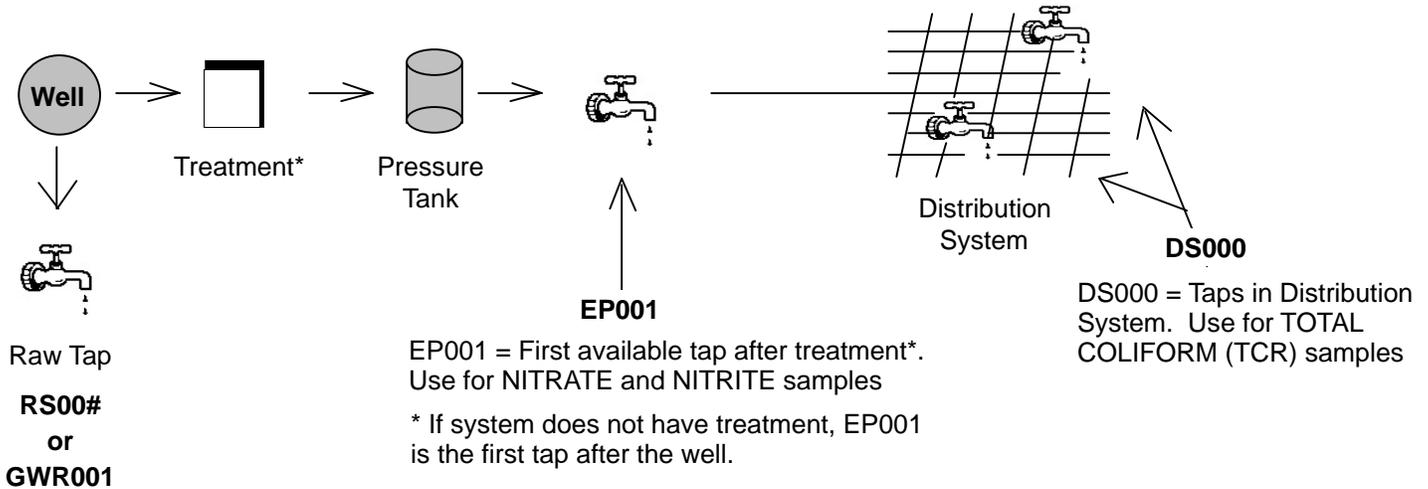

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5048112 ZION HILL CHURCH OF THE BRETHREN

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **ZION HILL CHURCH O/T BRETHREN**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056123** Facility Name: **ZION HILL CHURCH O/T BRETHREN**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

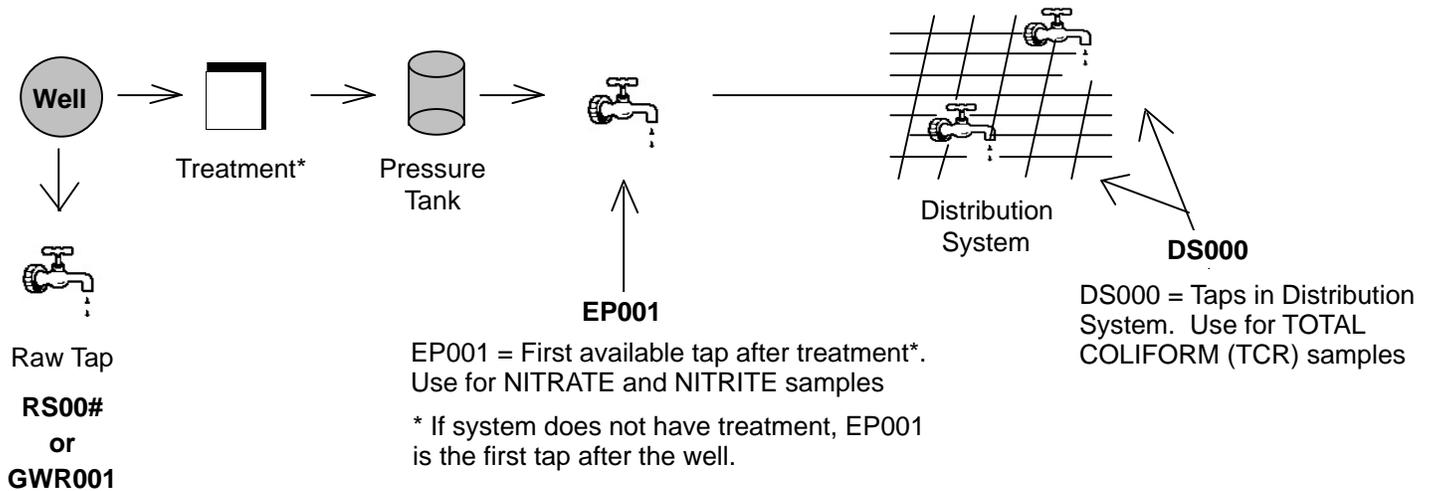

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5048612 EAST GOSHEN FRIENDS CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: EAST GOSHEN FRIENDS CH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5056127	Facility Name: EAST GOSHEN FRIENDS CHURCH
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

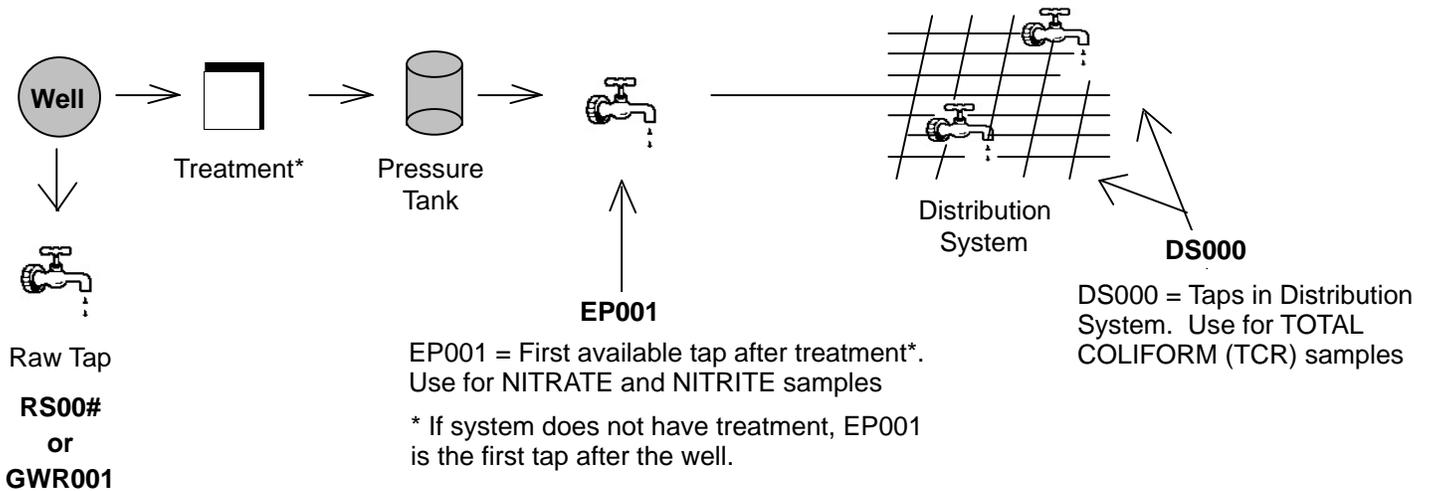

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5048812 HERITAGE BAPTIST CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HERITAGE BAPTIST CHURCH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5056129	Facility Name: HERITAGE BAPTIST CHURCH
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

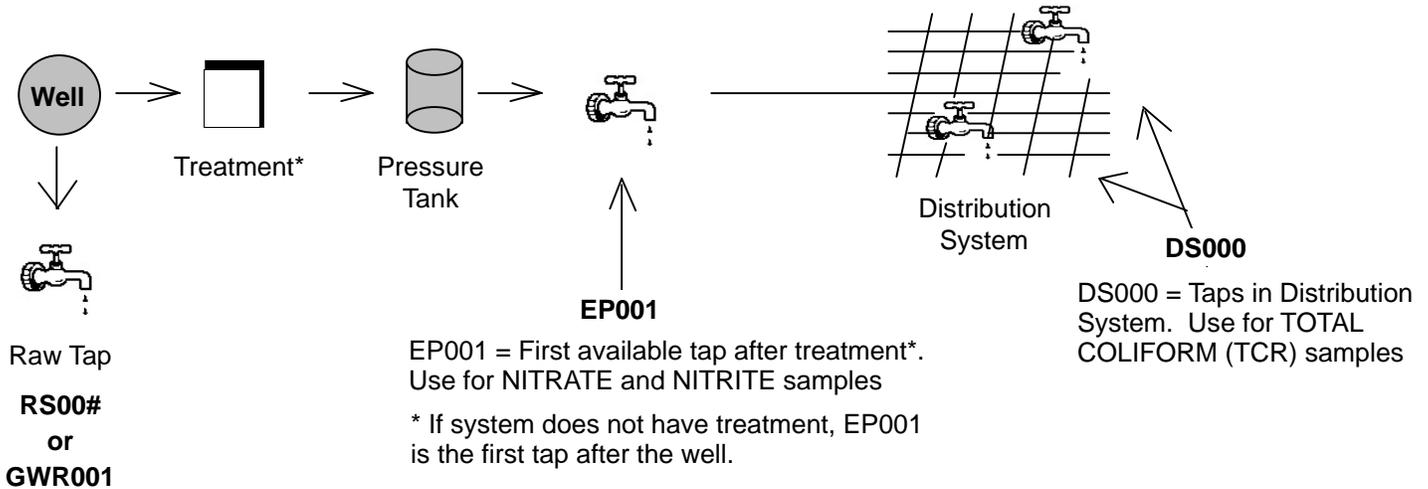

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5049312 BERLIN CENTER UNITED METHODIST CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: BERLIN CENTER UN METHODI DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5056132	Facility Name: BERLIN CENTER UN METHODIST CHURCH
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

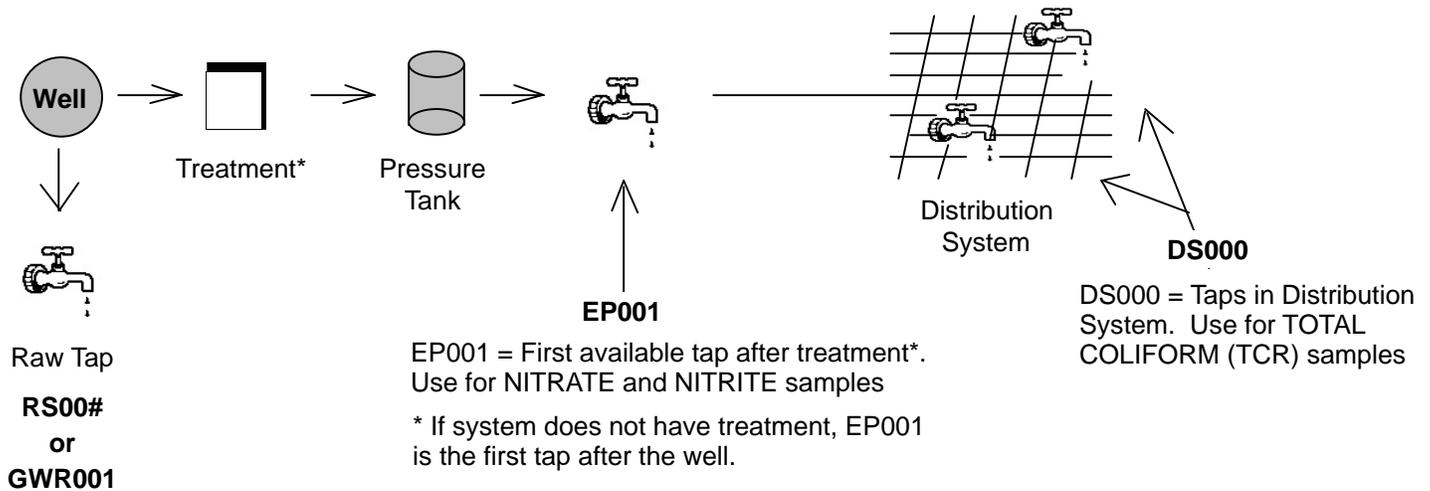

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH5049912 GREENFORD CHRISTIAN LIFE CENTER (C, D,E)

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: GREENFORD CHRISTIAN LIFE DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2015 and 1/31/2015
	2 Sample(s) Required between 2/1/2015 and 2/28/2015
	2 Sample(s) Required between 3/1/2015 and 3/31/2015
	2 Sample(s) Required between 4/1/2015 and 4/30/2015
	2 Sample(s) Required between 5/1/2015 and 5/31/2015
	2 Sample(s) Required between 6/1/2015 and 6/30/2015
	2 Sample(s) Required between 7/1/2015 and 7/31/2015
	2 Sample(s) Required between 8/1/2015 and 8/31/2015
	2 Sample(s) Required between 9/1/2015 and 9/30/2015
	2 Sample(s) Required between 10/1/2015 and 10/31/2015
	2 Sample(s) Required between 11/1/2015 and 11/30/2015
	2 Sample(s) Required between 12/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5056136	Facility Name: GREENFORD CHRISTIAN LIFE CENTER (C,D,E)
Location SMP ID: EP001	Facility Source: Ground Water Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required

OH5049912 GREENFORD CHRISTIAN LIFE CENTER (C, D,E)

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5056136	Facility Name: GREENFORD CHRISTIAN LIFE CENTER (C,D,E)
Location SMP ID: EP001	Facility Source: Ground Water
	Facility Class: CLASS A

Chemicals	Monitoring Requirements
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

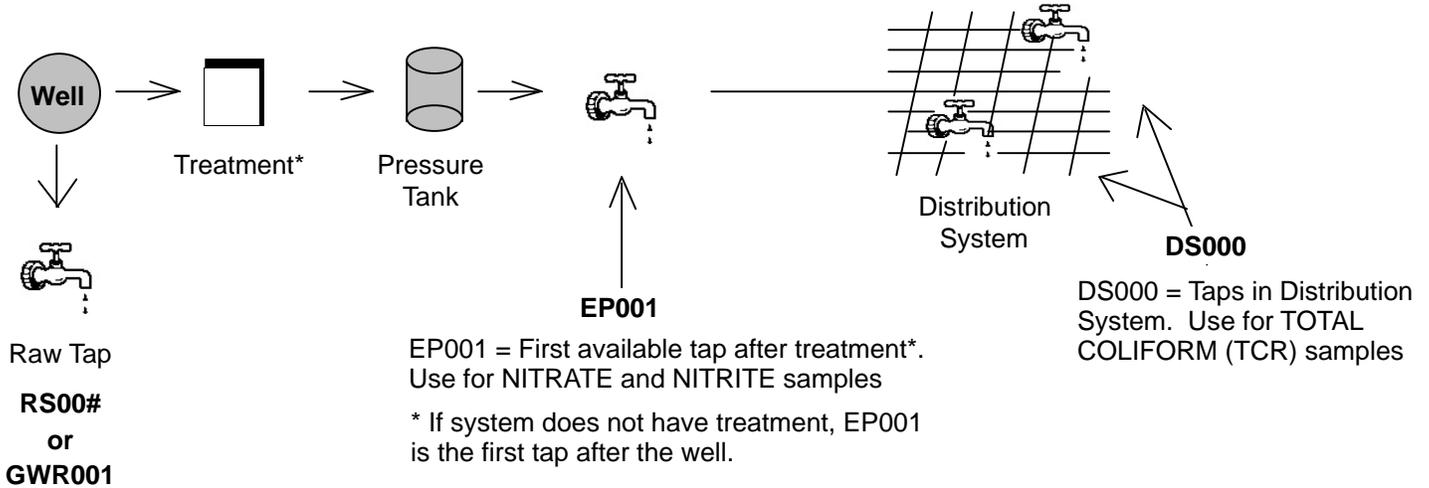

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5050012 ELLSWORTH PRESBYTERIAN CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **ELLSWORTH PRESBYTERIAN C DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056137** Facility Name: **ELLSWORTH PRESBYTERIAN CHURCH**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

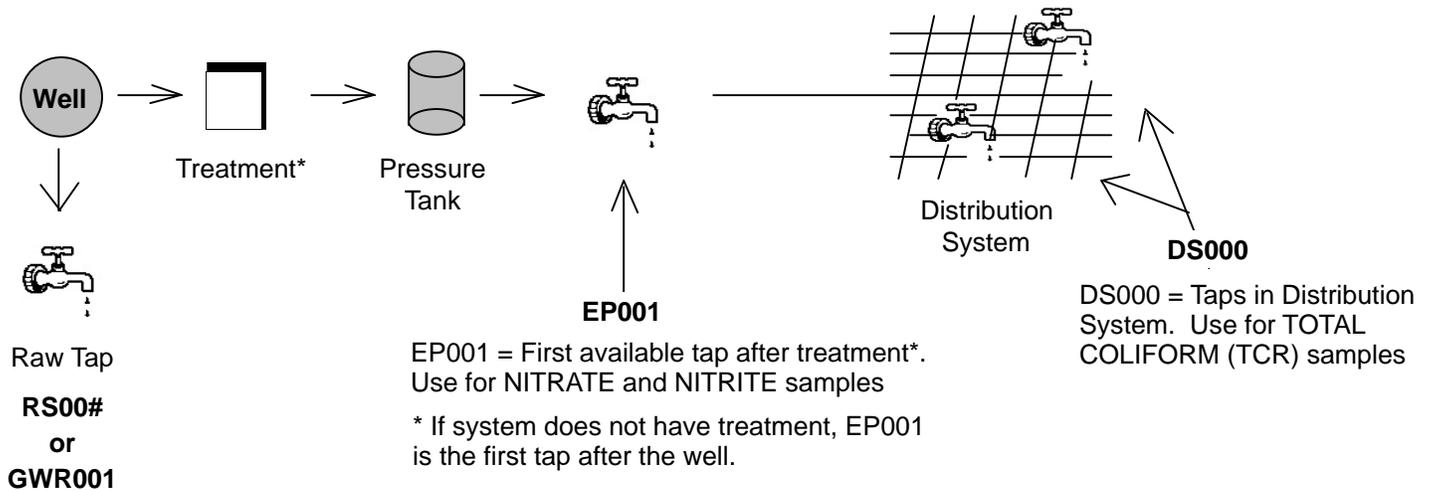

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH5050112 LINDE HYDRAULICS, CORP.

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5056138	Facility Name: LINDE HYDRAULICS CORP	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

ARSENIC - 1005	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

INORGANICS	1 Sample(s) Required between 6/1/2015 and 10/31/2015
------------	--

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1015 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024
FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015
----------------	--

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
---	--------------

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 7/1/2015 and 9/30/2015
----------------------------------	---

OH5050112 LINDE HYDRAULICS, CORP.

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: LINDE HYDRAULICS, CORP. DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015
TOTAL CHLORINE - 1000	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: LINDE HYDRAULICS, CORP. DISTRIBUTION
	SMP ID: DS201	ADDRESS NOT KNOWN

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH5050211 SOCIETY OF ST PAUL

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **SOCIETY OF ST PAUL DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056139** Facility Name: **PIOUS SOCIETY OF ST PAUL**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

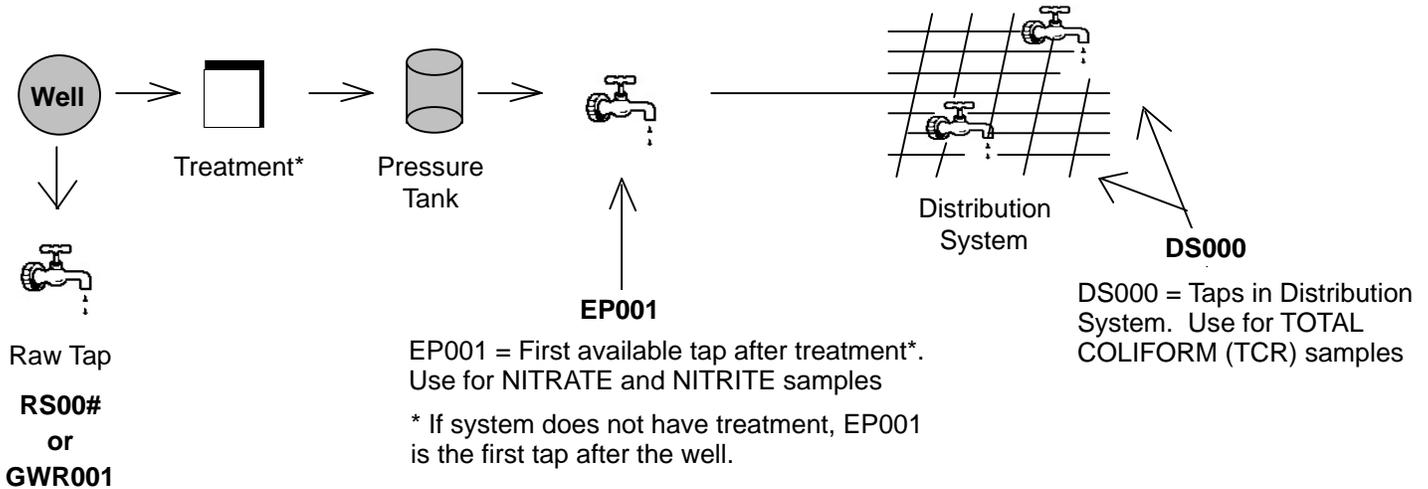

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5050612 OLD SPRINGFLD UNITED CHURCH OF CHRIST

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: OLD SPRINGFLD CH OF CHR DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5056142	Facility Name: OLD SPRINGFLD UN CHURCH OF CHRIST
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

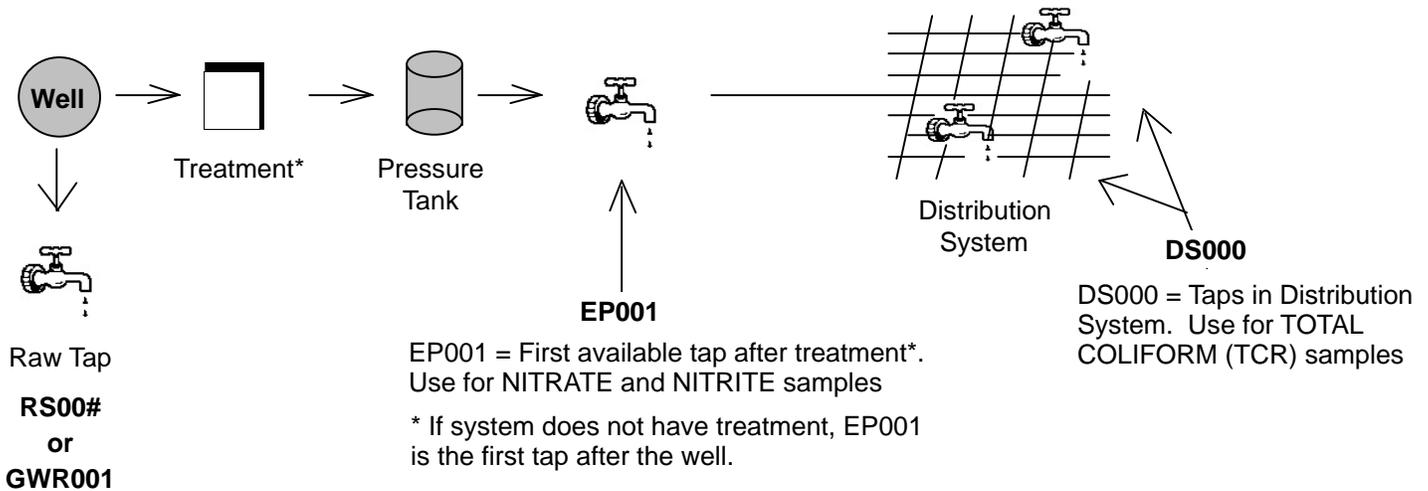

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5051012 BISTRO 62 PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **BISTRO 62 DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056145** Facility Name: **BISTRO 62 TP**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

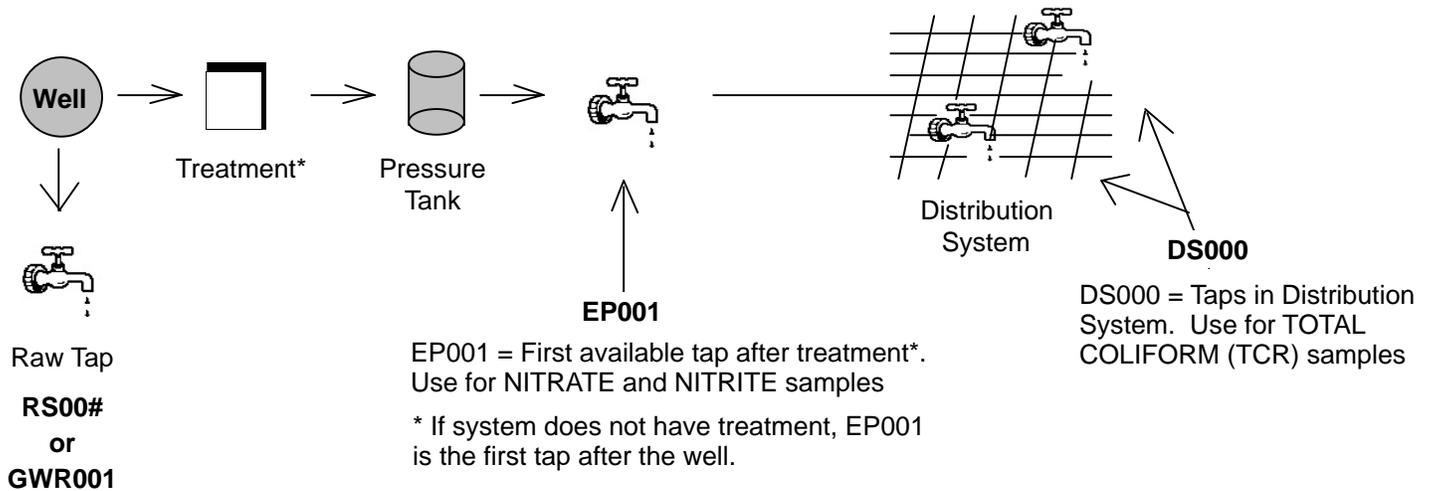

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5051412 SALEM HILLS GOLF AND CC

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **SALEM HILLS COUNTRY CLUB DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056149** Facility Name: **SALEM HILLS COUNTRY CLUB**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

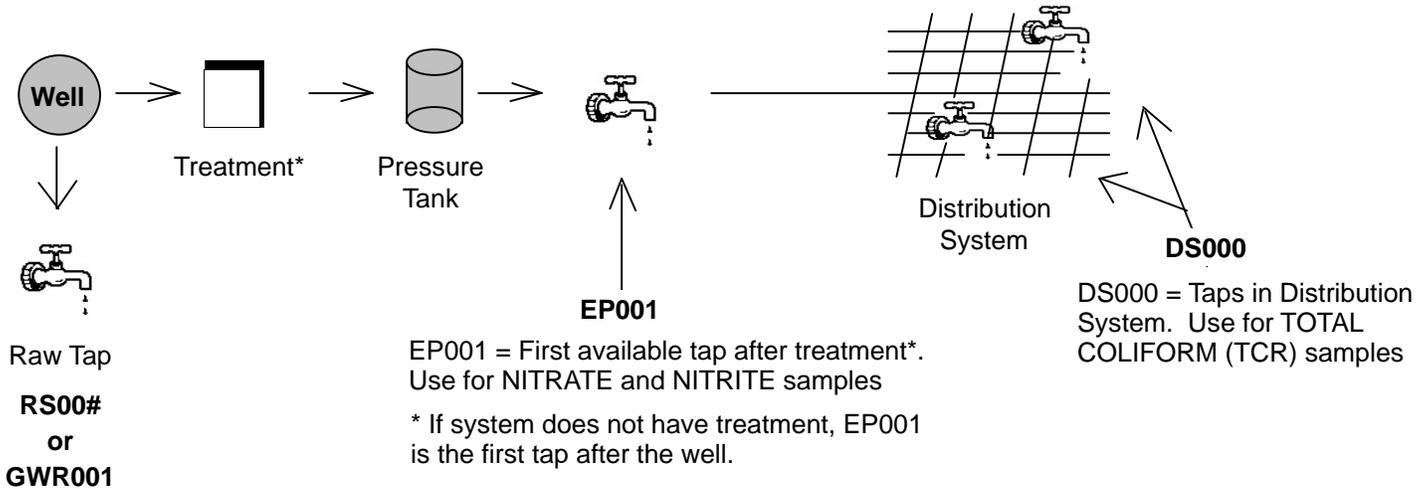

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5051512 CAMP STAMBAUGH BSA PARKING

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CAMP STAMBAUGH BSA PARKI DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5056150	Facility Name: CAMP STAMBAUGH BSA PARKING LOT
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

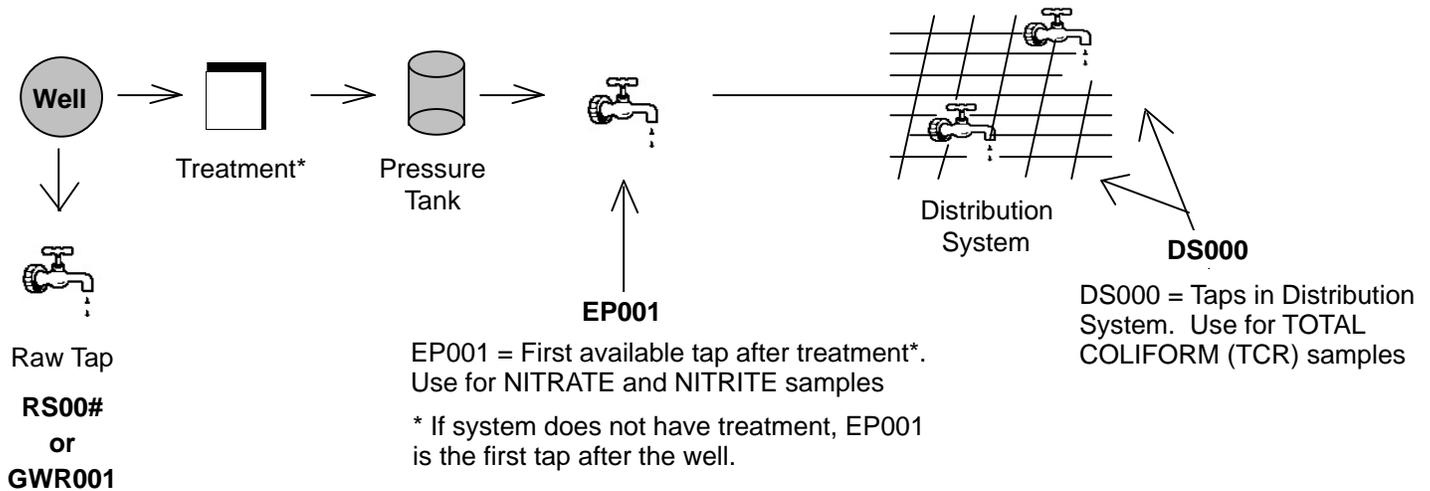

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

OH5051812 NASHBAR DIRECT PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5056153	Facility Name: BIKE NASHBAR	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2015 and 10/31/2015

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 6/1/2015 and 10/31/2015

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 Not Required

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2015 and 10/31/2015



OH5051912 TIP PLUS CORP PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5056154	Facility Name: TIP PLUS CORP	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

ARSENIC - 1005	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

INORGANICS	1 Sample(s) Required between 6/1/2015 and 10/31/2015
------------	--

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1015 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024
FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015
----------------	--

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
---	--------------

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2015 and 10/31/2015
----------------------------------	--



Effective Date: 01/01/2015

2015 DISTRIBUTION SCHEDULE

OH5051912 TIP PLUS CORP PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: TIP PLUS CORP DISTRIBUTION
	SMP ID: DS000	

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2015 and 9/30/2015

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2015	and	3/31/2015
	1 Sample(s) Required between	4/1/2015	and	6/30/2015
	1 Sample(s) Required between	7/1/2015	and	9/30/2015
	1 Sample(s) Required between	10/1/2015	and	12/31/2015

OH5052012 VICTORY CHRISTIAN CENTER ADMIN BLDG PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **VICTORY CHRISTIAN CENTER ADMIN BLDG DIST**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056155** Facility Name: **VICTORY ASSEMBLY ADMIN BLDG**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

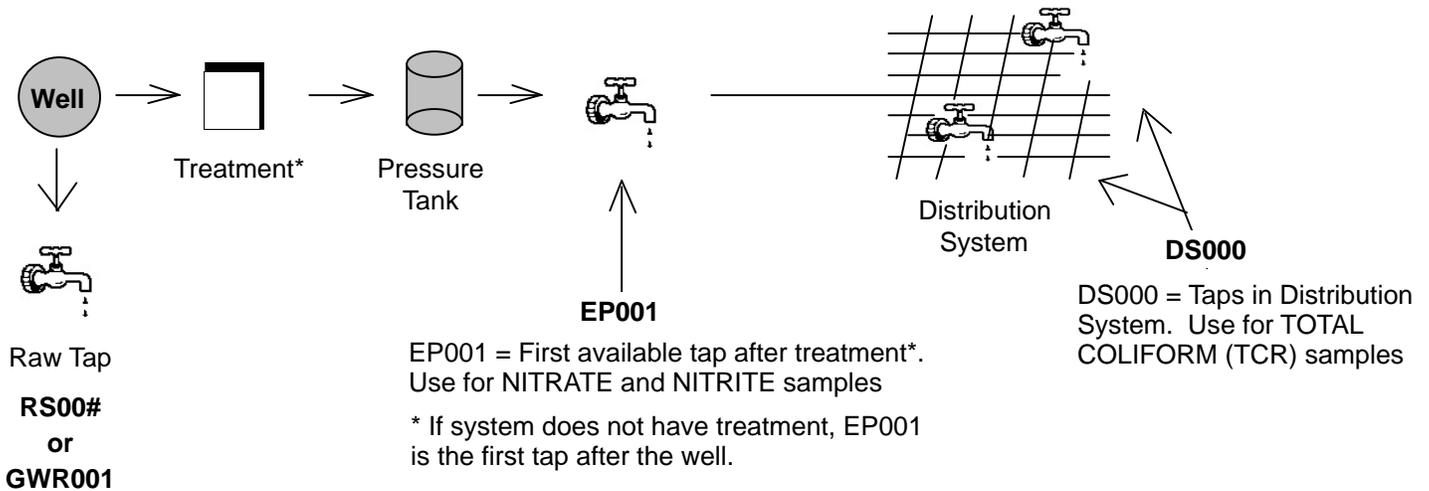

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5052212 COMMON GROUND CHURCH COMMUNITY

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **COMMON GROUND CHURCH COMMUNITY DS**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056157** Facility Name: **COMMON GROUND CHURCH COMMUNITY TP**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 6/1/2015 and 10/31/2015
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

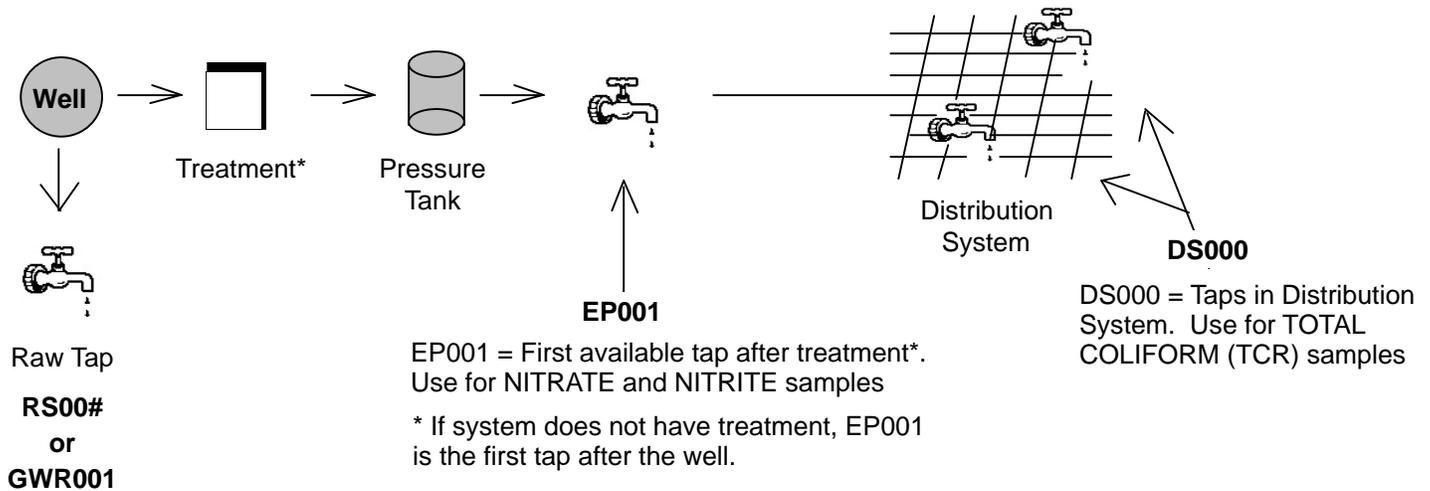

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5052312 COMMUNITY BIBLE CHURCH - BELOIT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **COMMUNITY BIBLE CHURCH - BELOIT DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5056158** Facility Name: **COMMUNITY BIBLE CHURCH**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

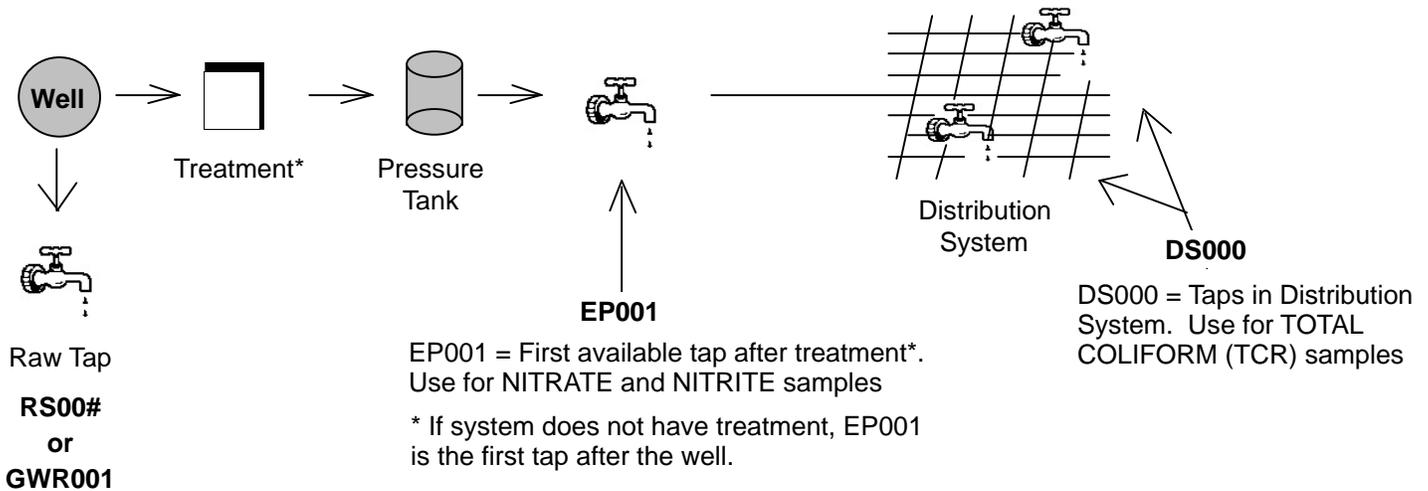

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5052412 MIDWAY MENNONITE CHURCH

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: MIDWAY MENNONITE CHURCH DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5056159	Facility Name: MIDWAY MENNONITE CHURCH
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

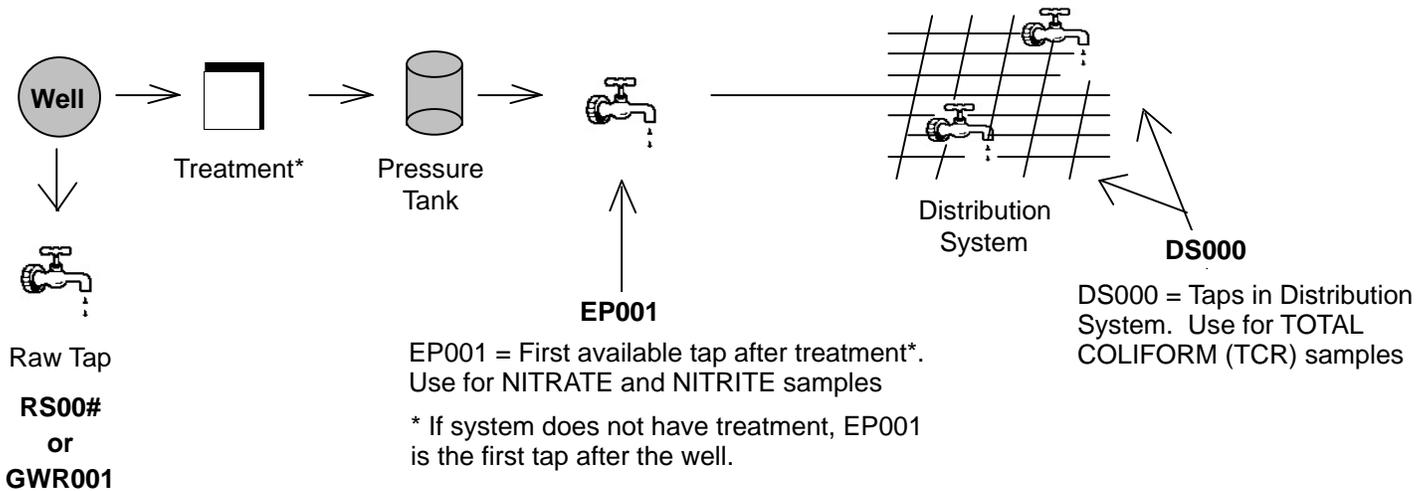

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

OH5052512 BAIRD BROTHERS SAWMILL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5056160	Facility Name: BAIRD BROTHERS SAWMILL INC	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2015 and 10/31/2015

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 6/1/2015 and 10/31/2015

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 Not Required

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 7/1/2015 and 9/30/2015

OH5052712 YOUNGSTOWN-ELSER AIRPORT

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: YOUNGSTOWN-ELSER AIRPORT DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5056162	Facility Name: YOUNGSTOWN-ELSER AIRPORT
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

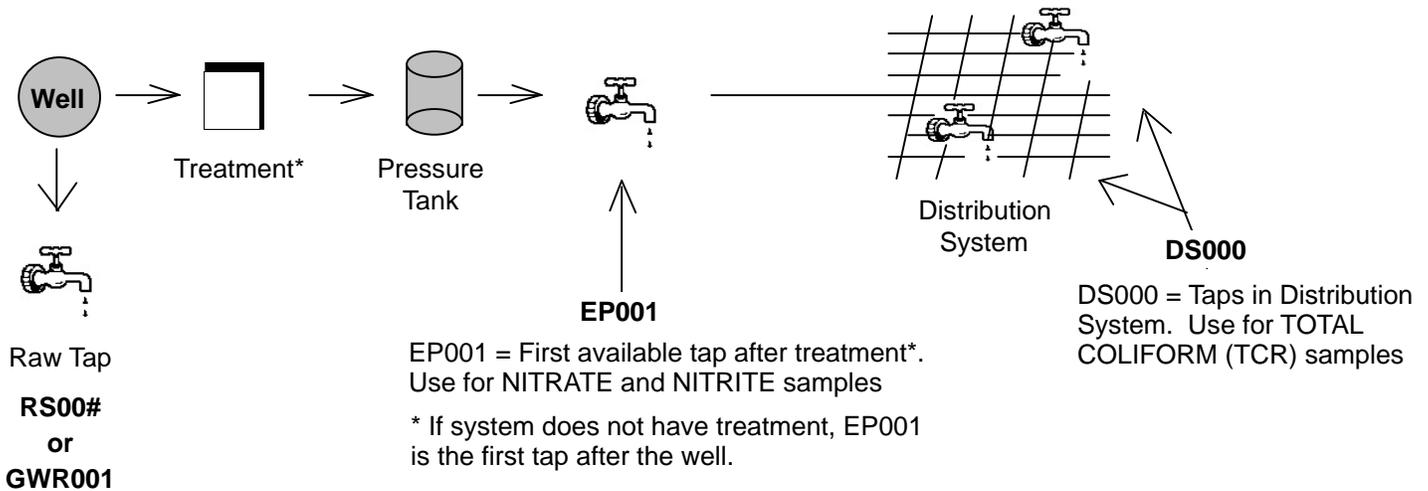

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5053412 CHRISTIAN LIFE CENTER PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: CHRISTIAN LIFE CENTER DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5060925	Facility Name: CHRISTIAN LIFE CENTER
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

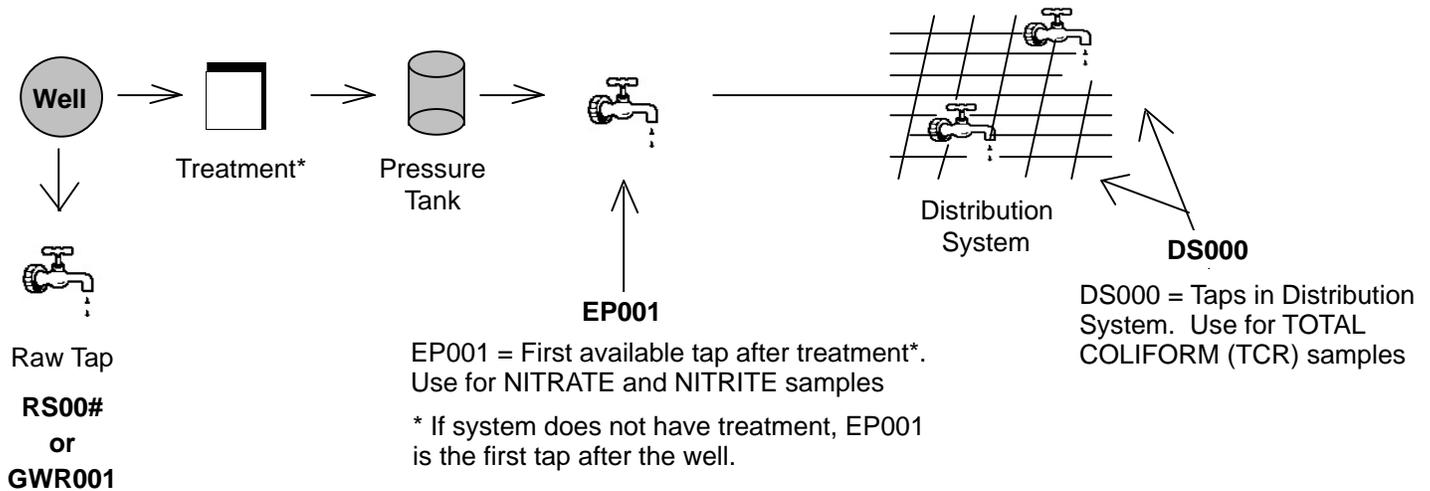

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5053612 HOWARD HANNA BLDG PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **HOWARD HANNA BLDG DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5061145** Facility Name: **HOWARD HANNA BLDG**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

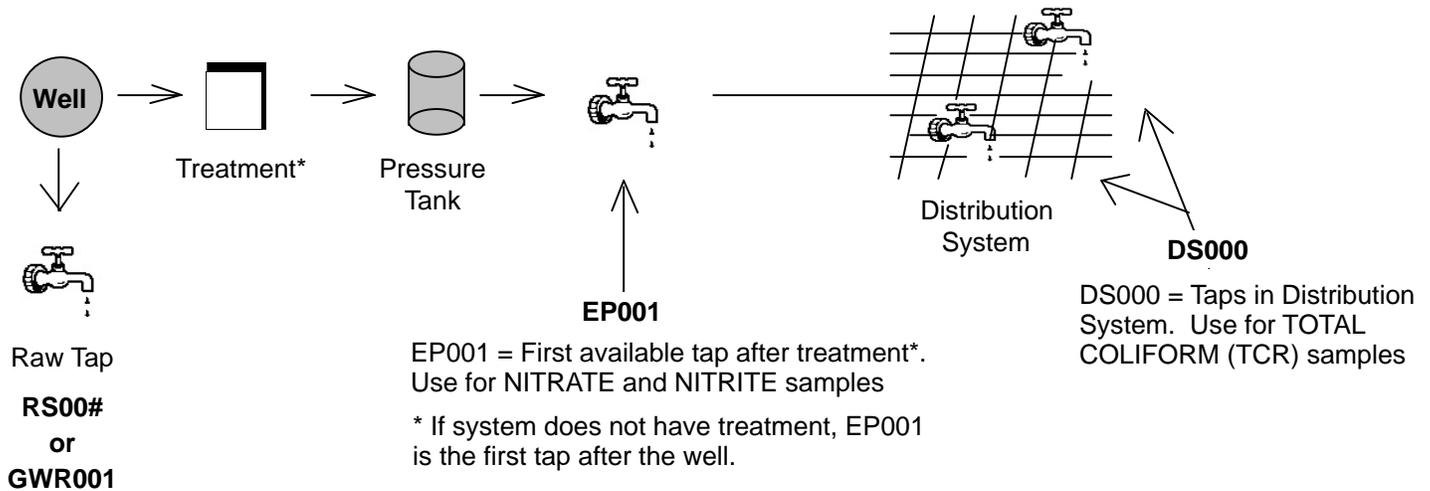

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5053912 HIGH POINTE ASSEMBLY OF GOD PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **HIGH POINTE AOG DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5061633** Facility Name: **HIGH POINTE ASSEMBLY OF GOD**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

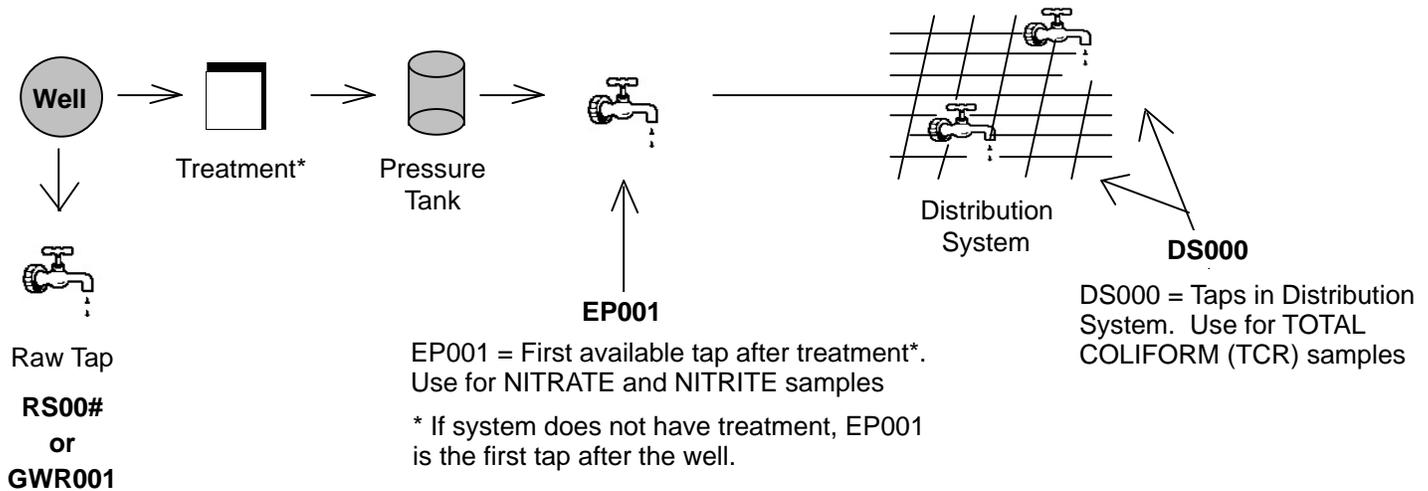

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5054012 MASTROPIETRO WINERY PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: MASTROPIETRO WINERY DISTRIBUTION
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5061707	Facility Name: MASTROPIETRO WINERY
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

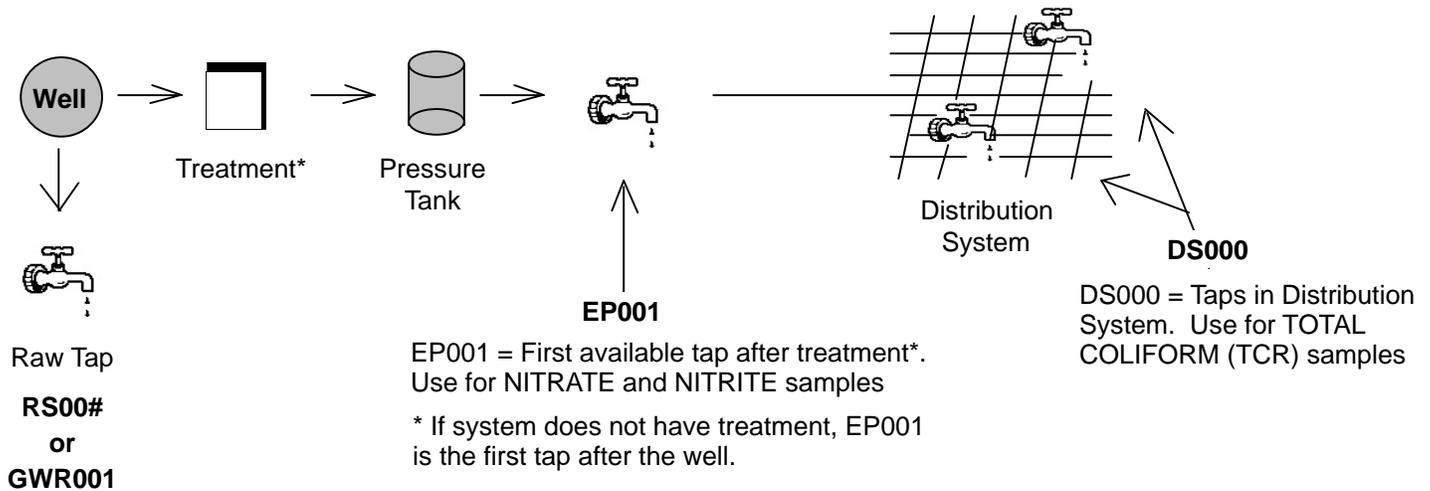

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

OH5054112 DAMASCUS ELEMENTARY PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5061899	Facility Name: DAMASCUS ELEMENTARY	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2015 and 10/31/2015

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 6/1/2015 and 10/31/2015

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 Not Required

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 7/1/2015 and 9/30/2015



OH5054112 DAMASCUS ELEMENTARY PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **DAMASCUS ELEM DISTRIBUTION**
Location SMP ID: **DS000**

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2015 and 9/30/2015

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

TOTAL COLIFORM (TCR) - 3100
1 Sample(s) Required between 1/1/2015 and 3/31/2015
1 Sample(s) Required between 4/1/2015 and 6/30/2015
1 Sample(s) Required between 7/1/2015 and 9/30/2015
1 Sample(s) Required between 10/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000
1 Sample(s) Required between 1/1/2015 and 3/31/2015
1 Sample(s) Required between 4/1/2015 and 6/30/2015
1 Sample(s) Required between 7/1/2015 and 9/30/2015
1 Sample(s) Required between 10/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Facility ID: **DS1** Facility Name: **DAMASCUS ELEM DISTRIBUTION**
Location SMP ID: **DS201** ADDRESS NOT KNOWN

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH5054212 JACKSON/MILTON SERVICE AREA PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

Table with 4 columns: Sampling Location, Facility ID, Facility Name, Facility Class. Values: DS1, JACKSON/MILTON SERVICE AREA DISTRIBU, CLASS 1, DS000.

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

ASBESTOS - 1094 Not Required

TOTAL COLIFORM (TCR) - 3100 4 Sample(s) Required between 1/1/2015 and 1/31/2015 ... 4 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000 4 Sample(s) Required between 1/1/2015 and 1/31/2015 ... 4 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Table with 4 columns: Sampling Location, Facility ID, Facility Name, Facility Class. Values: DS201, 5TH SEASON RESTAURANT, 7098 M, CLASS 1.

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 1/1/2015 and 1/7/2015 at SMP: DS201 ... 1 Sample(s) Required between 10/1/2015 and 10/7/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



Effective Date: 01/16/2015

2015 DISTRIBUTION SCHEDULE

OH5054212 JACKSON/MILTON SERVICE AREA PWS

System Type: Community

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: JACKSON/MILTON SERVICE AREA DISTRIBU 425 FOREST AVENUE	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements		
DISINFECTION BYPRODUCTS	1 Sample(s) Required between	1/1/2015 and	1/7/2015 at SMP: DS202
	1 Sample(s) Required between	4/1/2015 and	4/7/2015 at SMP: DS202
	1 Sample(s) Required between	7/1/2015 and	7/7/2015 at SMP: DS202
	1 Sample(s) Required between	10/1/2015 and	10/7/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH5054312 SKYLINE DINER PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **SKYLINE DINER DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5062014** Facility Name: **SKYLINE DINER**
Location SMP ID: **EP001** Facility Source:

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

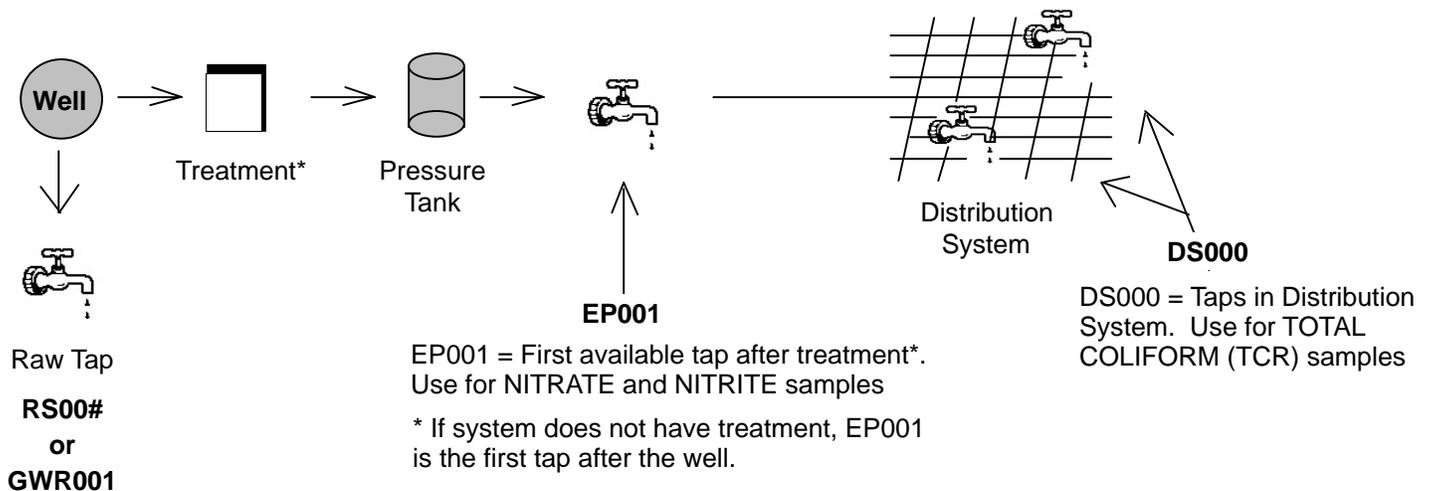

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

OH5054412 PURPLE CAT DAY HABILITATION CENTER

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5062147	Facility Name: DAY HABILITATION CENTER	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2015 and 10/31/2015

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 6/1/2015 and 10/31/2015

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 6/1/2015 and 10/31/2015

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2015 and 10/31/2015



Effective Date: 01/01/2015

2015 DISTRIBUTION SCHEDULE

OH5054412 PURPLE CAT DAY HABILITATION CENTER

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: DAY HABILITATION CENTER DISTRIBUTION
	SMP ID: DS000	

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

OH5054512 ELLSWORTH TOWNSHIP PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: ELLSWORTH TOWNSHIP DISTRIBUTION
Location SMP ID: DS000	Facility Source: Surface Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5062151	Facility Name: ELLSWORTH TOWNSHIP
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 6/1/2015 and 10/31/2015
NITRATE - 1040	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

Where to Collect Samples For a Small Public Water System

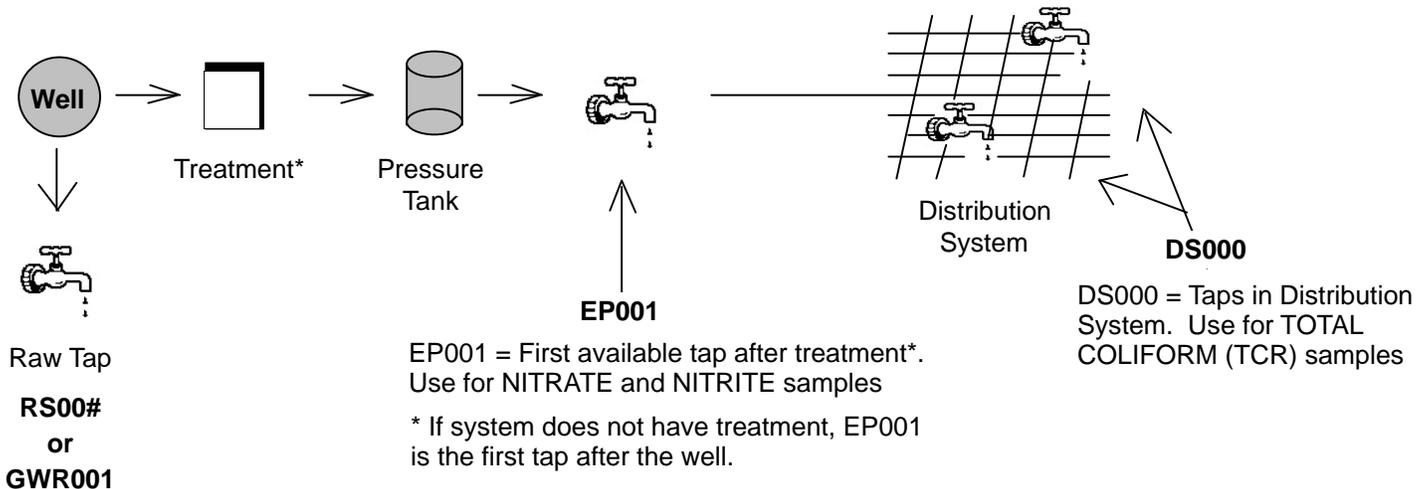

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

OH5054712 SOUTH RANGE LOCAL SCHOOL K-12 PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5062258	Facility Name: SOUTH RANGE LOCAL SCHOOL K-12	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2015 and 10/31/2015

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 6/1/2015 and 10/31/2015

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 Not Required

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2015 and 10/31/2015



OH5054712 SOUTH RANGE LOCAL SCHOOL K-12 PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: SOUTH RANGE LOCAL SCHOOL K-12 DIST
	SMP ID: DS000	

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	20 Sample(s) Required between 1/1/2015 and 6/30/2015
	20 Sample(s) Required between 7/1/2015 and 12/31/2015

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2015 and 1/31/2015
	2 Sample(s) Required between 2/1/2015 and 2/28/2015
	2 Sample(s) Required between 3/1/2015 and 3/31/2015
	2 Sample(s) Required between 4/1/2015 and 4/30/2015
	2 Sample(s) Required between 5/1/2015 and 5/31/2015
	2 Sample(s) Required between 6/1/2015 and 6/30/2015
	2 Sample(s) Required between 7/1/2015 and 7/31/2015
	2 Sample(s) Required between 8/1/2015 and 8/31/2015
	2 Sample(s) Required between 9/1/2015 and 9/30/2015
	2 Sample(s) Required between 10/1/2015 and 10/31/2015
	2 Sample(s) Required between 11/1/2015 and 11/30/2015
	2 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2015 and 1/31/2015
	2 Sample(s) Required between 2/1/2015 and 2/28/2015
	2 Sample(s) Required between 3/1/2015 and 3/31/2015
	2 Sample(s) Required between 4/1/2015 and 4/30/2015
	2 Sample(s) Required between 5/1/2015 and 5/31/2015
	2 Sample(s) Required between 6/1/2015 and 6/30/2015
	2 Sample(s) Required between 7/1/2015 and 7/31/2015
	2 Sample(s) Required between 8/1/2015 and 8/31/2015
	2 Sample(s) Required between 9/1/2015 and 9/30/2015
	2 Sample(s) Required between 10/1/2015 and 10/31/2015
	2 Sample(s) Required between 11/1/2015 and 11/30/2015
	2 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1	Facility Name: SOUTH RANGE LOCAL SCHOOL K-12 DIST
	SMP ID: DS201	ADDRESS NOT KNOWN

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2015

2015 DISTRIBUTION SCHEDULE

OH5054712 SOUTH RANGE LOCAL SCHOOL K-12 PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling	Facility ID: DS1	Facility Name: SOUTH RANGE LOCAL SCHOOL K-12 DIST
Location	SMP ID: DS202	ADDRESS NOT KNOWN

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS

1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH5055012 FAMILY DOLLAR - BELOIT (STORE #9180) PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **FAMILY DOLLAR - BELOIT DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5062270** Facility Name: **FAMILY DOLLAR - BELOIT**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

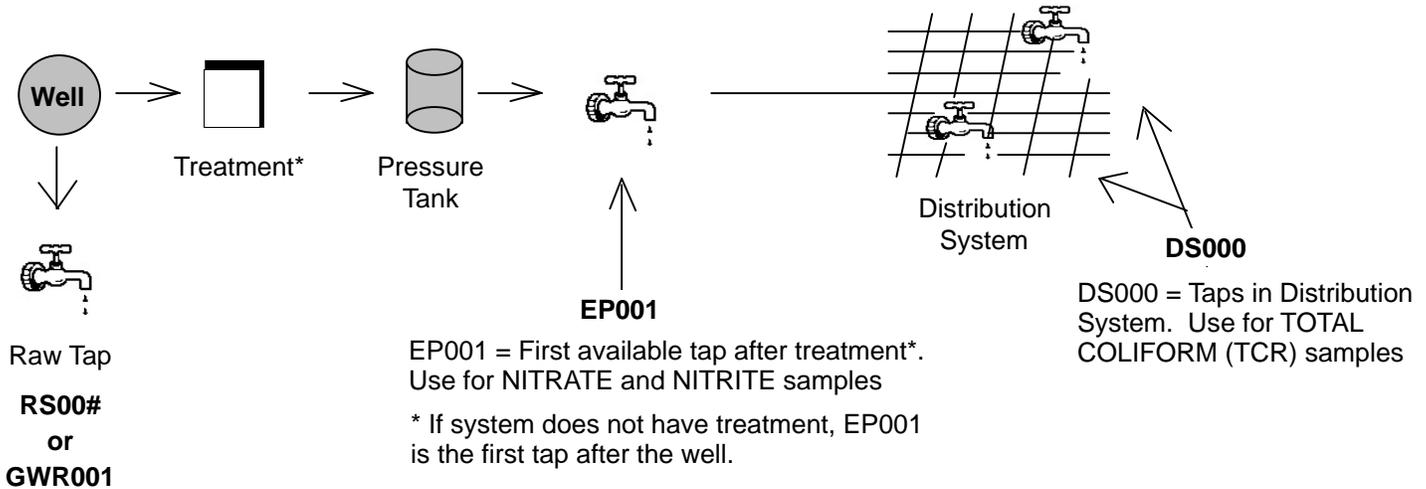

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH5055013 HOLLYWOOD GAMING @ MVRC

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5062271	Facility Name: HOLLYWOOD GAMING @ MVRC	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2015 and 10/31/2015

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 1 Sample(s) Required between 6/1/2015 and 10/31/2015

NITRATE - 1040 1 Sample(s) Required between 6/1/2015 and 10/31/2015

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 6/1/2015 and 10/31/2015

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC)

1 Sample(s) Required between 1/1/2015 and 3/31/2015

1 Sample(s) Required between 4/1/2015 and 6/30/2015

1 Sample(s) Required between 7/1/2015 and 9/30/2015

1 Sample(s) Required between 10/1/2015 and 12/31/2015



OH5055013 HOLLYWOOD GAMING @ MVRC

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: HOLLYWOOD GAMING @ MVRC
	SMP ID: DS000	

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 1/1/2015 and 6/30/2015
	10 Sample(s) Required between 7/1/2015 and 12/31/2015
<i>Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: http://epa.ohio.gov/ddagw/reporting.aspx</i>	
TOTAL COLIFORM (TCR) - 3100	6 Sample(s) Required between 1/1/2015 and 1/31/2015
	6 Sample(s) Required between 2/1/2015 and 2/28/2015
	6 Sample(s) Required between 3/1/2015 and 3/31/2015
	6 Sample(s) Required between 4/1/2015 and 4/30/2015
	6 Sample(s) Required between 5/1/2015 and 5/31/2015
	6 Sample(s) Required between 6/1/2015 and 6/30/2015
	6 Sample(s) Required between 7/1/2015 and 7/31/2015
	6 Sample(s) Required between 8/1/2015 and 8/31/2015
	6 Sample(s) Required between 9/1/2015 and 9/30/2015
	6 Sample(s) Required between 10/1/2015 and 10/31/2015
	6 Sample(s) Required between 11/1/2015 and 11/30/2015
	6 Sample(s) Required between 12/1/2015 and 12/31/2015

OH5055014 KING'S MOTEL - WEST

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5060557** Facility Name: **KING'S MOTEL - WEST PLANT**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

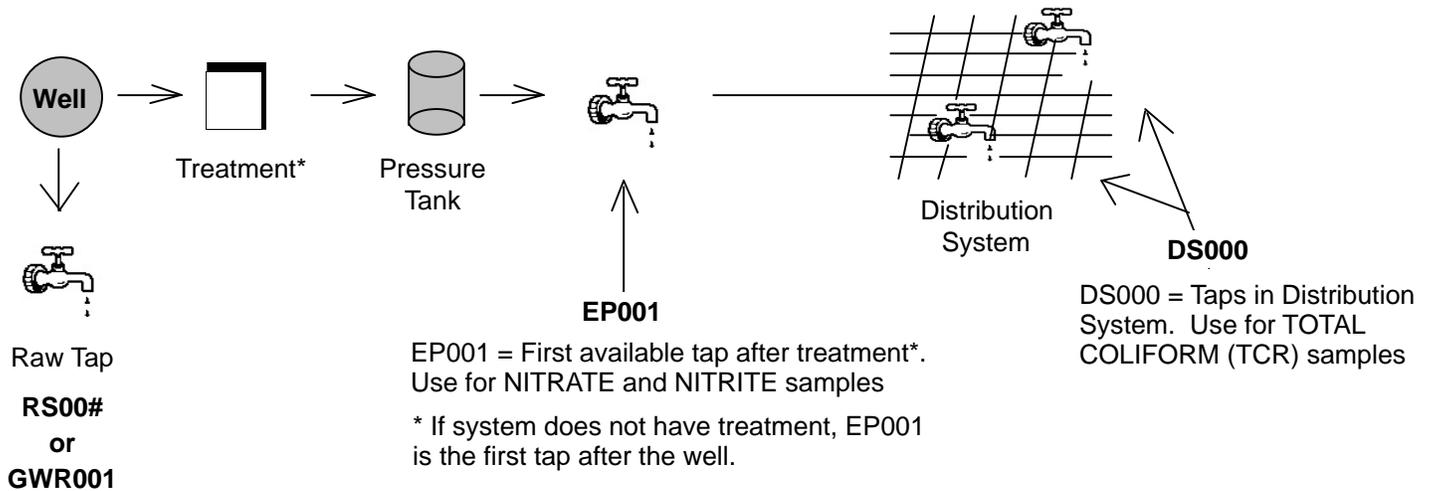

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5055015 CONNECTING POINT CHAPEL PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5062274 Facility Name: **CONNECTING POINT CHAPEL**
Location SMP ID: EP001 Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 6/1/2015 and 10/31/2015
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

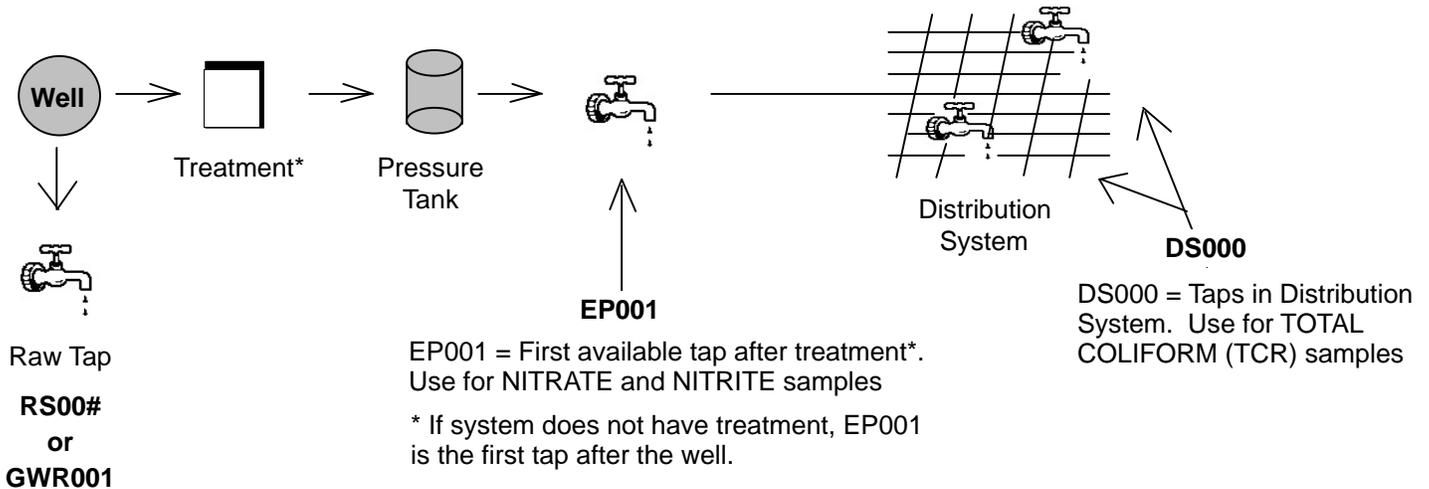

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>

Save a dime. Sample on time!



Effective Date: 08/14/2015

2015 ENTRY POINT SCHEDULE

OH5055016 ANGELS FOR ANIMALS PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5062275	Facility Name: ANGELS FOR ANIMALS
	SMP ID: EP001	Facility Source: Ground Water

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2015 and 10/31/2015

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 1 Sample(s) Required between 6/1/2015 and 10/31/2015

NITRATE - 1040 1 Sample(s) Required between 6/1/2015 and 10/31/2015

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 1 Sample(s) Required between 6/1/2015 and 10/31/2015

Sample for all the analytes listed below:

ALACHLOR (LASSO) - 2051 ATRAZINE - 2050 SIMAZINE - 2037

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 7/1/2015 and 9/30/2015

1 Sample(s) Required between 10/1/2015 and 12/31/2015



OH5055016 ANGELS FOR ANIMALS PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **DISTRIBUTION**
Location SMP ID: **DS000**

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 7/1/2015 and 12/31/2015

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

TOTAL COLIFORM (TCR) - 3100
1 Sample(s) Required between 1/1/2015 and 3/31/2015
1 Sample(s) Required between 4/1/2015 and 6/30/2015
1 Sample(s) Required between 7/1/2015 and 9/30/2015
1 Sample(s) Required between 10/1/2015 and 12/31/2015

Sampling Facility ID: **DS1** Facility Name: **DISTRIBUTION**
Location SMP ID: **DS201** ADDRESS NOT KNOWN

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH5055018 G'S PIZZA WORLD - BERLIN CENTER PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5062277** Facility Name: **G'S PIZZA WORLD - BERLIN CENTER-TP**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 6/1/2015 and 10/31/2015
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

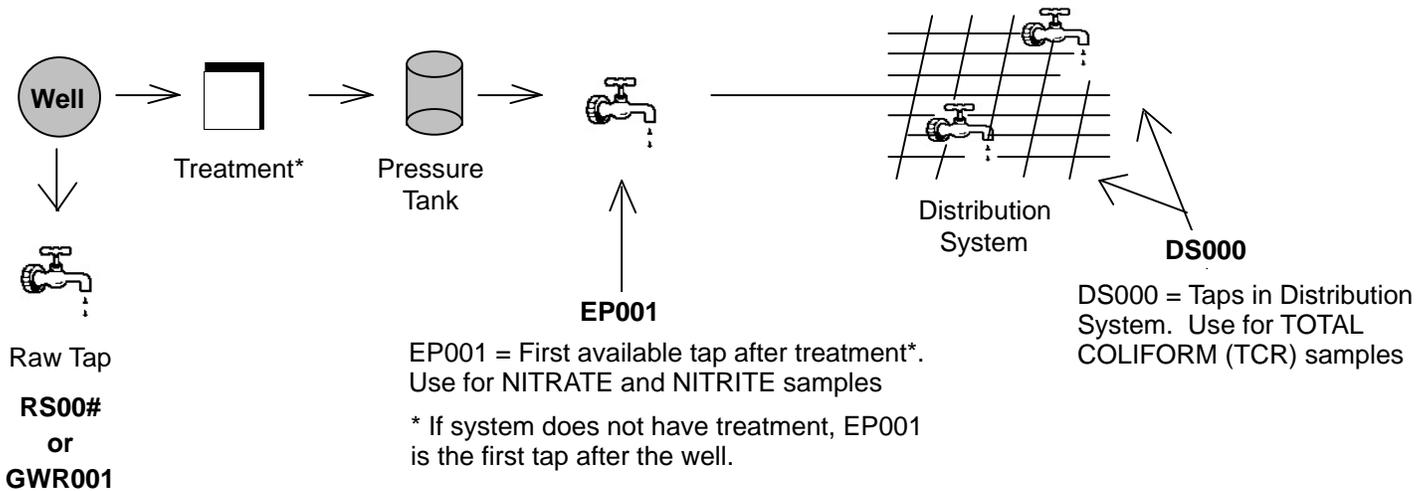

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!