



OH5900112 CARDINGTON VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5956758	Facility Name: CARDINGTON WTP	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2015 and 10/31/2015
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015
RADIOLOGICALS	1 Sample(s) Required between 6/1/2015 and 10/31/2015
<i>Sample for all the analytes listed below:</i>	
GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2015 and 10/31/2015



OH5900112 CARDINGTON VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: CARDINGTON DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	10 Sample(s) Required between 6/1/2015 and 9/30/2015
-------------------------------	--

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

ASBESTOS - 1094	Not Required
-----------------	--------------

TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2015 and 1/31/2015
	2 Sample(s) Required between 2/1/2015 and 2/28/2015
	2 Sample(s) Required between 3/1/2015 and 3/31/2015
	2 Sample(s) Required between 4/1/2015 and 4/30/2015
	2 Sample(s) Required between 5/1/2015 and 5/31/2015
	2 Sample(s) Required between 6/1/2015 and 6/30/2015
	2 Sample(s) Required between 7/1/2015 and 7/31/2015
	2 Sample(s) Required between 8/1/2015 and 8/31/2015
	2 Sample(s) Required between 9/1/2015 and 9/30/2015
	2 Sample(s) Required between 10/1/2015 and 10/31/2015
	2 Sample(s) Required between 11/1/2015 and 11/30/2015
	2 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2015 and 1/31/2015
	2 Sample(s) Required between 2/1/2015 and 2/28/2015
	2 Sample(s) Required between 3/1/2015 and 3/31/2015
	2 Sample(s) Required between 4/1/2015 and 4/30/2015
	2 Sample(s) Required between 5/1/2015 and 5/31/2015
	2 Sample(s) Required between 6/1/2015 and 6/30/2015
	2 Sample(s) Required between 7/1/2015 and 7/31/2015
	2 Sample(s) Required between 8/1/2015 and 8/31/2015
	2 Sample(s) Required between 9/1/2015 and 9/30/2015
	2 Sample(s) Required between 10/1/2015 and 10/31/2015
	2 Sample(s) Required between 11/1/2015 and 11/30/2015
	2 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: CARDINGTON DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2015

2015 DISTRIBUTION SCHEDULE

OH5900112 CARDINGTON VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS202	Facility Name: CARDINGTON DISTRIBUTION ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	---	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH5900412 HICKORY GROVE MOBILE HOME COMMUNITY

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5956761	Facility Name: HICKORY GROVE MOBILE HOME COMMUNITY
	SMP ID: EP001	Facility Source: Ground Water
		Facility Class: CLASS A

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2015 and 10/31/2015
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020	
CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2015 and 10/31/2015



OH5900412 HICKORY GROVE MOBILE HOME COMMUNITY

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

Table with 4 columns: Sampling Location, Facility ID, Facility Name, Facility Class. Values: DS1, DS000, HICKORY GROVE MOBILE HOME COMMUNIT', CLASS 1

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100 1 Sample(s) Required between 1/1/2015 and 1/31/2015 ... 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000 1 Sample(s) Required between 1/1/2015 and 1/31/2015 ... 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Table with 4 columns: Sampling Location, Facility ID, Facility Name, Facility Class. Values: DS1, DS201, HICKORY GROVE MOBILE HOME COMMUNIT', CLASS 1

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 2/8/2015 and 2/14/2015 at SMP: DS201 ... 11/8/2015 and 11/14/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

OH5900512 LAKEVIEW ESTATES MHP

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5956762	Facility Name: LAKEVIEW ESTATES MHP	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

Chemicals	Monitoring Requirements
INORGANICS	1 Sample(s) Required between 6/1/2015 and 10/31/2015
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2015 and 10/31/2015



OH5900512 LAKEVIEW ESTATES MHP

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: LAKEVIEW ESTATES MHP DIST
Location SMP ID: DS000

Chemicals Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 Not Required

TOTAL COLIFORM (TCR) - 3100 1 Sample(s) Required between 1/1/2015 and 1/31/2015
1 Sample(s) Required between 2/1/2015 and 2/28/2015
1 Sample(s) Required between 3/1/2015 and 3/31/2015
1 Sample(s) Required between 4/1/2015 and 4/30/2015
1 Sample(s) Required between 5/1/2015 and 5/31/2015
1 Sample(s) Required between 6/1/2015 and 6/30/2015
1 Sample(s) Required between 7/1/2015 and 7/31/2015
1 Sample(s) Required between 8/1/2015 and 8/31/2015
1 Sample(s) Required between 9/1/2015 and 9/30/2015
1 Sample(s) Required between 10/1/2015 and 10/31/2015
1 Sample(s) Required between 11/1/2015 and 11/30/2015
1 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000 1 Sample(s) Required between 1/1/2015 and 1/31/2015
1 Sample(s) Required between 2/1/2015 and 2/28/2015
1 Sample(s) Required between 3/1/2015 and 3/31/2015
1 Sample(s) Required between 4/1/2015 and 4/30/2015
1 Sample(s) Required between 5/1/2015 and 5/31/2015
1 Sample(s) Required between 6/1/2015 and 6/30/2015
1 Sample(s) Required between 7/1/2015 and 7/31/2015
1 Sample(s) Required between 8/1/2015 and 8/31/2015
1 Sample(s) Required between 9/1/2015 and 9/30/2015
1 Sample(s) Required between 10/1/2015 and 10/31/2015
1 Sample(s) Required between 11/1/2015 and 11/30/2015
1 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Facility ID: DS1 Facility Name: LAKEVIEW ESTATES MHP DIST
Location SMP ID: DS201 ADDRESS NOT KNOWN

Chemicals Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



OH5900712 MT GILEAD VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5956763	Facility Name: MT GILEAD WTP	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015
INORGANICS	1 Sample(s) Required between 6/1/2015 and 10/31/2015
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1015 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015
RADIOLOGICALS	Not Required
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2015 and 10/31/2015

OH5900712 MT GILEAD VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: MT GILEAD DISTRIBUTION	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
LEAD - 1030 AND COPPER - 1022	Not Required
ASBESTOS - 1094	Not Required
TOTAL COLIFORM (TCR) - 3100	4 Sample(s) Required between 1/1/2015 and 1/31/2015 4 Sample(s) Required between 2/1/2015 and 2/28/2015 4 Sample(s) Required between 3/1/2015 and 3/31/2015 4 Sample(s) Required between 4/1/2015 and 4/30/2015 4 Sample(s) Required between 5/1/2015 and 5/31/2015 4 Sample(s) Required between 6/1/2015 and 6/30/2015 4 Sample(s) Required between 7/1/2015 and 7/31/2015 4 Sample(s) Required between 8/1/2015 and 8/31/2015 4 Sample(s) Required between 9/1/2015 and 9/30/2015 4 Sample(s) Required between 10/1/2015 and 10/31/2015 4 Sample(s) Required between 11/1/2015 and 11/30/2015 4 Sample(s) Required between 12/1/2015 and 12/31/2015
TOTAL CHLORINE - 1000	4 Sample(s) Required between 1/1/2015 and 1/31/2015 4 Sample(s) Required between 2/1/2015 and 2/28/2015 4 Sample(s) Required between 3/1/2015 and 3/31/2015 4 Sample(s) Required between 4/1/2015 and 4/30/2015 4 Sample(s) Required between 5/1/2015 and 5/31/2015 4 Sample(s) Required between 6/1/2015 and 6/30/2015 4 Sample(s) Required between 7/1/2015 and 7/31/2015 4 Sample(s) Required between 8/1/2015 and 8/31/2015 4 Sample(s) Required between 9/1/2015 and 9/30/2015 4 Sample(s) Required between 10/1/2015 and 10/31/2015 4 Sample(s) Required between 11/1/2015 and 11/30/2015 4 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: MT GILEAD DISTRIBUTION 900 ORCHARD DRIVE	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2015

2015 DISTRIBUTION SCHEDULE

OH5900712 MT GILEAD VILLAGE PWS

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: MT GILEAD DISTRIBUTION	Facility Class: CLASS 1
	SMP ID: DS202	165 FAIRWAY LANE	

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



OH5901012 CANDLEWOOD LAKE ASSOCIATION INC

System Type: Community

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5956765	Facility Name: CANDLEWOOD LAKE WTP	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015

Chemicals	Monitoring Requirements
ARSENIC - 1005	1 Sample(s) Required between 1/1/2015 and 3/31/2015 1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015
INORGANICS	1 Sample(s) Required between 6/1/2015 and 10/31/2015
<i>Sample for all the analytes listed below:</i>	
ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1015 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL	
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015
RADIOLOGICALS	1 Sample(s) Required between 6/1/2015 and 10/31/2015
<i>Sample for all the analytes listed below:</i>	
GROSS ALPHA - 4002 RADIUM-228 - 4030	
SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2015 and 10/31/2015



OH5901012 CANDLEWOOD LAKE ASSOCIATION INC

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1 SMP ID: DS000	Facility Name: CANDLEWOOD LAKE ASSN INC DISTRIBUTIC	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

LEAD - 1030 AND COPPER - 1022	Not Required
-------------------------------	--------------

TOTAL COLIFORM (TCR) - 3100	2 Sample(s) Required between 1/1/2015 and 1/31/2015
	2 Sample(s) Required between 2/1/2015 and 2/28/2015
	2 Sample(s) Required between 3/1/2015 and 3/31/2015
	2 Sample(s) Required between 4/1/2015 and 4/30/2015
	2 Sample(s) Required between 5/1/2015 and 5/31/2015
	2 Sample(s) Required between 6/1/2015 and 6/30/2015
	2 Sample(s) Required between 7/1/2015 and 7/31/2015
	2 Sample(s) Required between 8/1/2015 and 8/31/2015
	2 Sample(s) Required between 9/1/2015 and 9/30/2015
	2 Sample(s) Required between 10/1/2015 and 10/31/2015
	2 Sample(s) Required between 11/1/2015 and 11/30/2015
	2 Sample(s) Required between 12/1/2015 and 12/31/2015

TOTAL CHLORINE - 1000	2 Sample(s) Required between 1/1/2015 and 1/31/2015
	2 Sample(s) Required between 2/1/2015 and 2/28/2015
	2 Sample(s) Required between 3/1/2015 and 3/31/2015
	2 Sample(s) Required between 4/1/2015 and 4/30/2015
	2 Sample(s) Required between 5/1/2015 and 5/31/2015
	2 Sample(s) Required between 6/1/2015 and 6/30/2015
	2 Sample(s) Required between 7/1/2015 and 7/31/2015
	2 Sample(s) Required between 8/1/2015 and 8/31/2015
	2 Sample(s) Required between 9/1/2015 and 9/30/2015
	2 Sample(s) Required between 10/1/2015 and 10/31/2015
	2 Sample(s) Required between 11/1/2015 and 11/30/2015
	2 Sample(s) Required between 12/1/2015 and 12/31/2015

Samples should be collected at the same time and place as the Total Coliform samples.

Sampling Location	Facility ID: DS1 SMP ID: DS201	Facility Name: CANDLEWOOD LAKE ASSN INC DISTRIBUTIC ADDRESS NOT KNOWN	Facility Class: CLASS 1
--------------------------	---	--	--------------------------------

Chemicals	Monitoring Requirements
-----------	-------------------------

DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201
-------------------------	---

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950



Effective Date: 01/01/2015

2015 DISTRIBUTION SCHEDULE

OH5901012 CANDLEWOOD LAKE ASSOCIATION INC

System Type: Community

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

**** REMINDER: ** Consumer Confidence Report (CCR) is due July 1, 2015**

DISTRIBUTION MONITORING SCHEDULE

Sampling Location	Facility ID: DS1	Facility Name: CANDLEWOOD LAKE ASSN INC DISTRIBUTIC	Facility Class: CLASS 1
	SMP ID: DS202	ADDRESS NOT KNOWN	

Chemicals	Monitoring Requirements
DISINFECTION BYPRODUCTS	1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH5931712 CLEARFORK MARINA

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **CLEARFORK MARINA DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5956768** Facility Name: **CLEARFORK MARINA**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

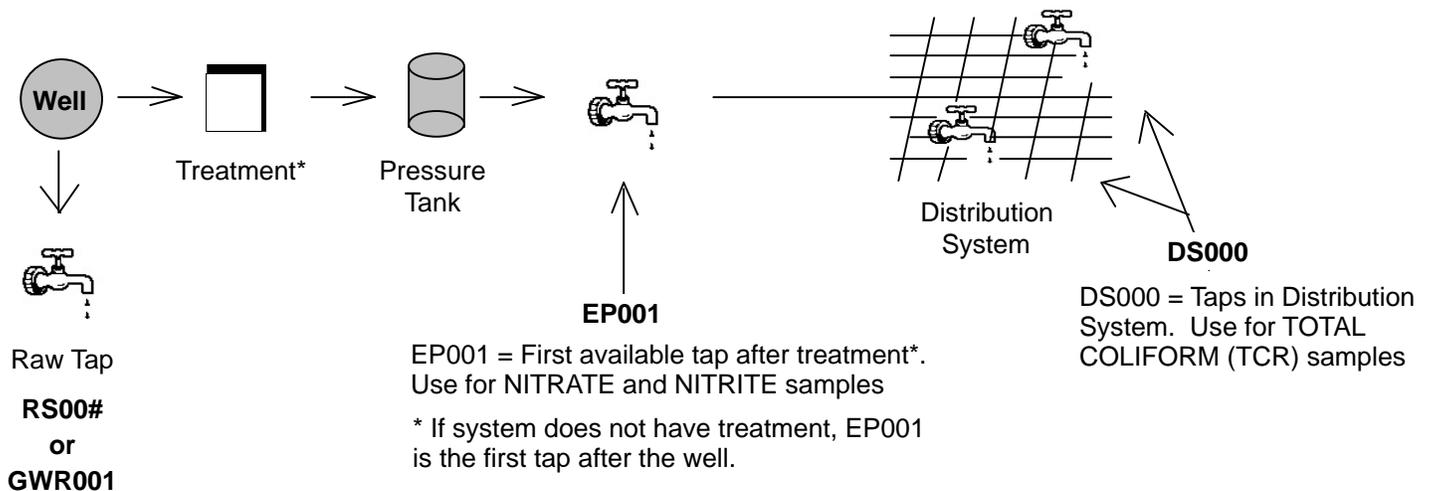

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5931812 CLEARFORK CAMPGROUND

System Type: Transient Noncommunity

Operating Period: 4/1 to 10/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **CLEARFORK CAMPGROUND DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5956769** Facility Name: **CLEARFORK CAMPGROUND**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

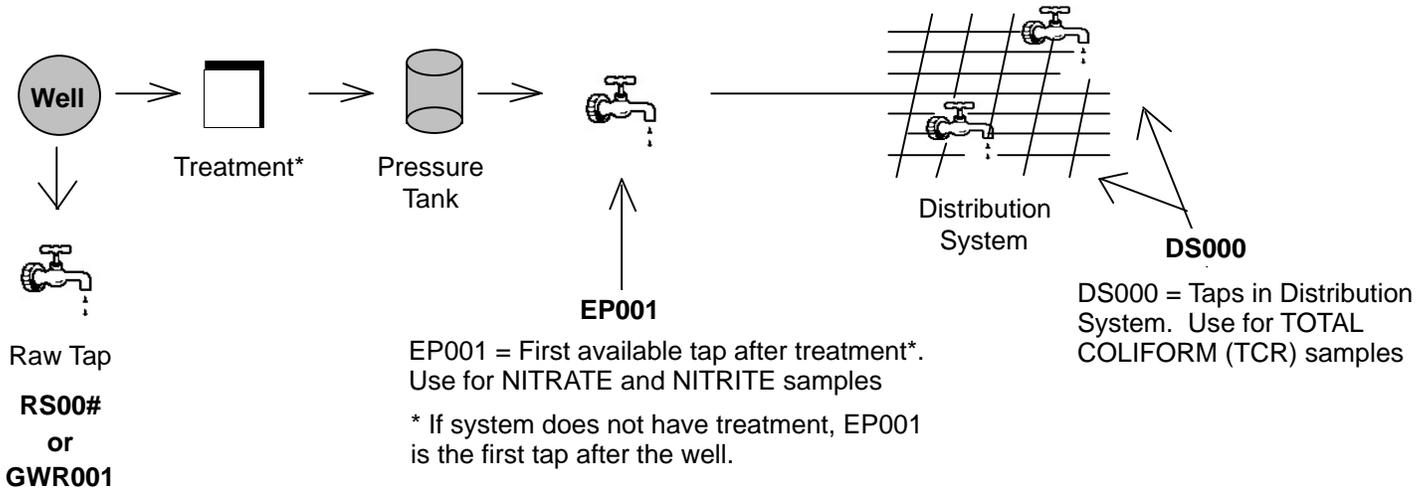

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5935712 MID-OHIO SPORTS MAINTENANCE

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **MID-OHIO SPORTS MAINTENANCE DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5956779** Facility Name: **MID-OHIO SPORTS MAINTENANCE**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

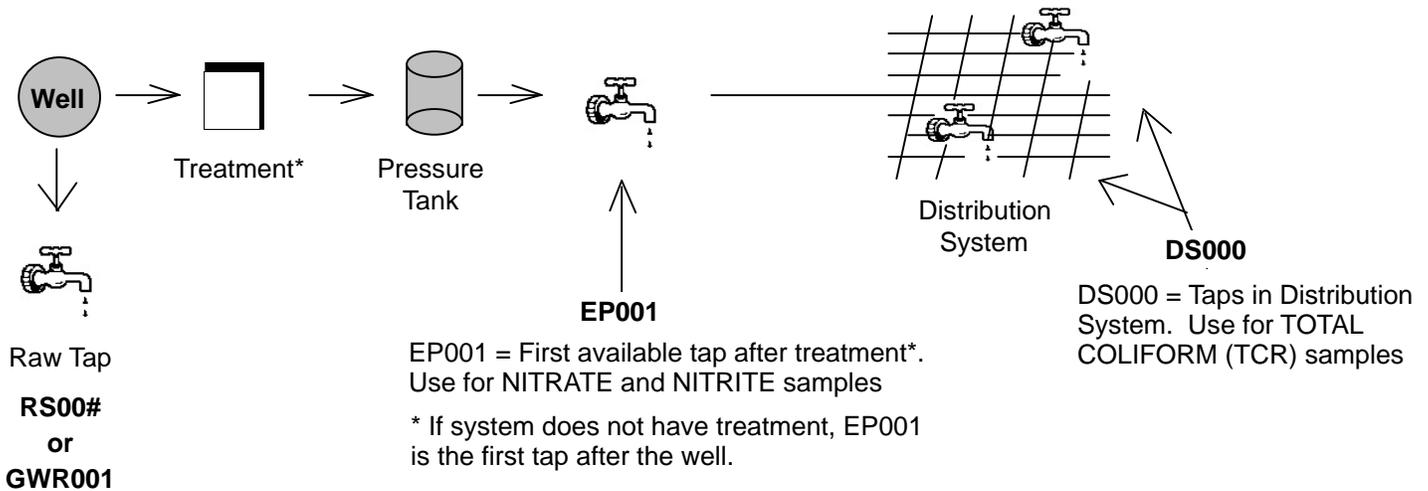

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5935812 MID-OHIO SPORTS TOWER

System Type: Transient Noncommunity

Operating Period: 4/1 to 11/30

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **MID-OHIO SPORTS/TOWER DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5956780** Facility Name: **MID-OHIO SPORTS/TOWER**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

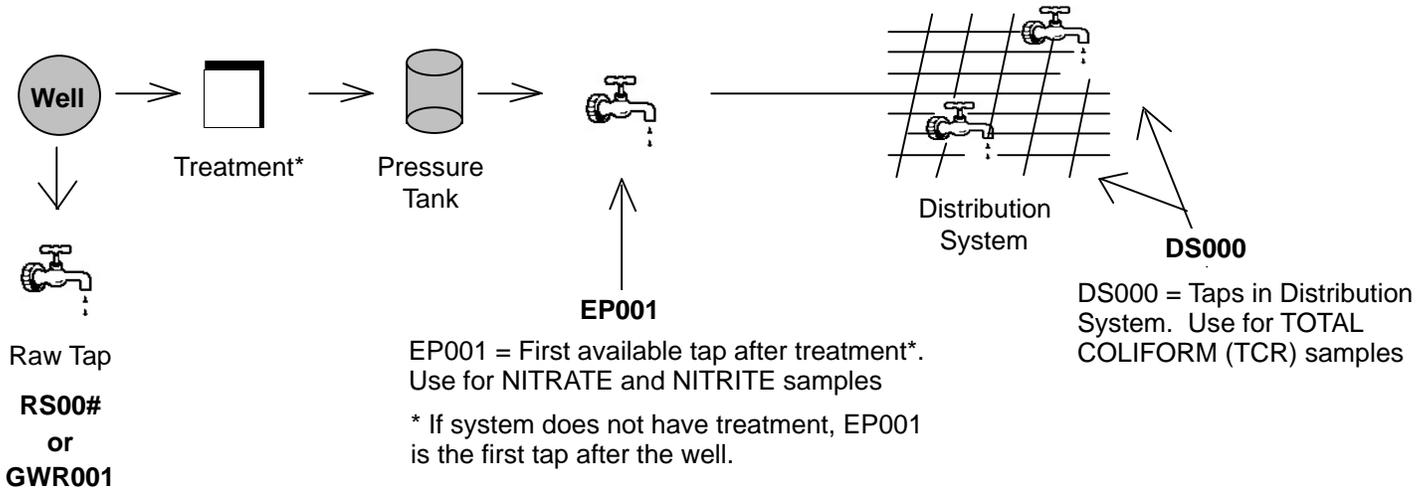

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



Effective Date: 01/01/2015

2015 ENTRY POINT SCHEDULE

OH5936212 NORTHMOR ADMINISTRATIVE OFFICE

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5956783	Facility Name: NORTHMOR ADMINISTRATIVE OFFICE	Facility Class: CLASS A
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

INORGANICS 1 Sample(s) Required between 6/1/2015 and 10/31/2015

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 ARSENIC - 1005 BARIUM - 1010 BERYLLIUM, TOTAL - 1075 CADMIUM - 1015 CHROMIUM - 1020

CYANIDE - 1024 FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL - 1085

NITRITE - 1041 Not Required

NITRATE - 1040 1 Sample(s) Required between 6/1/2015 and 10/31/2015

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1 Not Required

VOLATILE ORGANIC CHEMICALS (VOC) 1 Sample(s) Required between 6/1/2015 and 10/31/2015



Effective Date: 01/01/2015

2015 DISTRIBUTION SCHEDULE

OH5936212 NORTHMOR ADMINISTRATIVE OFFICE

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **NORTHMOR ADMIN. OFFICE DISTRIBUTUTIOI**
Location SMP ID: **DS000**

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 5 Sample(s) Required between 6/1/2015 and 9/30/2015

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: <http://epa.ohio.gov/ddagw/reporting.aspx>

TOTAL COLIFORM (TCR) - 3100
1 Sample(s) Required between 1/1/2015 and 3/31/2015
1 Sample(s) Required between 4/1/2015 and 6/30/2015
1 Sample(s) Required between 7/1/2015 and 9/30/2015
1 Sample(s) Required between 10/1/2015 and 12/31/2015

OH5936412 OHIO RETREAT CENTER

System Type: Transient Noncommunity

Operating Period: 5/1 to 10/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **OHIO RETREAT CENTER DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015 1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5956785** Facility Name: **OHIO RETREAT CENTER**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

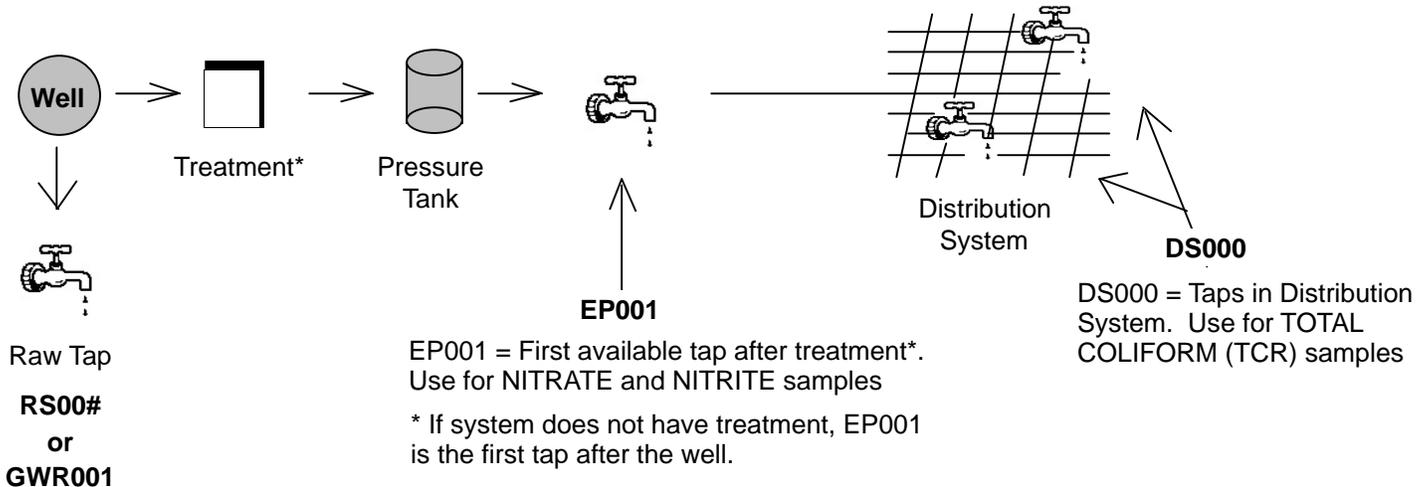

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5936712 PLEASANT GROVE CHURCH OF CHRIST

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **PLEASANT GROVE CHURCH OF DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5956788** Facility Name: **PLEASANT GROVE CHURCH OF CHRST**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

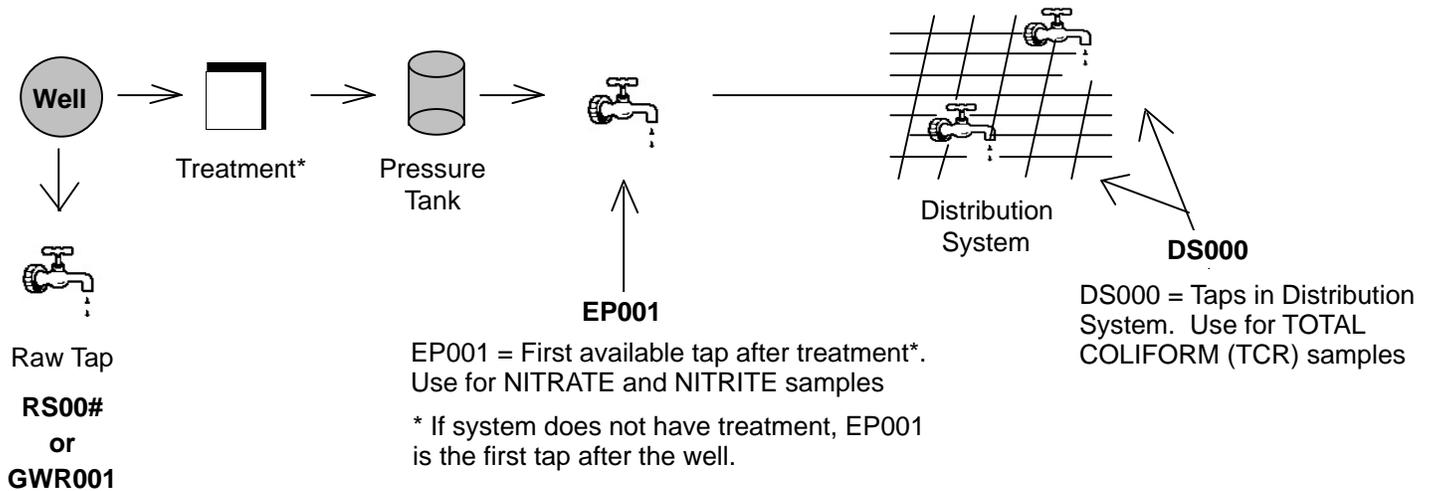

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5941112 GALION COUNTRY CLUB POOL PWS

System Type: Transient Noncommunity

Operating Period: 5/1 to 9/30

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **GALION COUNTRY CLUB POOL DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5956804** Facility Name: **GALION COUNTRY CLUB POOL**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

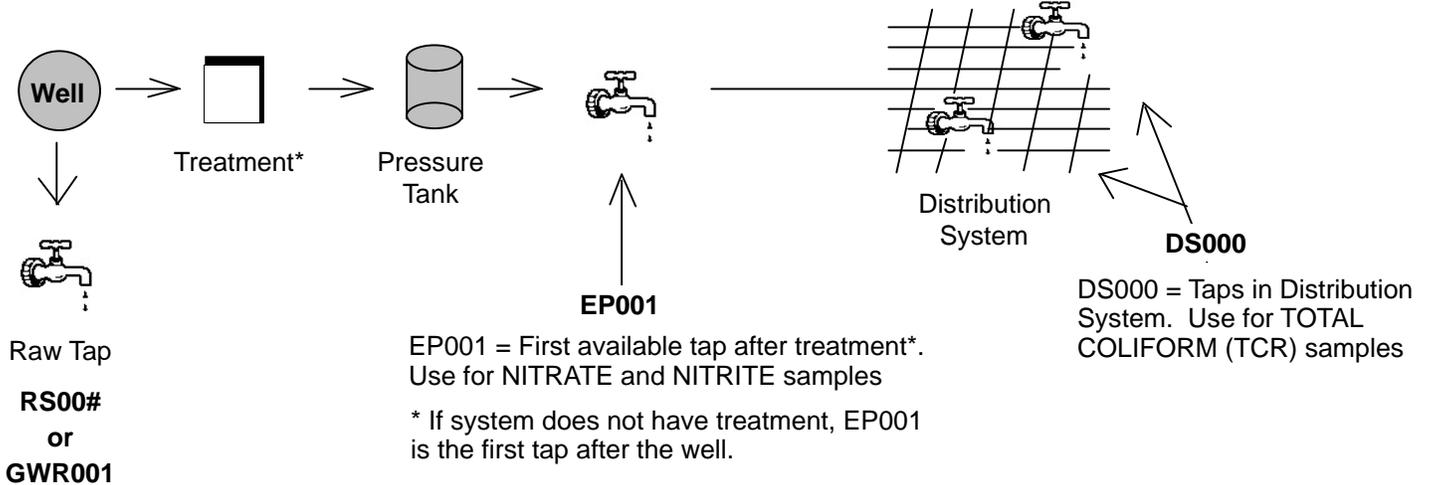

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5941222 GALION COUNTRY CLUB LODGE PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.


Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5956805** Facility Name: **GALION COUNTRY CLUB LODGE**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

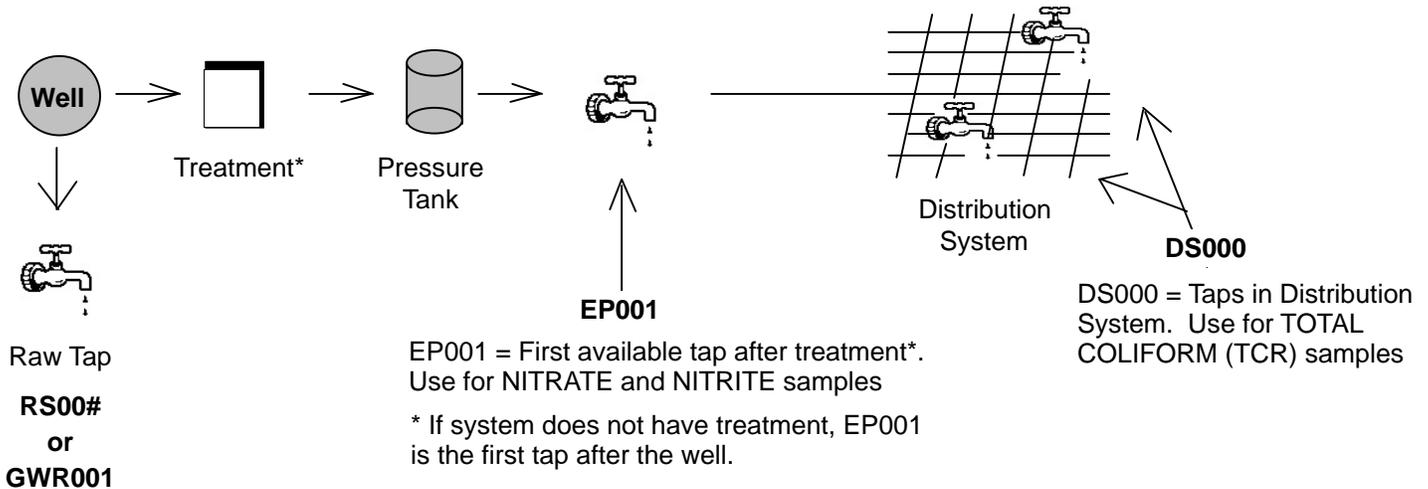

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:

<http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>

Save a dime. Sample on time!

OH5941912 GRANT GALBRAITH MD, INC. PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **GRANT GALBRAITH MD, INC. DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5961626** Facility Name: **GRANT GALBRAITH MD, INC.**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

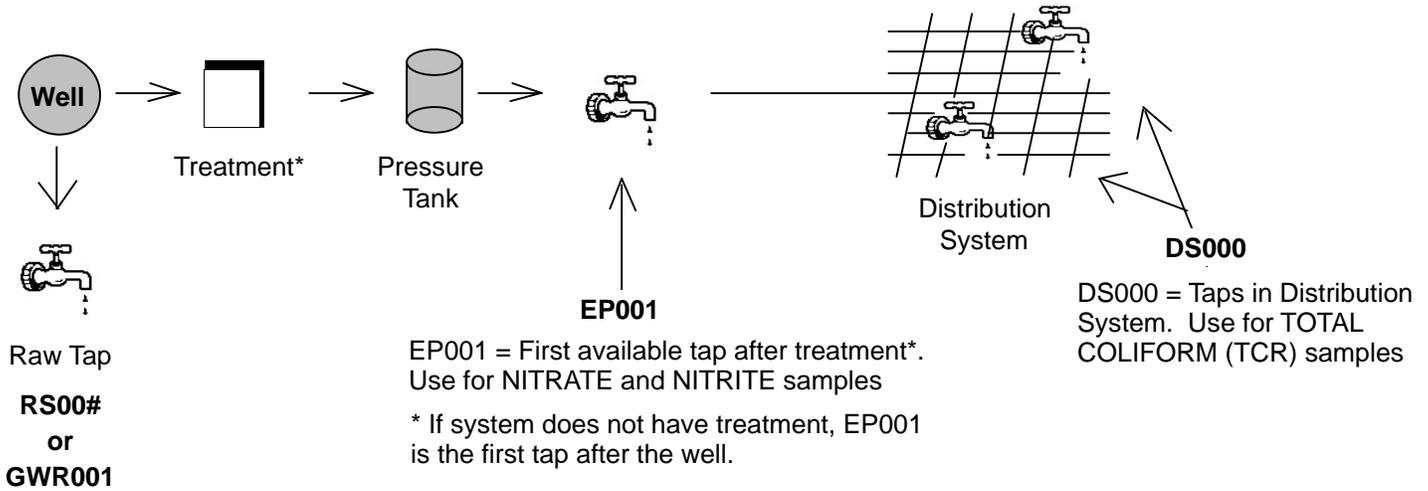

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:
<http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5942012 NORTHFIELD MEDICAL BLDG PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **NORTHFIELD MEDICAL BLDG DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5961627** Facility Name: **NORTHFIELD MEDICAL BLDG**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

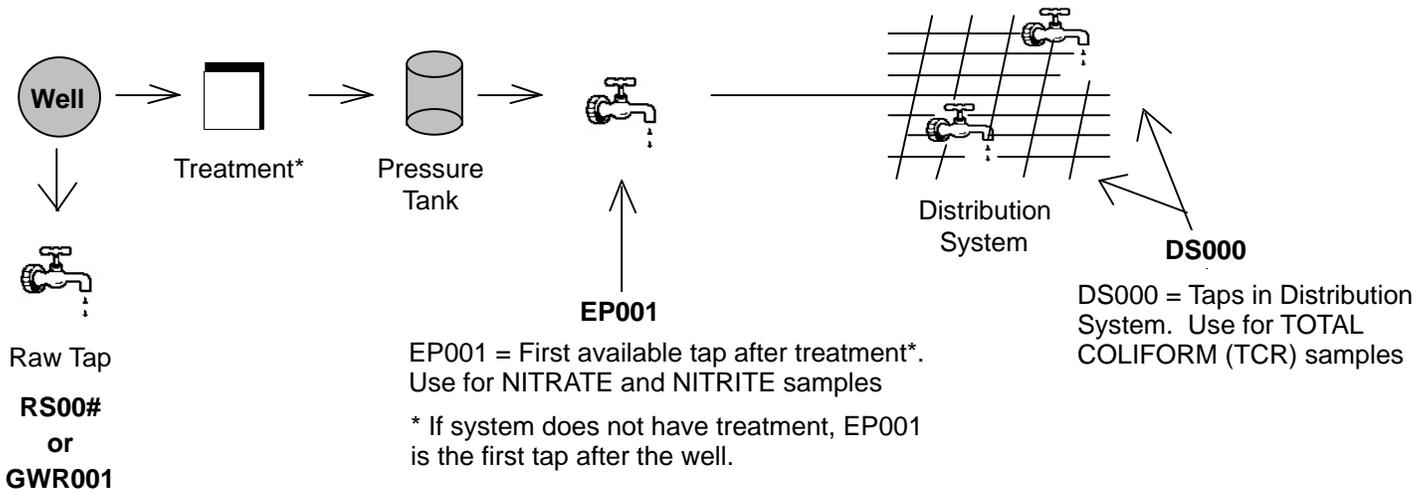

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5942212 FRESH FAITH COMMUNITY CHURCH PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **FRESH FAITH COMM CHURCH DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5962148** Facility Name: **FRESH FAITH COMMUNITY CHURCH**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

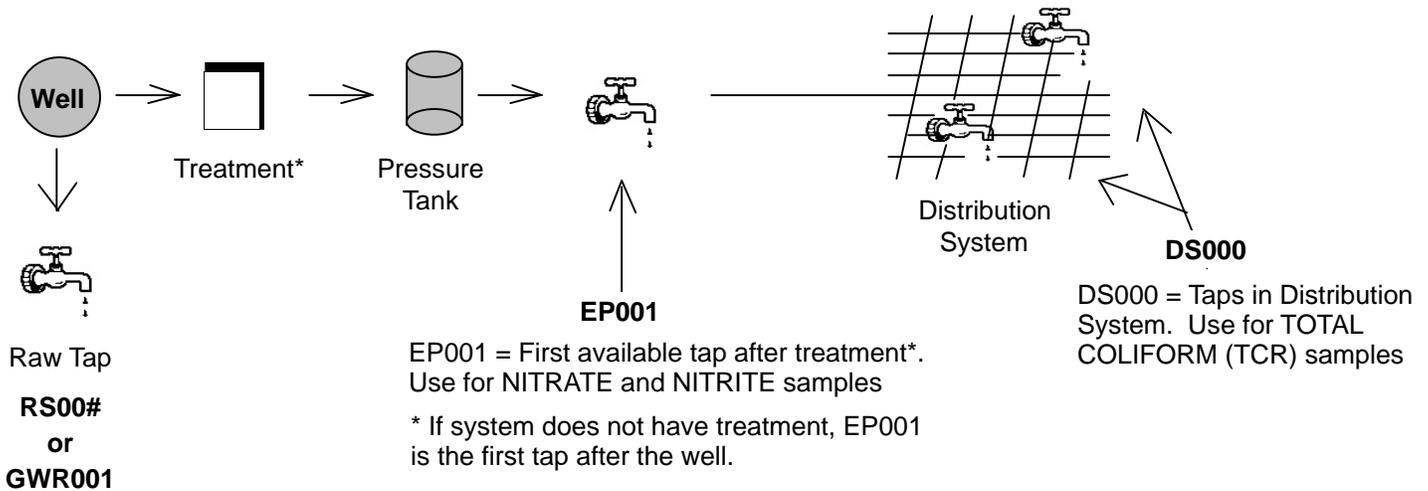

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5942312 YODERS COUNTRY DINER

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **YODERS COUNTRY DINER DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5962248** Facility Name: **YODERS COUNTRY DINER**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

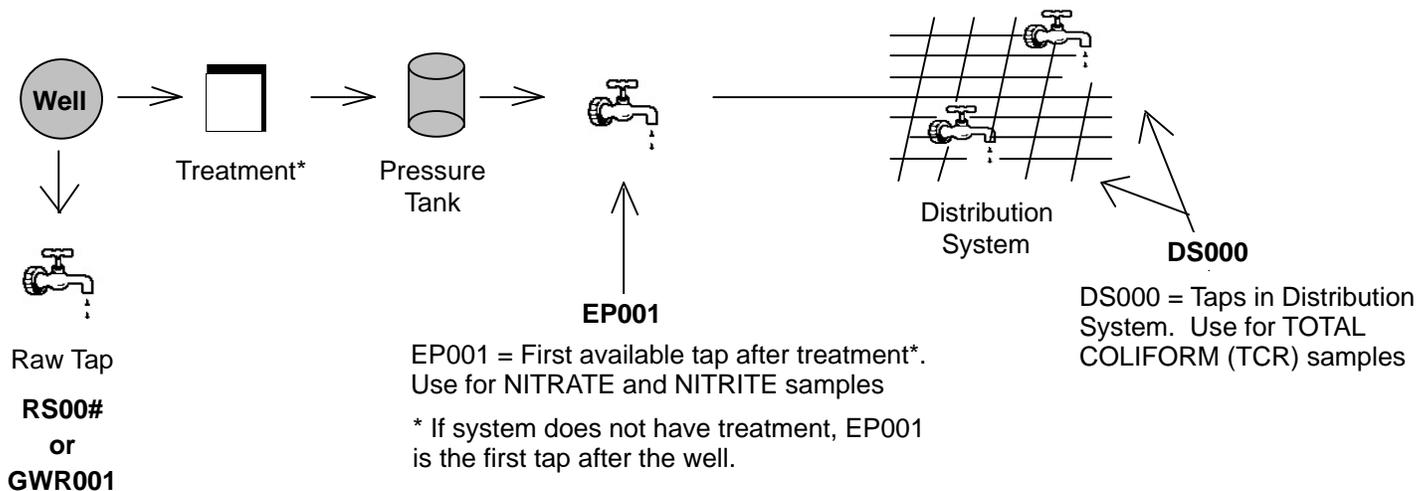

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5942512 PENIEL BIBLE CAMP PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **PENIEL BIBLE CAMP DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5962264** Facility Name: **PENIEL BIBLE CAMP**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	Not Required
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

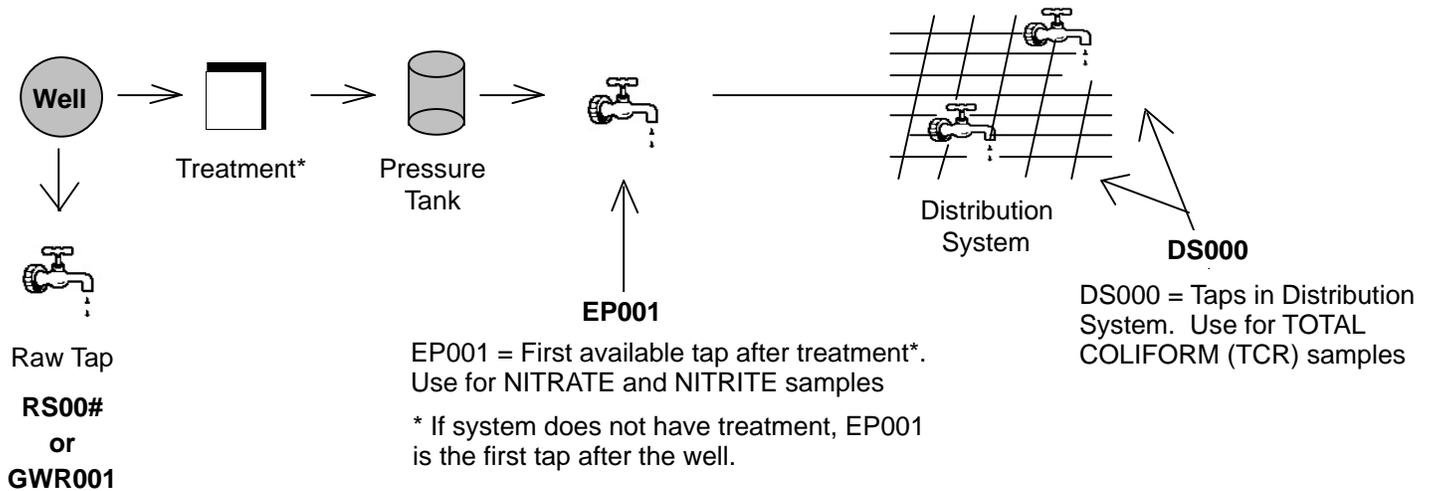

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!

OH5942612 HIGHLAND PIZZA AND ICE CREAM PWS

System Type: Transient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1	Facility Name: HIGHLAND PIZZA AND ICE CREAM DISTRIBUTIO
Location SMP ID: DS000	Facility Source: Ground Water


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: 5962265	Facility Name: HIGHLAND PIZZA AND ICE CREAM
Location SMP ID: EP001	Facility Source: Ground Water

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 6/1/2015 and 10/31/2015
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

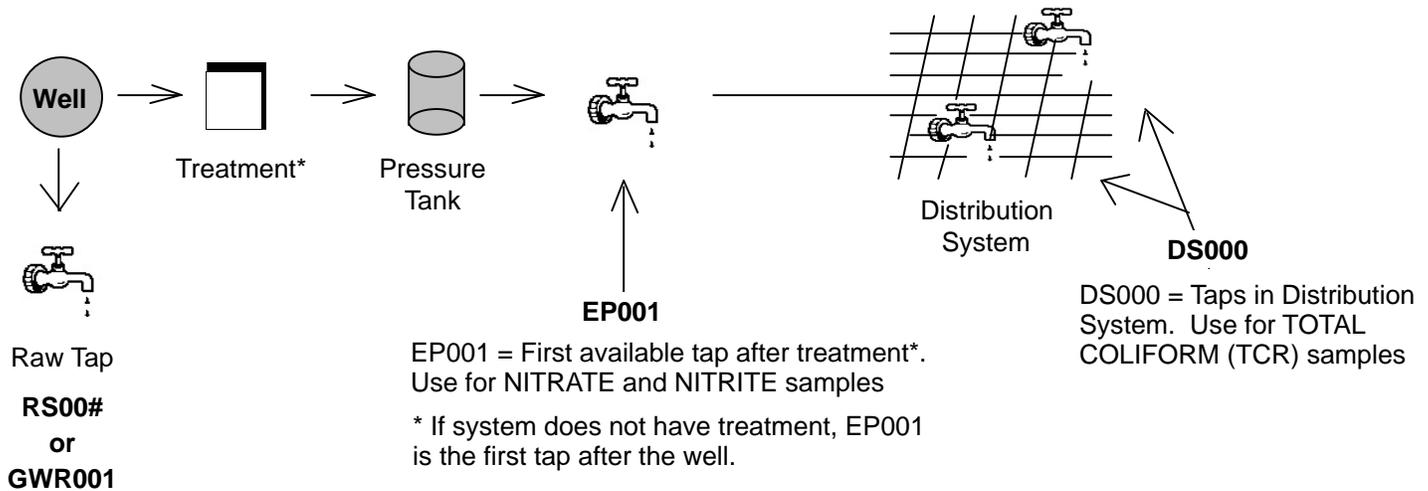

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at: <http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!



OH5942712 NORTHMOR SCHOOL PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

ENTRY POINT MONITORING SCHEDULE

Sampling Location	Facility ID: 5962375	Facility Name: NORTHMOR SCHOOL	Facility Class: CLASS 1
	SMP ID: EP001	Facility Source: Ground Water	

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

Chemicals

Monitoring Requirements

ARSENIC - 1005	1 Sample(s) Required between 1/1/2015 and 3/31/2015
	1 Sample(s) Required between 4/1/2015 and 6/30/2015
	1 Sample(s) Required between 7/1/2015 and 9/30/2015
	1 Sample(s) Required between 10/1/2015 and 12/31/2015

INORGANICS	1 Sample(s) Required between 6/1/2015 and 10/31/2015
------------	--

Sample for all the analytes listed below:

ANTIMONY, TOTAL - 1074 BARIUM - 1010 BERYLLIUM, TOTAL - 1015 CADMIUM - 1015 CHROMIUM - 1020 CYANIDE - 1024
FLUORIDE - 1025 MERCURY - 1035 NICKEL - 1036 SELENIUM - 1045 THALLIUM, TOTAL

NITRITE - 1041	Not Required
----------------	--------------

NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015
----------------	--

SYNTHETIC ORGANIC CHEMICALS (SOC) GROUP 1	Not Required
---	--------------

VOLATILE ORGANIC CHEMICALS (VOC)	1 Sample(s) Required between 6/1/2015 and 10/31/2015
----------------------------------	--



OH5942712 NORTHMOR SCHOOL PWS

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: DS1 Facility Name: NORTHMOR SCHOOL DISTRIBUTION
Location SMP ID: DS000

Chemicals

Monitoring Requirements

LEAD - 1030 AND COPPER - 1022 10 Sample(s) Required between 6/1/2015 and 9/30/2015

Lead Consumer Notice needs issued to sampling participants within thirty days of receipt of results and verification submitted to Ohio EPA within ninety days from the end of the monitoring period. Submit Form 5105 with appendix to Ohio EPA within ten days from the end of the monitoring period. Forms are available online at: http://epa.ohio.gov/ddagw/reporting.aspx

TOTAL COLIFORM (TCR) - 3100 2 Sample(s) Required between 1/1/2015 and 1/31/2015
2 Sample(s) Required between 2/1/2015 and 2/28/2015
2 Sample(s) Required between 3/1/2015 and 3/31/2015
2 Sample(s) Required between 4/1/2015 and 4/30/2015
2 Sample(s) Required between 5/1/2015 and 5/31/2015
2 Sample(s) Required between 6/1/2015 and 6/30/2015
2 Sample(s) Required between 7/1/2015 and 7/31/2015
2 Sample(s) Required between 8/1/2015 and 8/31/2015
2 Sample(s) Required between 9/1/2015 and 9/30/2015
2 Sample(s) Required between 10/1/2015 and 10/31/2015
2 Sample(s) Required between 11/1/2015 and 11/30/2015
2 Sample(s) Required between 12/1/2015 and 12/31/2015

Sampling Facility ID: DS1 Facility Name: NORTHMOR SCHOOL DISTRIBUTION
Location SMP ID: DS201 ADDRESS NOT KNOWN

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS201

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950

Sampling Facility ID: DS1 Facility Name: NORTHMOR SCHOOL DISTRIBUTION
Location SMP ID: DS202 ADDRESS NOT KNOWN

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS 1 Sample(s) Required between 7/1/2015 and 9/30/2015 at SMP: DS202

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) - 2456
2) TTHM - 2950



OH5942713 CARDINGTON LINCOLN HIGH SCHOOL

System Type: Nontransient Noncommunity

Operating Period: 1/1 to 12/31

Groundwater Rule Substantial Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **DISTRIBUTION**
Location SMP ID: **DS000**

Chemicals

Monitoring Requirements

TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between	1/1/2015	and	3/31/2015
	1 Sample(s) Required between	4/1/2015	and	6/30/2015
	1 Sample(s) Required between	7/1/2015	and	9/30/2015
	1 Sample(s) Required between	10/1/2015	and	12/31/2015

Sampling Facility ID: **DS1** Facility Name: **DISTRIBUTION**
Location SMP ID: **DS201** ADDRESS NOT KNOWN

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS	1 Sample(s) Required between	7/1/2015	and	9/30/2015	at SMP: DS201
-------------------------	------------------------------	----------	-----	-----------	---------------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

Sampling Facility ID: **DS1** Facility Name: **DISTRIBUTION**
Location SMP ID: **DS202** ADDRESS NOT KNOWN

Chemicals

Monitoring Requirements

DISINFECTION BYPRODUCTS	1 Sample(s) Required between	7/1/2015	and	9/30/2015	at SMP: DS202
-------------------------	------------------------------	----------	-----	-----------	---------------

Sample for all the analytes listed below:

- 1) TOTAL HALOACETIC ACIDS (HAA5) – 2456
- 2) TTHM - 2950

OH5942714 MID-OHIO SPORTS INFIELD PWS

System Type: Transient Noncommunity

Operating Period: 4/1 to 9/30

Groundwater Rule Minimal Treatment System

THIS SCHEDULE MAY NOT INCLUDE ALL MONITORING REQUIREMENTS FOR YOUR SYSTEM.

Contact your district office to review additional monitoring for operating parameters, and/or other monitoring requirements not included on this schedule. For water emergencies that occur after hours, please call 800-282-9378

DISTRIBUTION MONITORING SCHEDULE

Sampling Facility ID: **DS1** Facility Name: **DISTRIBUTION**
Location SMP ID: **DS000** Facility Source: **Ground Water**


Chemicals	Monitoring Requirements
TOTAL COLIFORM (TCR) - 3100	1 Sample(s) Required between 4/1/2015 and 6/30/2015 1 Sample(s) Required between 7/1/2015 and 9/30/2015

ENTRY POINT MONITORING SCHEDULE

Sampling Facility ID: **5962377** Facility Name: **MID-OHIO SPORTS INFIELD**
Location SMP ID: **EP001** Facility Source: **Ground Water**

Chemicals	Monitoring Requirements
NITRITE - 1041	1 Sample(s) Required between 6/1/2015 and 10/31/2015
NITRATE - 1040	1 Sample(s) Required between 6/1/2015 and 10/31/2015

Where to Collect Samples For a Small Public Water System

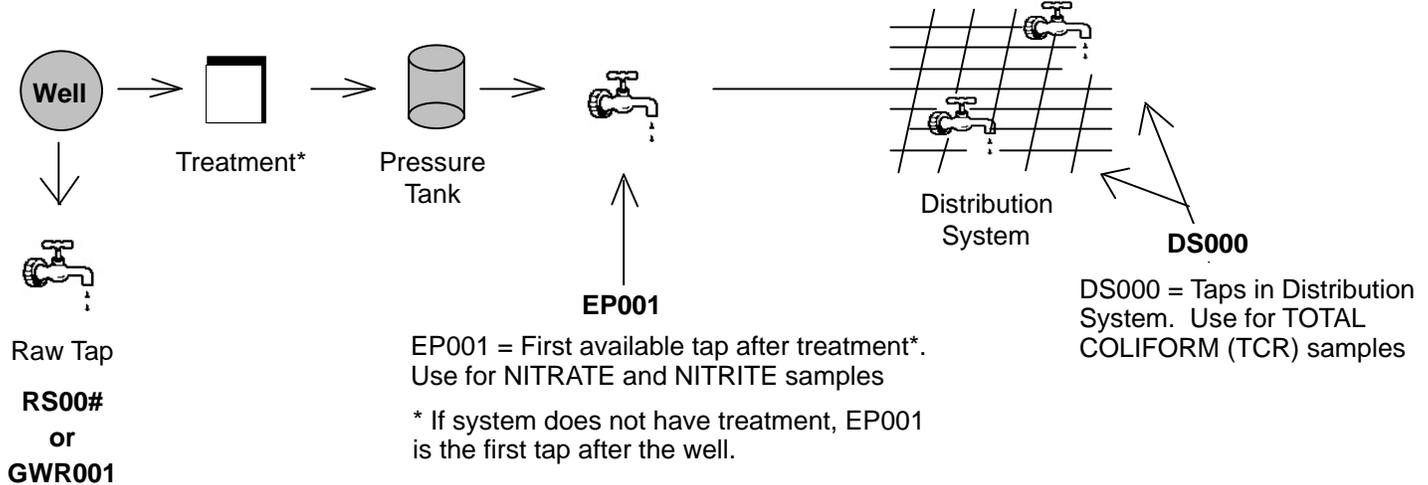

Failing to sample for total coliform or nitrate will cost you \$150 or more in penalties for each monitoring violation. A list of drinking water sample collection services that can assist you with collecting water samples is located at:
<http://epa.ohio.gov/portals/28/documents/PWS/DWSample.pdf>.

Save a dime. Sample on time!